




OIL ANALYSIS REPORT

Sample Rating Trend

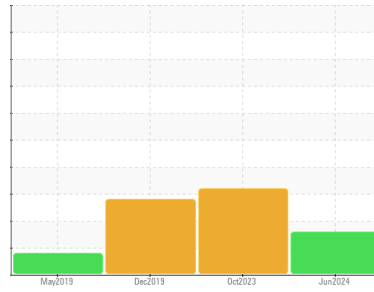

ISO



Machine Id
KAESER ASD 40 6636306 (S/N 1049)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC06216880	KC05994388	KC76282
Sample Date	Client Info		04 Jun 2024	26 Oct 2023	04 Dec 2019
Machine Age	hrs	Client Info	14537	12500	2130
Oil Age	hrs	Client Info	0	0	1124
Oil Changed	Client Info		N/A	N/A	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	<1	<1	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	3	<1	<1
Lead	ppm	ASTM D5185m >10	<1	0	<1
Copper	ppm	ASTM D5185m >50	8	4	1
Tin	ppm	ASTM D5185m >10	<1	<1	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	2	22	5
Molybdenum	ppm	ASTM D5185m	<1	<1	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 90	6	24	53
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	25	74	7
Zinc	ppm	ASTM D5185m	22	37	0

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	0	<1
Sodium	ppm	ASTM D5185m	10	24	10
Potassium	ppm	ASTM D5185m >20	5	1	6
Water	%	ASTM D6304 >0.05	0.042	▲ 0.056	▲ 0.236
ppm Water	ppm	ASTM D6304 >500	428	▲ 562.2	▲ 2360

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		16111	34965	---
Particles >6µm	ASTM D7647 >1300		▲ 6977	▲ 8431	---
Particles >14µm	ASTM D7647 >80		▲ 683	▲ 265	---
Particles >21µm	ASTM D7647 >20		▲ 136	▲ 46	---
Particles >38µm	ASTM D7647 >4		4	1	---
Particles >71µm	ASTM D7647 >3		0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 21/20/17	▲ 22/20/15	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.38	0.35	0.346

OIL ANALYSIS REPORT


▲ Particle Trend

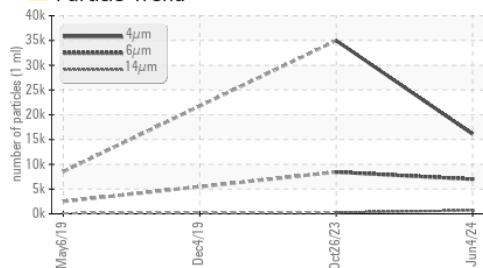


Water (KF)

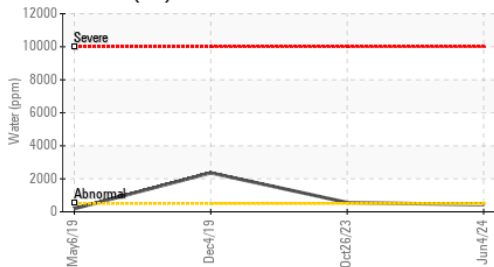


Acid Number

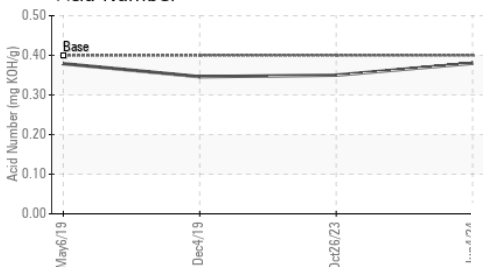

Water (KF)

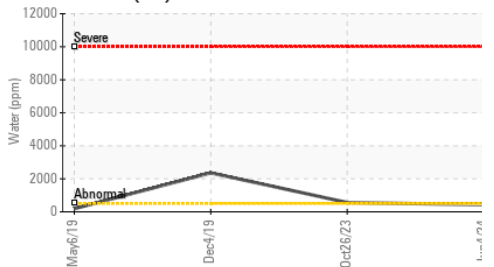

Viscosity @ 40°C

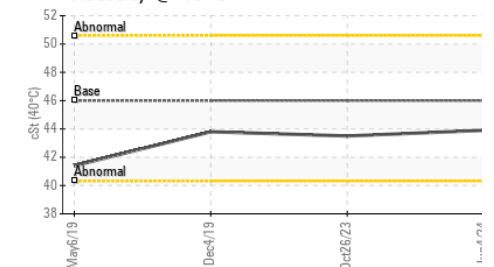

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	LIGHT	NONE
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	● HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.9	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

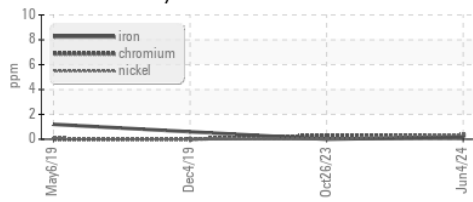


Non-ferrous Metals

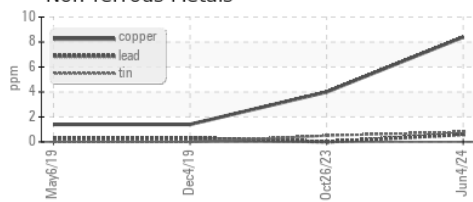


Viscosity @ 40°C

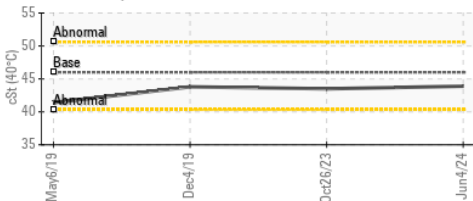

▲ Particle Count

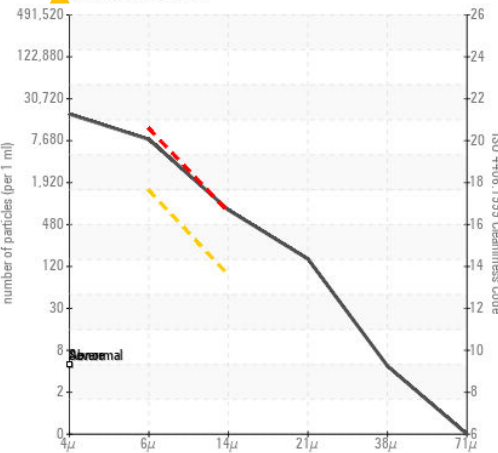

Acid Number

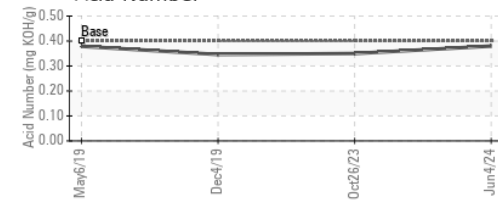

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KC06216880

Lab Number : 06216880

Unique Number : 11089744

Test Package : IND 2

Received : 21 Jun 2024

Tested : 24 Jun 2024

Diagnosed : 24 Jun 2024 - Don Baldrige

CANTRELL

1400 BRADFORD ST EXT

GAINESVILLE, GA

US 30501

Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: