




OIL ANALYSIS REPORT

Sample Rating Trend

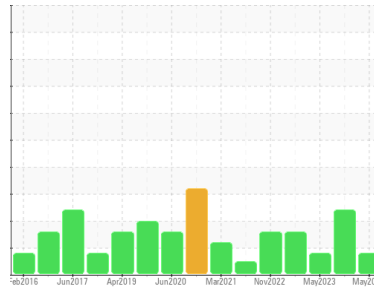

WEAR



Machine Id
KAESER SM 15 5393827 (S/N 1467)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

Wear

The copper level is abnormal. All other component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC06216895	KC05975746	KC05869479
Sample Date	Client Info		10 May 2024	28 Sep 2023	25 May 2023
Machine Age	hrs	Client Info	64043	59646	57085
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	3	0	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	▲ 151	28	▲ 59
Tin	ppm	ASTM D5185m >10	<1	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	1	0	0
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m 90	11	45	18
Calcium	ppm	ASTM D5185m 2	0	3	0
Phosphorus	ppm	ASTM D5185m	4	2	4
Zinc	ppm	ASTM D5185m	93	81	55

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	0	0
Sodium	ppm	ASTM D5185m	2	19	8
Potassium	ppm	ASTM D5185m >20	2	2	<1
Water	%	ASTM D6304 >0.05	0.010	0.020	0.007
ppm Water	ppm	ASTM D6304 >500	107	206.9	73.0






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		137	130284	3166
Particles >6µm	ASTM D7647 >1300		45	▲ 68780	837
Particles >14µm	ASTM D7647 >80		4	▲ 12226	70
Particles >21µm	ASTM D7647 >20		1	▲ 3847	11
Particles >38µm	ASTM D7647 >4		0	▲ 175	1
Particles >71µm	ASTM D7647 >3		0	▲ 11	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	14/13/9	▲ 24/23/21	19/17/13

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.30	0.35	0.33


OIL ANALYSIS REPORT

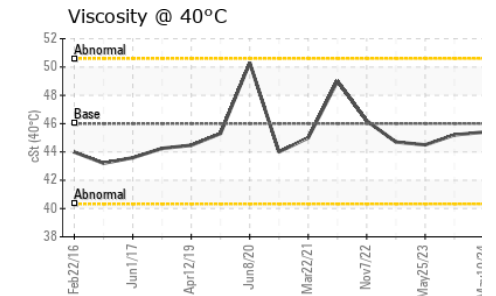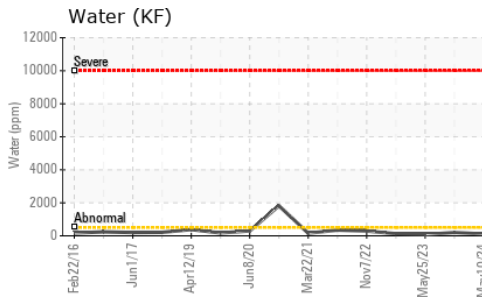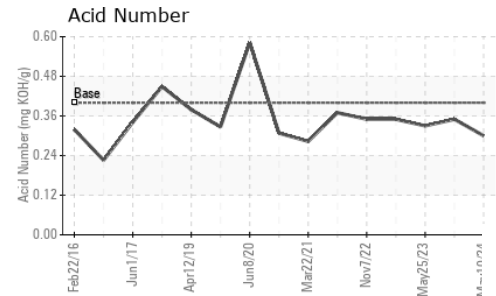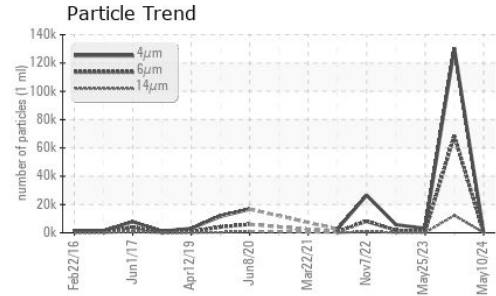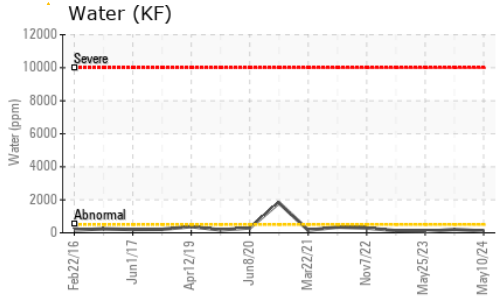






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.4	45.2	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

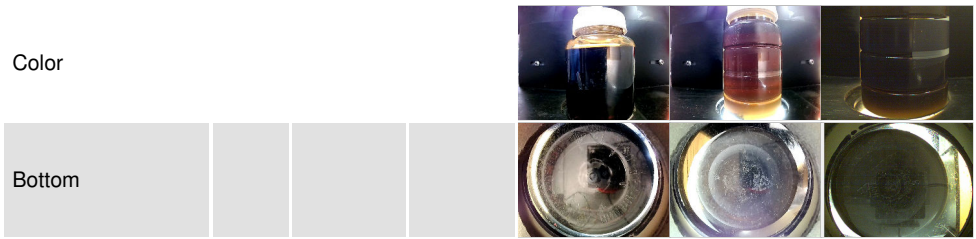

GRAPHS

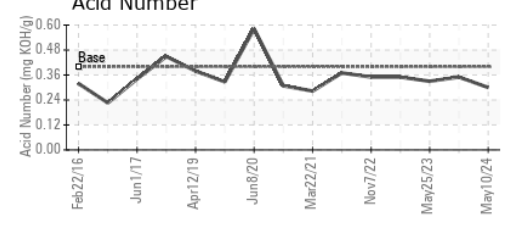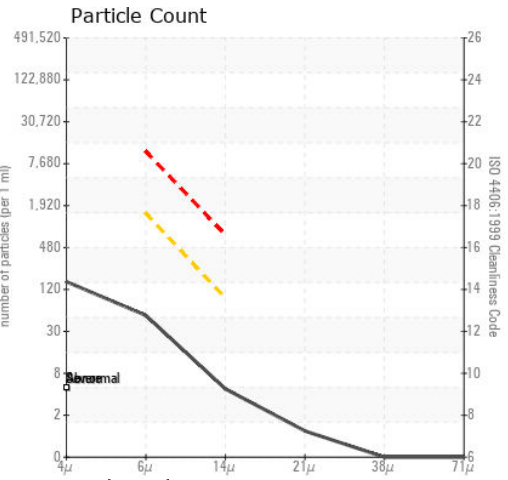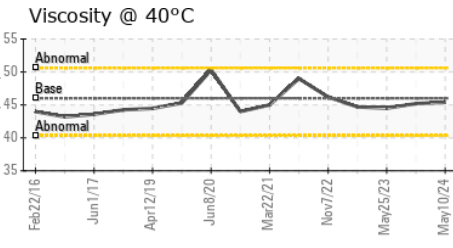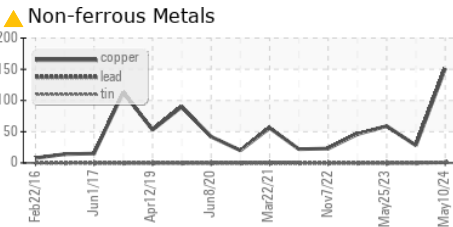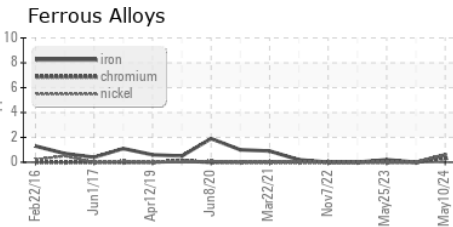

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06216895
Lab Number : 06216895
Unique Number : 11089759
Test Package : IND 2
Received : 21 Jun 2024
Tested : 24 Jun 2024
Diagnosed : 24 Jun 2024 - Don Baldrige

LATHEM FARMS INC
 1236 WAYNE POULTRY RD
 PENDERGRASS, GA
 US 30549
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)