

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id

KAESER BSD 50 8575822 (S/N 1410)

Component Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06216897	KC06047800	KC05760709
Sample Date		Client Info		10 Jun 2024	08 Dec 2023	25 Jan 2023
Machine Age	hrs	Client Info		15373	11217	2972
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	4
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m		15	4	8
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	<1
Cadmium	ppm	ASTM D5185m		<1	0	0
	ррпп		line it /le e e e		-	-
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	2	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	<1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	90	3	0	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		3	57	1
Zinc	ppm	ASTM D5185m		1	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		0	3	1
Potassium	ppm	ASTM D5185m	>20	1	1	0
Water	%	ASTM D6304	>0.05	0.008	0.007	0.007
ppm Water	ppm	ASTM D6304	>500	89	71	76.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3409	2030	2171
Particles >6µm		ASTM D7647	>1300	1296	416	879
Particles >14µm		ASTM D7647	>80	<mark> </mark> 121	66	137
Particles >21µm		ASTM D7647	>20	<mark> </mark> 32	30	44
Particles >38µm		ASTM D7647	>4	1	1	7
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	— 19/17/14	18/16/13	18/17/14
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.38	0.38	0.39
			2	0.00	0.00	0.00



Water

(B/HOX

0.00

1000

600 Water (

4000

200

52

5

42

38

B


Abno 4(


Water (KF)

Abnormal

Viscosity @ 40°C

OIL ANALYSIS REPORT

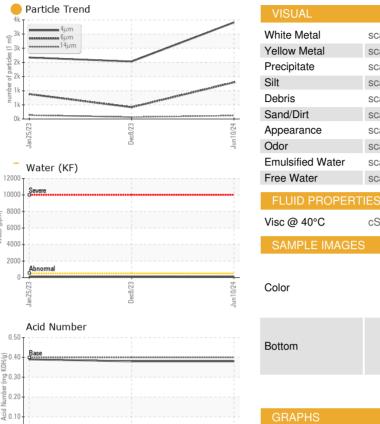

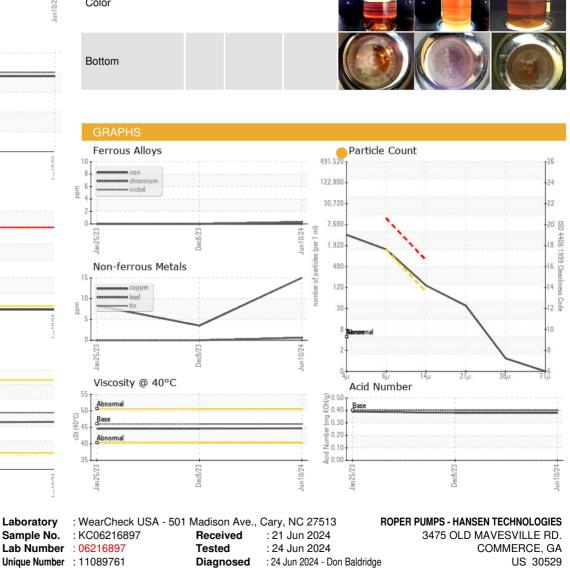

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

44.7

*Visual

*Visual

*Visua

*Visual

*Visual

*Visual

*Visual

*Visual

*Visual

*Visual

ASTM D445

scalar

cSt

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

>0.05

46

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

44.6

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

44.6



To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate 12367

Laboratory

Sample No.

Lab Number

Test Package : IND 2

Contact/Location: SERVICE MANAGER - ROPCOM

Contact: SERVICE MANAGER

T:

F: