


OIL ANALYSIS REPORT

Sample Rating Trend

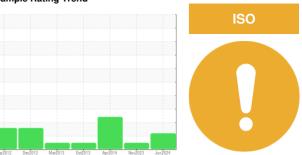

Machine Id

KAESER BSD 50 2701723 (S/N 1407)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep2012	Dec2012 Mar2013	Oct2013 Apr2014 Nov2023	Jun 2 024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06216898	KC06032351	KC37076
Sample Date		Client Info		07 Jun 2024	29 Nov 2023	15 Apr 2014
Machine Age	hrs	Client Info		98414	94608	37686
Oil Age	hrs	Client Info		0	0	2078
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				ATTENTION	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	2
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	5	4	14
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	1	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	<1	<1	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		28	165	236
Zinc	ppm	ASTM D5185m		1	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		0	<1	<1
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>0.05	0.009	0.018	0.004
ppm Water	ppm	ASTM D6304	>500	93	182	40
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1445	1582	5000
Particles >6µm		ASTM D7647	>1300	653	287	<u>▲</u> 2723
Particles >14μm		ASTM D7647	>80	<u> </u>	22	464
Particles >21µm		ASTM D7647	>20	5 6	8	<u>▲</u> 156
Particles >38μm		ASTM D7647	>4	4	1	<u> </u>
Particles >71μm		ASTM D7647	>3	0	0	<u>^</u> 2
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/14	18/15/12	▲ 19/16
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.43	0.23	0.300



OIL ANALYSIS REPORT

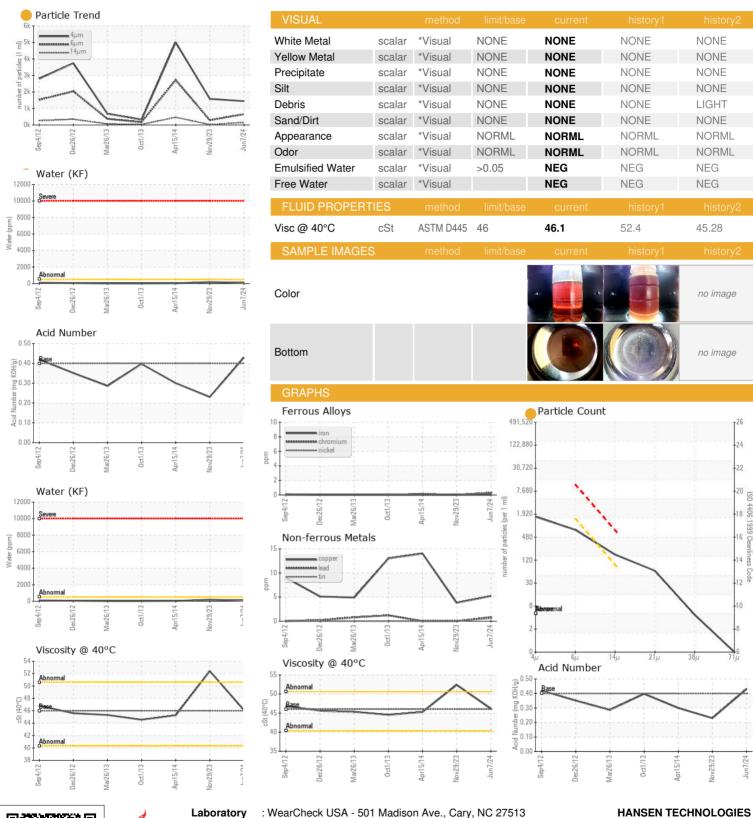



Certificate 12367

Laboratory Sample No.

Test Package : IND 2

: KC06216898 Received Lab Number : 06216898 **Tested** Unique Number : 11089762

: 24 Jun 2024 Diagnosed : 24 Jun 2024 - Don Baldridge

: 21 Jun 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

PO BOX 269

US 30529

Contact:

T:

F:

COMMERCE, GA