


## **OIL ANALYSIS REPORT**

Sample Rating Trend

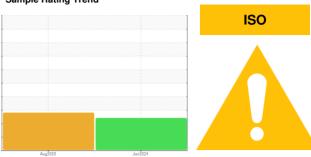

Machine Id

# 6587851 (S/N 1793)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2020	Jun2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06216899	KC05062951	
Sample Date		Client Info		12 Jun 2024	12 Aug 2020	
Machine Age	hrs	Client Info		8146	99	
Oil Age	hrs	Client Info		0	99	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	3	0	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>50	6	1	
Tin	ppm	ASTM D5185m	>10	<1	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	1	
Barium	ppm	ASTM D5185m	90	1	8	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	0	9	
Calcium	ppm	ASTM D5185m	2	0	<1	
Phosphorus	ppm	ASTM D5185m		2	4	
Zinc	ppm	ASTM D5185m		57	23	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	1	
Sodium	ppm	ASTM D5185m		0	4	
Potassium	ppm	ASTM D5185m	>20	1	1	
Water	%	ASTM D6304	>0.05	0.009	<b>△</b> 0.230	
ppm Water	ppm	ASTM D6304	>500	97	<u>^</u> 2300	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		28964		
Particles >6µm		ASTM D7647	>1300	<u>▲</u> 8163		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21μm		ASTM D7647	>20	<b>464</b>		
Particles >38μm		ASTM D7647	>4	<u>40</u>		
Particles >71µm		ASTM D7647	>3	<b>△</b> 3		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/20/17</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.160	



### **OIL ANALYSIS REPORT**

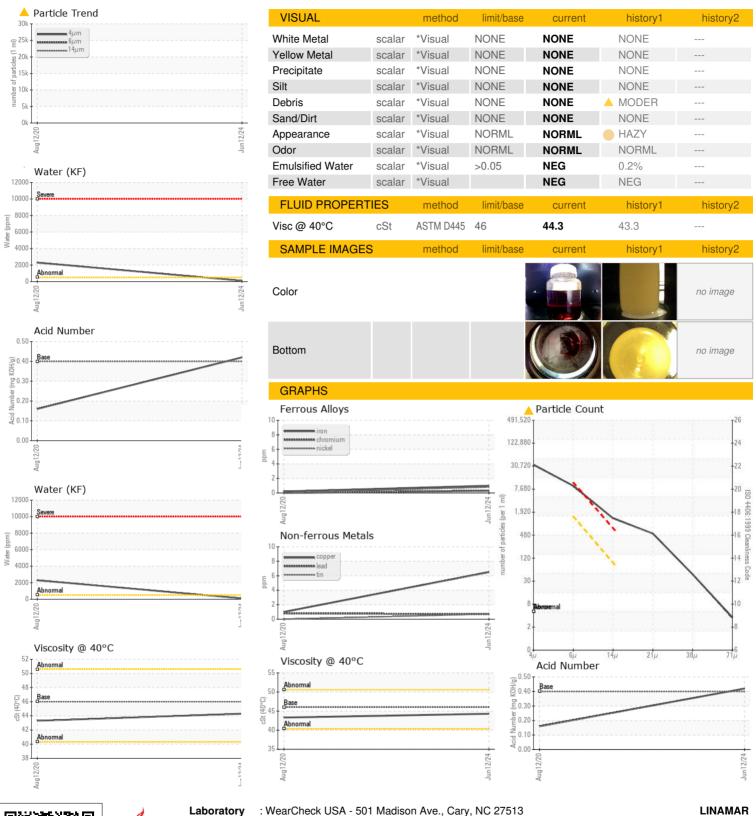



Certificate 12367

Laboratory Sample No. Lab Number

: KC06216899 : 06216899 Unique Number : 11089763 Test Package : IND 2

Received : 21 Jun 2024 **Tested** : 24 Jun 2024

Diagnosed : 24 Jun 2024 - Don Baldridge 2169 HENDERSONVILLE RD ARDEN, NC US 28704

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: