




PROBLEM SUMMARY

Machine Id
KAESER SK 15 8199299 (S/N 1806)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- LTR)



Sample Rating Trend

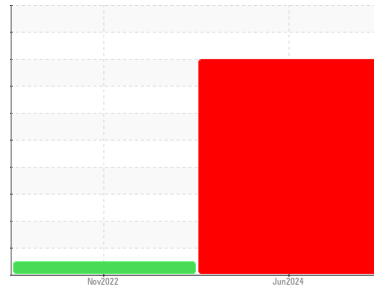

WATER



COMPONENT CONDITION SUMMARY

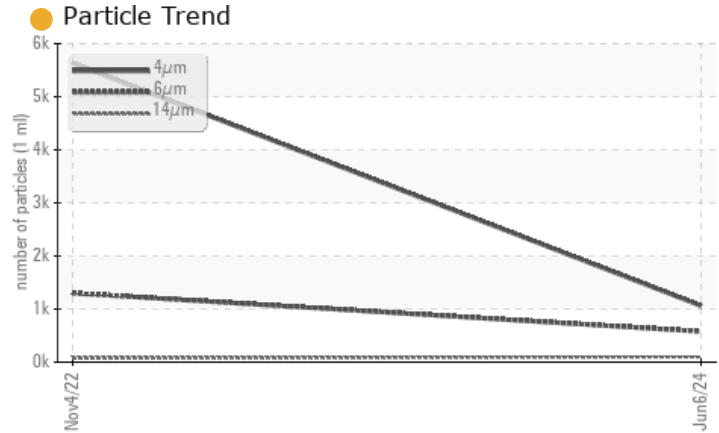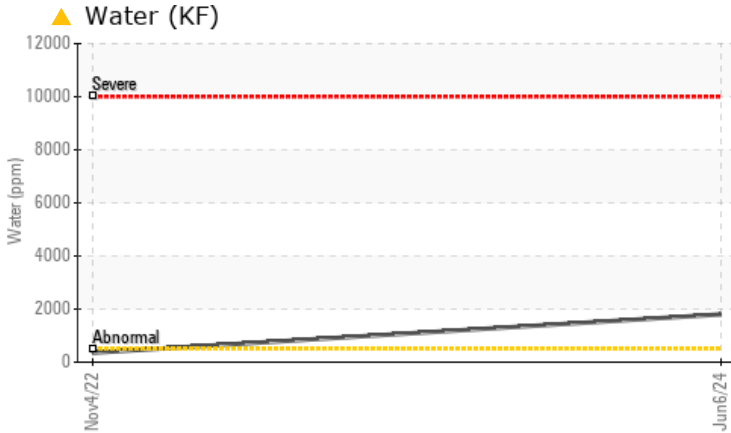


RECOMMENDATION

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	NORMAL	---
Water	%	ASTM D6304	>0.05	▲ 0.180	0.035	---
ppm Water	ppm	ASTM D6304	>500	▲ 1800	355.8	---
Free Water	scalar	*Visual		▲ 5.0	NEG	---

Customer Id: COLCORKC
Sample No.: KCPA017268
Lab Number: 06216903
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

NORMAL



04 Nov 2022 Diag: Don Baldrige

Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

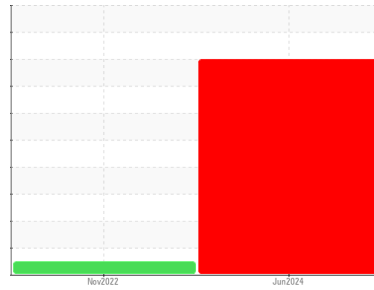

WATER



Machine Id
KAESER SK 15 8199299 (S/N 1806)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- LTR)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil. Excessive free water present. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA017268	KCP40304	---
Sample Date	Client Info			06 Jun 2024	04 Nov 2022	---
Machine Age	hrs	Client Info		3398	1468	---
Oil Age	hrs	Client Info		1093	1468	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				SEVERE	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	2	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	<1	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	<1	<1	---
Aluminum	ppm	ASTM D5185m	>10	3	0	---
Lead	ppm	ASTM D5185m	>10	1	0	---
Copper	ppm	ASTM D5185m	>50	14	6	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	1	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m	90	20	52	---
Calcium	ppm	ASTM D5185m	2	0	<1	---
Phosphorus	ppm	ASTM D5185m		4	4	---
Zinc	ppm	ASTM D5185m		25	12	---
Sulfur	ppm	ASTM D5185m		20059	21252	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	<1	---
Sodium	ppm	ASTM D5185m		0	13	---
Potassium	ppm	ASTM D5185m	>20	3	7	---
Water	%	ASTM D6304	>0.05	▲ 0.180	0.035	---
ppm Water	ppm	ASTM D6304	>500	▲ 1800	355.8	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1061	5632	---
Particles >6µm		ASTM D7647	>1300	578	1299	---
Particles >14µm		ASTM D7647	>80	● 98	74	---
Particles >21µm		ASTM D7647	>20	● 33	19	---
Particles >38µm		ASTM D7647	>4	● 5	2	---
Particles >71µm		ASTM D7647	>3	1	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	● 17/16/14	20/17/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.45	0.35	---


OIL ANALYSIS REPORT

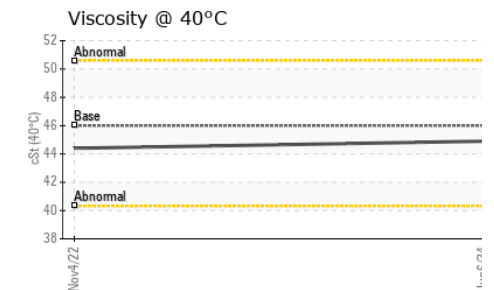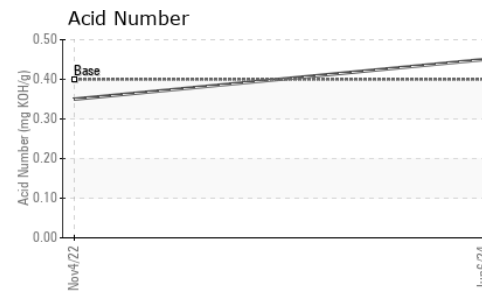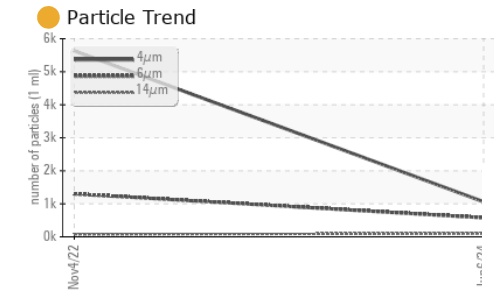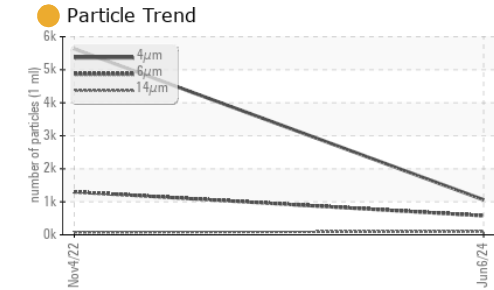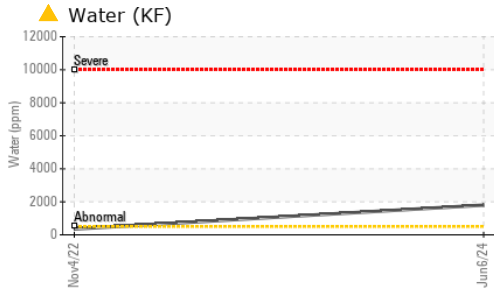





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		▲ 5.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.9	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

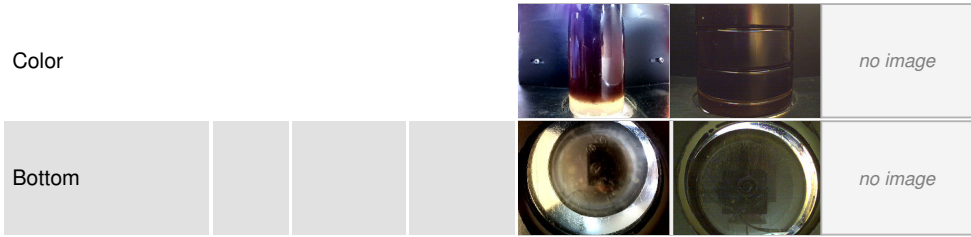

GRAPHS

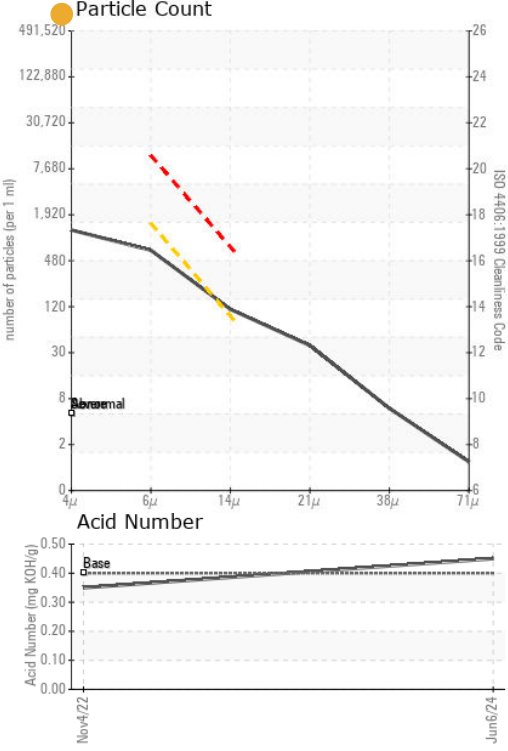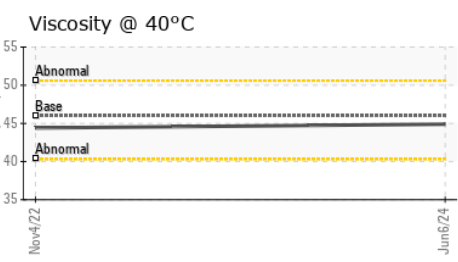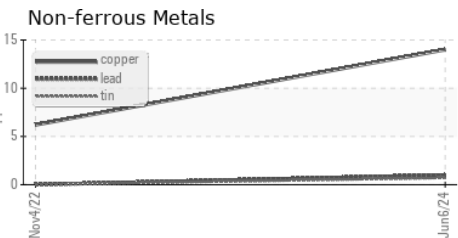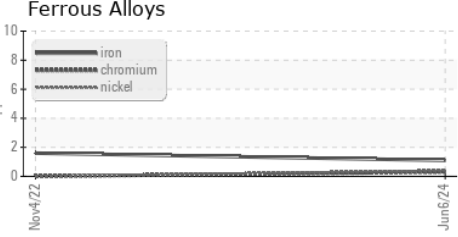

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA017268
Lab Number : 06216903
Unique Number : 11089767
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 21 Jun 2024
Tested : 26 Jun 2024
Diagnosed : 26 Jun 2024 - Jonathan Hester

COLLIN STREET BAKERY
 401 W 7TH AVE
 CORSICANA, TX
 US 75110
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)