




OIL ANALYSIS REPORT

Sample Rating Trend

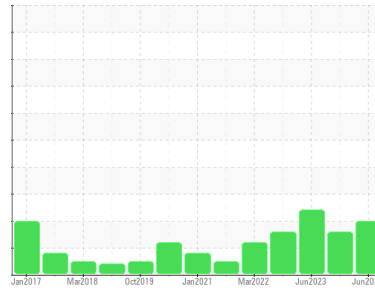

ISO



Machine Id

KAESER SM 8 2148829 (S/N 1075)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA018621	KCPA011838	KCPA001960
Sample Date	Client Info	06 Jun 2024	07 Dec 2023	08 Jun 2023
Machine Age	hrs	Client Info	82152	78476
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	Changed	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	1	0	0
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	3	0	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	2	1	1
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	<1	<1
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	44	0	28
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 100	62	0	62
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 0	2	0	0
Zinc	ppm	ASTM D5185m 0	8	0	0
Sulfur	ppm	ASTM D5185m 23500	20355	18061	21707

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	2	<1	<1
Sodium	ppm	ASTM D5185m	11	19	10
Potassium	ppm	ASTM D5185m >20	4	2	<1
Water	%	ASTM D6304 >0.05	0.029	0.015	0.029
ppm Water	ppm	ASTM D6304 >500	294	154	297.0






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	152951	6521	5743
Particles >6µm	ASTM D7647 >1300	100364	2195	1796
Particles >14µm	ASTM D7647 >80	16086	179	85
Particles >21µm	ASTM D7647 >20	3183	44	19
Particles >38µm	ASTM D7647 >4	34	2	5
Particles >71µm	ASTM D7647 >3	1	0	3
Oil Cleanliness	ISO 4406 (c) >--/17/13	24/24/21	20/18/15	20/18/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.37	0.34	0.42


OIL ANALYSIS REPORT

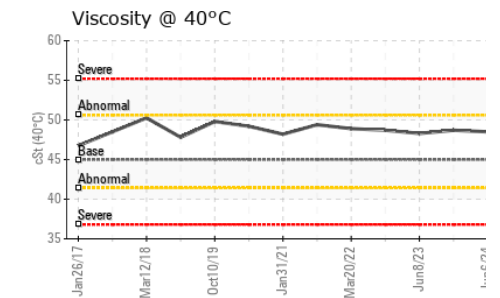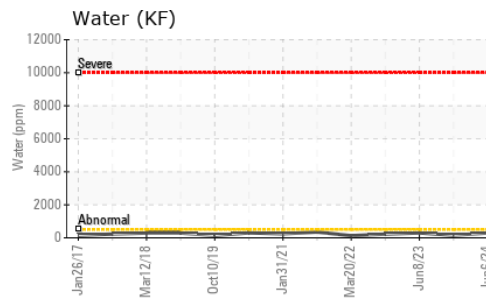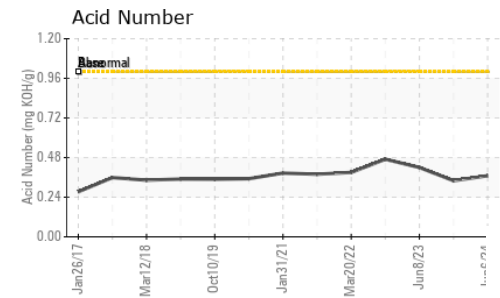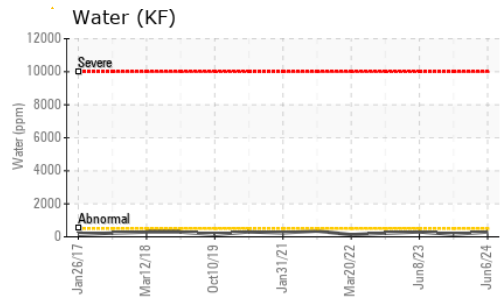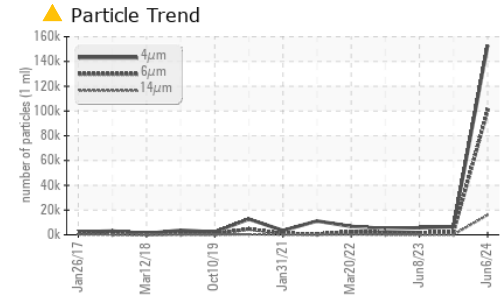





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	48.5	48.7	48.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

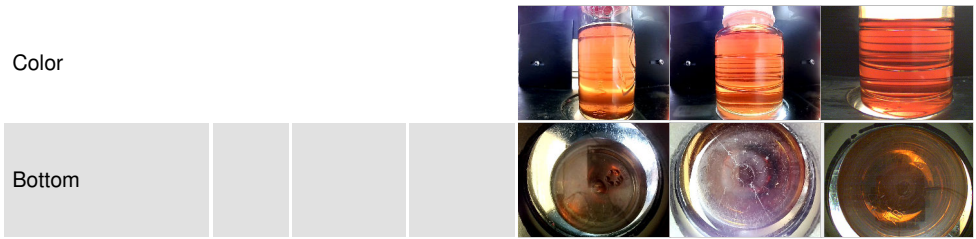

GRAPHS

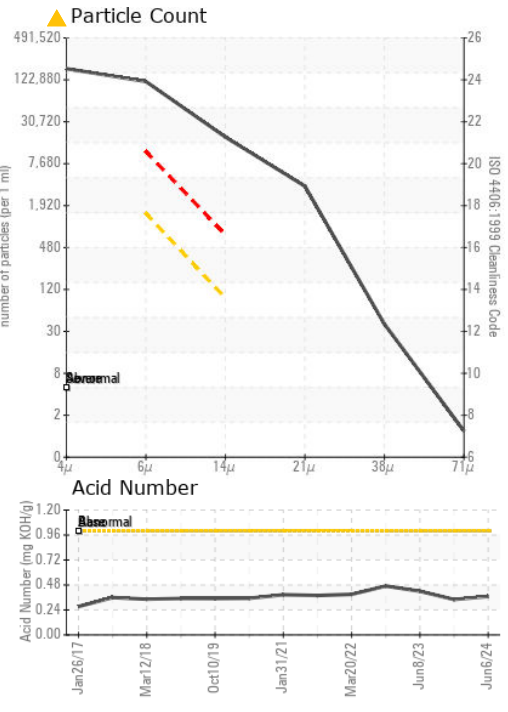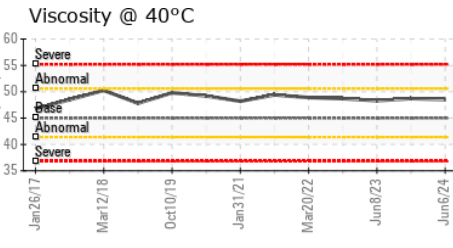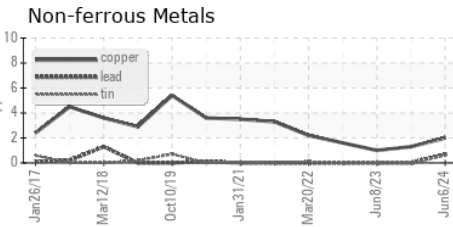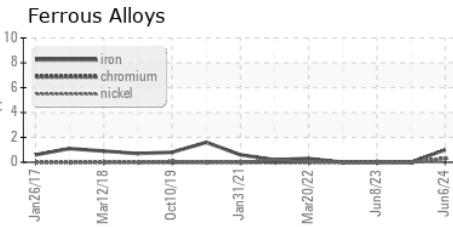

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA018621 **Received** : 21 Jun 2024
Lab Number : 06216924 **Tested** : 24 Jun 2024
Unique Number : 11089788 **Diagnosed** : 24 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

DCS - DATA CENTER SYSTEMS
 1881 VALLEY VIEW LN
 FARMERS BRANCH, TX
 US 75234
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)