

OIL ANALYSIS REPORT

KAESER BSD50T 6046077 (S/N 1380)

Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Machine Id

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

Juči i Juži j Juži 20 Mežel i krada Juži j Juži 21 Mežel Juži 22 Mežel Juži 23 Mežel Juži 23 Mežel Juži 24 Mežel 24 Mežel Juži 24 Mežel Juži 24 Mežel Juži 24 Mežel Juži 2						
SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017354	KCPA007967	KCP53262
Sample Date		Client Info		05 Jun 2024	16 Nov 2023	03 Apr 2023
Machine Age	hrs	Client Info		32044	28144	24009
Oil Age	hrs	Client Info		3000	0	429
Oil Changed		Client Info		Changed	N/A	Not Changd
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	5	11	<1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	41	1	54
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	100	59	37	92
Calcium	ppm	ASTM D5185m	0	0	0	2
Phosphorus	ppm	ASTM D5185m	0	2	2	3
Zinc	ppm	ASTM D5185m	0	9	0	4
Sulfur	ppm	ASTM D5185m	23500	21946	18896	24715
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	<1	<1
Sodium	ppm	ASTM D5185m		18	9	13
Potassium	ppm	ASTM D5185m	>20	6	2	4
Water	%	ASTM D6304	>0.05	0.031	0.017	0.034
ppm Water	ppm	ASTM D6304	>500	313	173	343.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3480	2755	33366
Particles >6µm		ASTM D7647	>1300	<u> </u>	558	4 9457
Particles >14µm		ASTM D7647	>80	<u> </u>	35	438
Particles >21µm		ASTM D7647	>20	<u> </u>	9	5 7
Particles >38µm		ASTM D7647	>4	1	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	1 9/18/15	19/16/12	▲ 22/20/16
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39	0.38	0.41


Report Id: AMAGRA [WUSCAR] 06216926 (Generated: 06/24/2024 17:47:23) Rev: 1


Contact/Location: Service Manager - AMAGRA Page 1 of 2

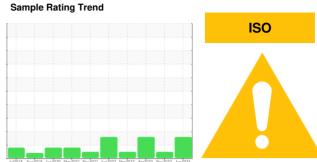






OIL ANALYSIS REPORT














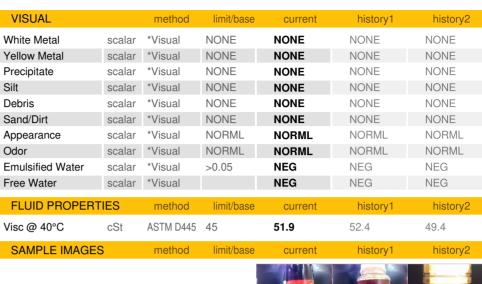

Color



Bottom

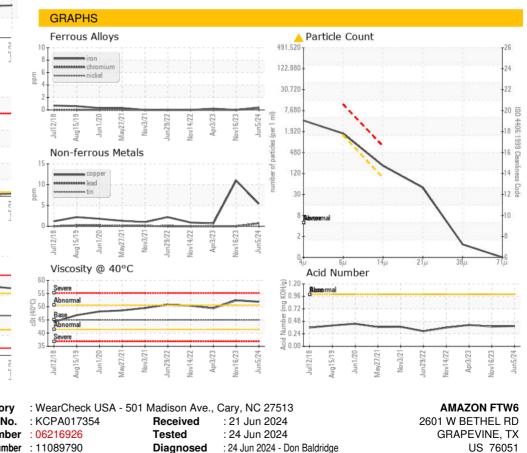



Laboratory Sample No. Lab Number Certificate 12367

Unique Number : 11089790 Diagnosed

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AMAGRA [WUSCAR] 06216926 (Generated: 06/24/2024 17:47:23) Rev: 1

Contact/Location: Service Manager - AMAGRA Page 2 of 2

Contact: Service Manager

T:

F: