

# **PROBLEM SUMMARY**

Sample Rating Trend

**DEGRADATION** 


Machine Id

# KAESER ESD 300 1572636 (S/N 1002)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### COMPONENT CONDITION SUMMARY

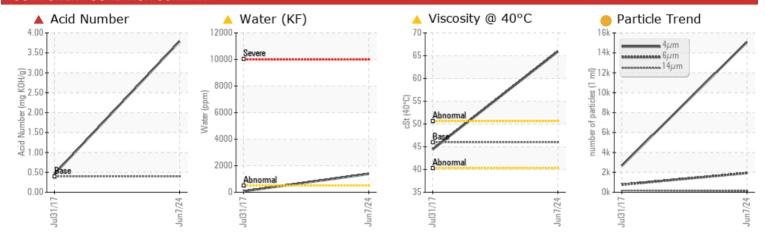

### **RECOMMENDATION**

Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS										
Sample Status				SEVERE	ABNORMAL					
Water	%	ASTM D6304	>0.05	<b>△</b> 0.137	0.008					
ppm Water	ppm	ASTM D6304	>500	<b>1380</b>	80					
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>3.79</b>	0.459					
Visc @ 40°C	cSt	ASTM D445	46	<b>65.9</b>	44.43					

Customer Id: HONRICKC Sample No.: KCPA018835 Lab Number: 06216938 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS					
Action	Status	Date	Done By	Description	
Change Fluid			?	Oil and filter change at the time of sampling has been noted.	
Change Filter			?	Oil and filter change at the time of sampling has been noted.	
Resample			?	We recommend an early resample to monitor this condition.	

### HISTORICAL DIAGNOSIS


**31 Jul 2017 Diag: Don Baldridge**We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER ESD 300 1572636 (S/N 1002)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil. There is a light concentration of water present in the oil.

### ▲ Fluid Condition

The AN level is above the recommended limit. The oil viscosity is higher than normal. The oil is no longer serviceable.

		L	Jul2017	Jun2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018835	KCP04778	
Sample Date		Client Info		07 Jun 2024	31 Jul 2017	
Machine Age	hrs	Client Info		0	17060	
Oil Age	hrs	Client Info		0	3000	
Oil Changed		Client Info		Changed	Not Changd	
Sample Status				SEVERE	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	8	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	5	0	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m		4	9	
Coppei Tin	ppm	ASTM D5185m	>10	<b>~</b> <1	0	
		ASTM D5185m	>10	< I	0	
Antimony Vanadium	ppm	ASTM D5185m				
	ppm			<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1	0	
Barium	ppm	ASTM D5185m	90	2	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	4	0	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		6	0	
Zinc	ppm	ASTM D5185m		88	<1	
Sulfur	ppm	ASTM D5185m		824	10287	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	<1	
Sodium	ppm	ASTM D5185m		13	<1	
Potassium	ppm	ASTM D5185m	>20	8	<1	
Water	0/	ACTM DCCC4	0.05		0.000	
	%	ASTM D6304	>0.05	<u> </u>	0.008	
	ppm	ASTM D6304 ASTM D6304	>500	△ 0.137 △ 1380	0.008	
	ppm					
opm Water FLUID CLEANLIN	ppm	ASTM D6304	>500	<u> </u>	80	
ppm Water FLUID CLEANLIN Particles >4μm	ppm	ASTM D6304 method	>500 limit/base	△ 1380 current	80 history1	history2
ppm Water FLUID CLEANLIN Particles >4μm Particles >6μm	ppm	ASTM D6304  method  ASTM D7647	>500 limit/base	△ 1380  current  15085	80 history1 2667	history2
opm Water  FLUID CLEANLIN  Particles >4  Particles >6  Particles >14  Particles >14  Particles >14	ppm	Method ASTM D7647 ASTM D7647	>500 limit/base >1300 >80	△ 1380  current  15085  1927	80 history1 2667 764	history2
ppm Water  FLUID CLEANLIN  Particles >4μm  Particles >6μm  Particles >14μm  Particles >21μm	ppm	method ASTM D7647 ASTM D7647 ASTM D7647	>500 limit/base >1300 >80	△ 1380  current  15085  ● 1927  ● 121	80 history1 2667 764 ▲ 187	history2
PDM Water  FLUID CLEANLIN  Particles >4μm  Particles >6μm  Particles >14μm  Particles >21μm  Particles >38μm	ppm	Method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>500 limit/base >1300 >80 >20 >4	△ 1380  current  15085  ● 1927  ● 121  ● 32  1	80  history1  2667  764  ▲ 187  ▲ 88  ▲ 18	history2
ppm Water	ppm	method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>500 limit/base >1300 >80 >20 >4	1380 current 15085 1927 121 32	80 history1 2667 764 △ 187 △ 88	history2

Acid Number (AN)

mg KOH/g ASTM D8045 0.4

**3.79** 

0.459



## **OIL ANALYSIS REPORT**







Certificate 12367

Sample No.

Lab Number

: KCPA018835 : 06216938 Unique Number : 11089802

Received : 21 Jun 2024 **Tested** : 24 Jun 2024 Diagnosed

: 24 Jun 2024 - Don Baldridge

830 E ARAPHO RD RICHARDSON, TX US 75081 Contact: SERVICE MANAGER

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: