

OIL ANALYSIS REPORT

Area S-46 [292259] KAESER 7288676 - K.R. KOMAREK (S/N 1482) Component Compressor

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001899		
Sample Date		Client Info		12 Jun 2024		
Machine Age	hrs	Client Info		12535		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	٧	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	21		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		10		
Zinc	ppm	ASTM D5185m		<1		
Sulfur	ppm	ASTM D5185m		17638		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.26		



OIL ANALYSIS REPORT

VISUAL

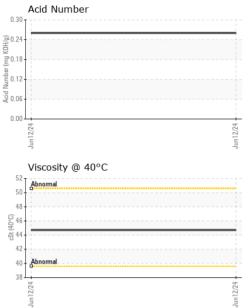

	VISUAL		method	limit/base	current	history1	history2
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
54	Sand/Dirt	scalar	*Visual	NONE	NONE		
Jun12/24	Appearance	scalar	*Visual	NORML	NORML		
7	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.05	NEG		
	Free Water	scalar	*Visual		NEG		
	FLUID PROPERT	IES	method	limit/base	current	history1	history2
				mmbase			motory
	Visc @ 40°C	cSt	ASTM D445		44.7		
	SAMPLE IMAGES	;	method				history2
Jun12/24	Color					• no image	no image
	Bottom					no image	no image
	Non-ferrous Metals	5		Acid Number (mg KOH(g) 10 12/24 10 12/24 10 12/24 10 12/24 10 12/24 10 12/24	Acid Numbe	er	
Laboratory Sample No. Lab Number Unique Number Test Package liscuss this sample report, Denotes test methods that	: 11089829 : IND 2 <i>contact Customer Servi</i>	ived : 21 ed : 24 nosed : 24 800-237-1368 ope of accred	Jun 2024 Jun 2024 Jun 2024 - V 9. itation.	e	FLUID-AIRE DYNAMIC 225 SPRING LAKE D ITASCA, I US 6014 Contact: ED DIENE ed.diener@fluidairedynamics.com T: (847)678-838 // 106:2012) F		

Contact/Location: ED DIENER - UCFLUSCH