


OIL ANALYSIS REPORT

PG-46 [283583] **PNEUTECH AK100021206 - TRS**

Component Compressor

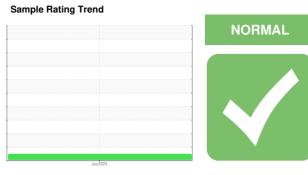

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is ISO 46 Screw Compressor Oil. Please confirm the oil type and grade, and specify the brand of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001147		
Sample Date		Client Info		04 Jun 2024		
Machine Age	hrs	Client Info		2345		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		579		
Zinc	ppm	ASTM D5185m		16		
Sulfur	ppm	ASTM D5185m		53		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	7		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		80.0		




OIL ANALYSIS REPORT

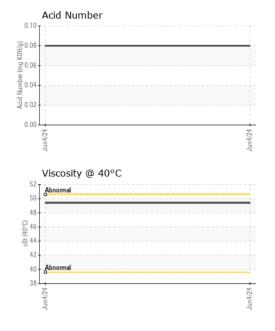





GRAPHS



10 _T	Non-ferrous Metals
8 -	copper
6-	panananana tin
4-	1
2 -	
0	4
	Jun4/24









Certificate 12367

Laboratory Sample No.

Lab Number : 06216979 Unique Number : 11089843

Test Package : IND 2

: UFD0001147

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 21 Jun 2024 **Tested** : 24 Jun 2024

Diagnosed : 24 Jun 2024 - Wes Davis

Contact: ED DIENER ed.diener@fluidairedynamics.com T: (847)678-8388

FLUID-AIRE DYNAMICS

225 SPRING LAKE DR

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCFLUSCH [WUSCAR] 06216979 (Generated: 06/24/2024 13:44:00) Rev: 1

Contact/Location: ED DIENER - UCFLUSCH

ITASCA, IL

US 60143