


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id

KAESER 6833667

Component Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug	2020	May2022 Jun202	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013904	KCP45683	KCP16760
Sample Date		Client Info		17 Jun 2024	03 May 2022	13 Aug 2020
Machine Age	hrs	Client Info		5247	2948	347
Oil Age	hrs	Client Info		2299	3000	347
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	<1	0
Aluminum	ppm	ASTM D5185m	>10	3	<1	<1
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	2	2	<1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	12
Barium	ppm	ASTM D5185m	90	11	13	45
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	22	47	77
Calcium	ppm	ASTM D5185m	0	0	1	3
Phosphorus	ppm	ASTM D5185m	0	5	5	5
Zinc	ppm	ASTM D5185m	0	6	6	8
Sulfur	ppm	ASTM D5185m	23500	20363	16304	15902
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	3	1
Sodium	ppm	ASTM D5185m		4	11	4
Potassium	ppm	ASTM D5185m	>20	5	12	6
Water	%	ASTM D6304	>0.05	0.004	0.006	0.029
ppm Water	ppm	ASTM D6304	>500	47	68.6	291.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1339	7184	11017
Particles >6µm		ASTM D7647	>1300	339	1852	<u>▲</u> 3658
Particles >14µm		ASTM D7647	>80	23	72	150
Particles >21µm		ASTM D7647	>20	5	18	34
Particles >38µm		ASTM D7647	>4	0	1	2
Particles >71μm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	18/13	<u>19/14</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

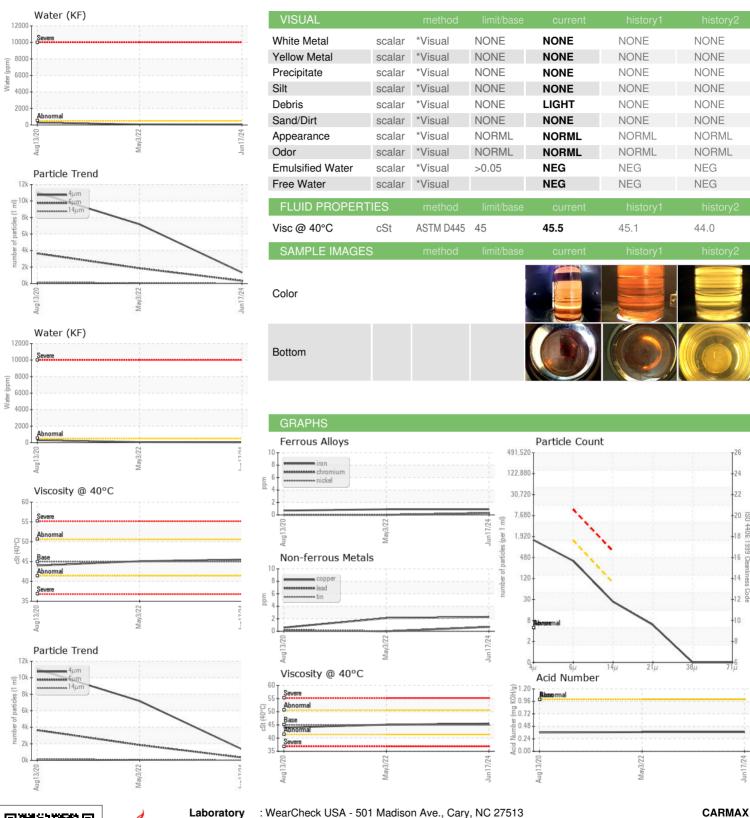



Certificate 12367

Laboratory Sample No.

: KCPA013904 Lab Number : 06217285

Received **Tested** Unique Number : 11090149 Diagnosed

: 25 Jun 2024 - Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 21 Jun 2024

: 25 Jun 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - CARPLECA

US 94523

T:

F:

77 CHILPANCINGO PKWY

Contact: Service Manager

PLEASANT HILL, CA