




# OIL ANALYSIS REPORT

Sample Rating Trend

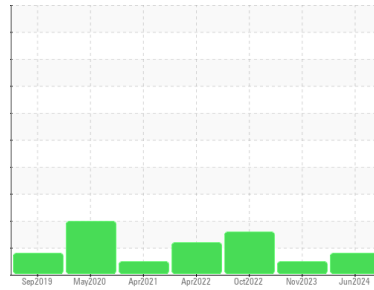

ISO



Machine Id

**KAESER SX 5 5380364 (S/N 1401)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>KCPA019168</b>	KCPA010027	KCP47362D	
Sample Date	Client Info	<b>18 Jun 2024</b>	20 Nov 2023	19 Oct 2022	
Machine Age	hrs	Client Info	<b>43713</b>	40641	32373
Oil Age	hrs	Client Info	<b>2000</b>	0	3000
Oil Changed	Client Info	<b>Changed</b>	N/A	Changed	
Sample Status		<b>ATTENTION</b>	NORMAL	ABNORMAL	

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	0	0
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	<1	<1	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	<b>3</b>	0	0
Lead	ppm	ASTM D5185m >10	<1	0	<1
Copper	ppm	ASTM D5185m >50	<b>8</b>	24	9
Tin	ppm	ASTM D5185m >10	<1	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	<1
Cadmium	ppm	ASTM D5185m	<1	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>18</b>	15	0
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 100	<b>38</b>	14	31
Calcium	ppm	ASTM D5185m 0	<b>0</b>	2	0
Phosphorus	ppm	ASTM D5185m 0	<b>2</b>	<1	19
Zinc	ppm	ASTM D5185m 0	<b>22</b>	21	12
Sulfur	ppm	ASTM D5185m 23500	<b>20099</b>	18395	24761

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>1</b>	<1	2
Sodium	ppm	ASTM D5185m	<b>15</b>	15	10
Potassium	ppm	ASTM D5185m >20	<b>4</b>	2	1
Water	%	ASTM D6304 >0.05	<b>0.020</b>	0.007	0.015
ppm Water	ppm	ASTM D6304 >500	<b>202</b>	78	156.8






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>3376</b>	5869	18752
Particles >6µm	ASTM D7647 >1300	<b>1110</b>	1211	▲ 3918
Particles >14µm	ASTM D7647 >80	● <b>94</b>	67	▲ 183
Particles >21µm	ASTM D7647 >20	<b>20</b>	15	● 40
Particles >38µm	ASTM D7647 >4	<b>0</b>	1	2
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	● <b>19/17/14</b>	20/17/13	▲ 21/19/15

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.29</b>	0.25	0.31

# OIL ANALYSIS REPORT

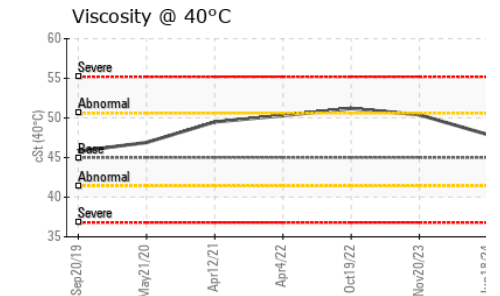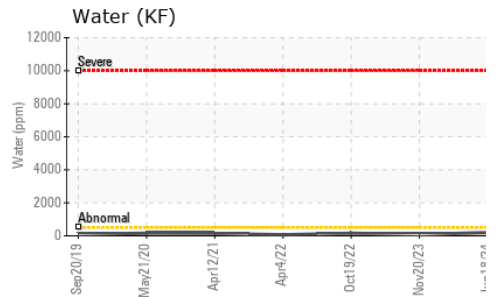
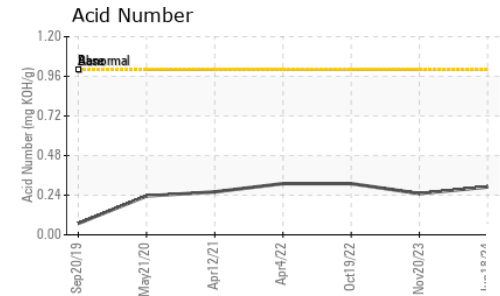
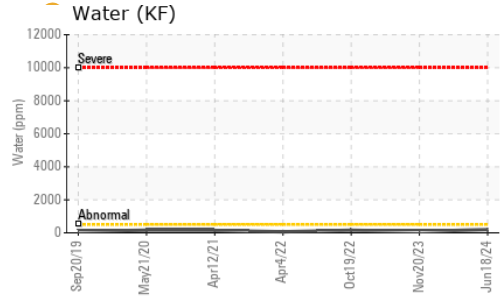
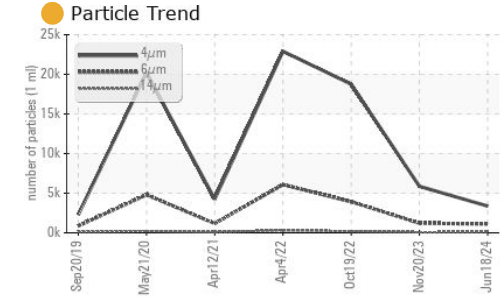


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	47.9	50.4	51.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

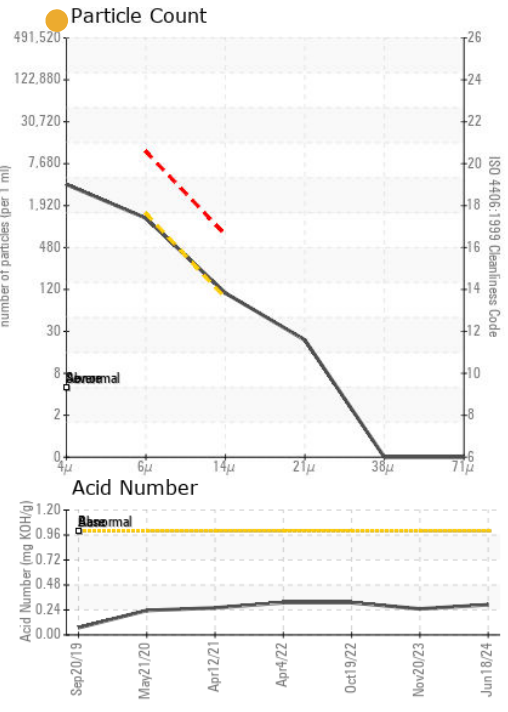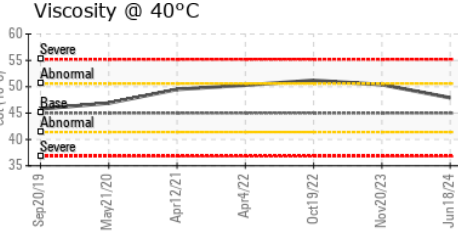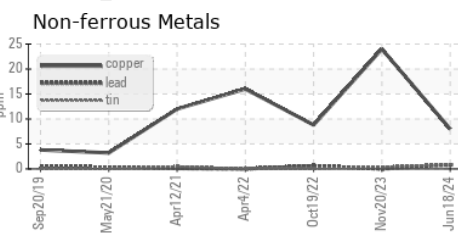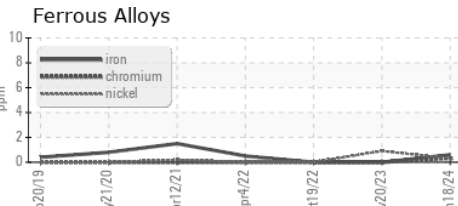

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA019168  
**Lab Number** : 06217293  
**Unique Number** : 11090157  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 21 Jun 2024  
**Tested** : 25 Jun 2024  
**Diagnosed** : 25 Jun 2024 - Don Baldrige

**AMAZON.COM**  
 3501 120TH AVE  
 KENOSHA, WI  
 US 53144  
 Contact: BRIAN ZOOK  
 zookbrian@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)