


OIL ANALYSIS REPORT

Machine Id

KAESER ASD 25 8428890 (S/N 1194)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

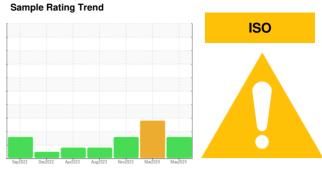

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			JOSEPH TOTAL			
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130345	KC121608	KC124668
Sample Date		Client Info		29 May 2024	11 Mar 2024	07 Nov 2023
Machine Age	hrs	Client Info		11136	9870	8491
Oil Age	hrs	Client Info		3765	0	0
Oil Changed		Client Info		Not Changd	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	1	<1
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	<u> 11</u>	10
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	12	9	9
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	1	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	90	2	2	6
Calcium	ppm	ASTM D5185m	2	0	1	<1
Phosphorus	ppm	ASTM D5185m		2	2	4
Zinc	ppm	ASTM D5185m		48	42	62
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	1
Sodium	ppm	ASTM D5185m		2	3	6
Potassium	ppm	ASTM D5185m	>20	3	2	8
Water	%	ASTM D6304	>0.05	0.006	△ 0.081	△ 0.106
ppm Water	ppm	ASTM D6304	>500	70	▲ 810	▲ 1060
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		11773		
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2712		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21μm		ASTM D7647	>20	<u>^</u> 27		
Particles >38μm		ASTM D7647	>4	2		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/14		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35	0.35	0.14



OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No.

Lab Number

: KC130345 : 06217301 Unique Number : 11090165 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 21 Jun 2024 **Tested** : 25 Jun 2024

Diagnosed : 25 Jun 2024 - Don Baldridge

JABIL 10500 MLK DR ST PETERSBURG, FL US 33716 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: