




OIL ANALYSIS REPORT

Sample Rating Trend

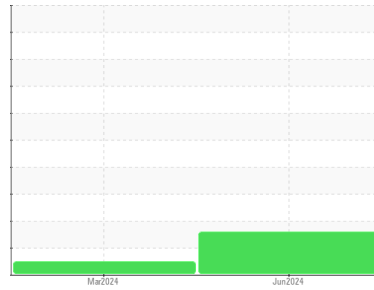

ISO



Machine Id
9322025 (S/N 2172)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

- Recommendation**
 No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**
 All component wear rates are normal.
- Contamination**
 There is a moderate amount of particulates present in the oil.
- Fluid Condition**
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC131221	KC125706	---
Sample Date	Client Info		12 Jun 2024	13 Mar 2024	---
Machine Age	hrs	Client Info	426	247	---
Oil Age	hrs	Client Info	426	0	---
Oil Changed	Client Info		Not Chngd	N/A	---
Sample Status			ATTENTION	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	---
Chromium	ppm	ASTM D5185m >10	<1	0	---
Nickel	ppm	ASTM D5185m >3	<1	<1	---
Titanium	ppm	ASTM D5185m >3	<1	0	---
Silver	ppm	ASTM D5185m >2	<1	0	---
Aluminum	ppm	ASTM D5185m >10	3	<1	---
Lead	ppm	ASTM D5185m >10	1	0	---
Copper	ppm	ASTM D5185m >50	3	<1	---
Tin	ppm	ASTM D5185m >10	<1	<1	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	<1	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m 90	10	34	---
Molybdenum	ppm	ASTM D5185m	<1	0	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m 90	64	81	---
Calcium	ppm	ASTM D5185m 2	0	7	---
Phosphorus	ppm	ASTM D5185m	<1	4	---
Zinc	ppm	ASTM D5185m	6	0	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	---
Sodium	ppm	ASTM D5185m	9	13	---
Potassium	ppm	ASTM D5185m >20	26	17	---
Water	%	ASTM D6304 >0.05	0.028	0.028	---
ppm Water	ppm	ASTM D6304 >500	284	280	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		4720	4175	---
Particles >6µm	ASTM D7647 >1300		1768	1120	---
Particles >14µm	ASTM D7647 >80		123	43	---
Particles >21µm	ASTM D7647 >20		24	5	---
Particles >38µm	ASTM D7647 >4		1	0	---
Particles >71µm	ASTM D7647 >3		0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		19/18/14	19/17/13	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.36	---


OIL ANALYSIS REPORT

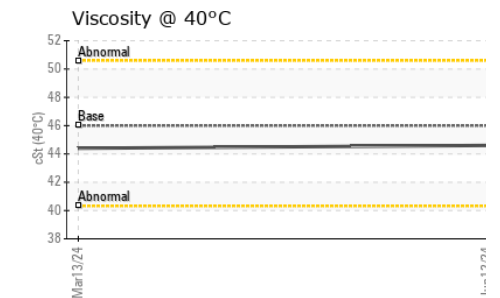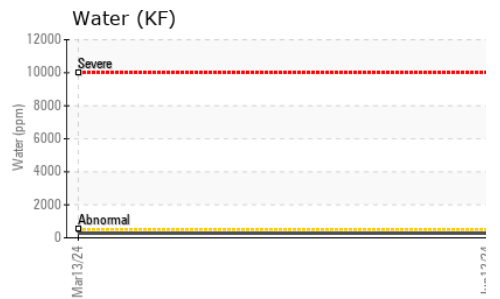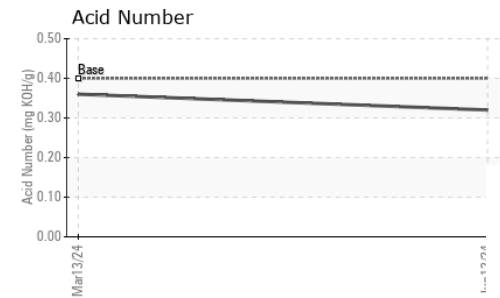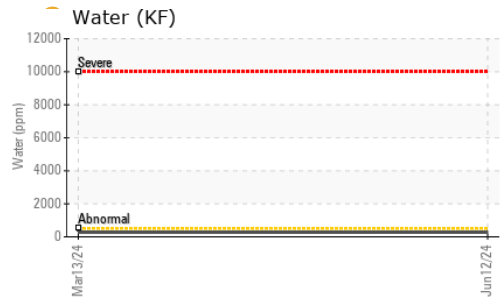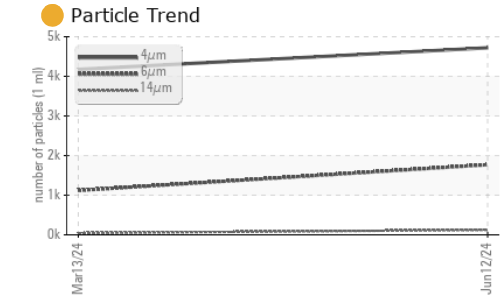





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.6	44.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

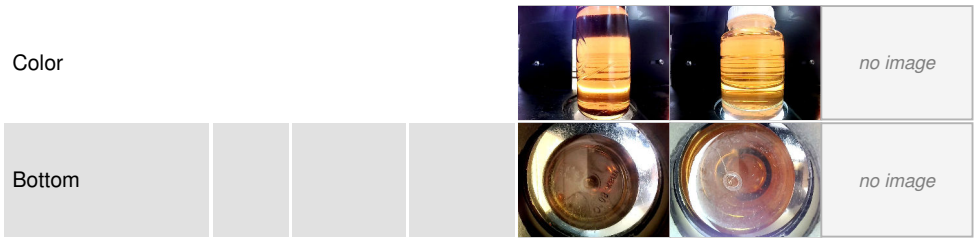

GRAPHS

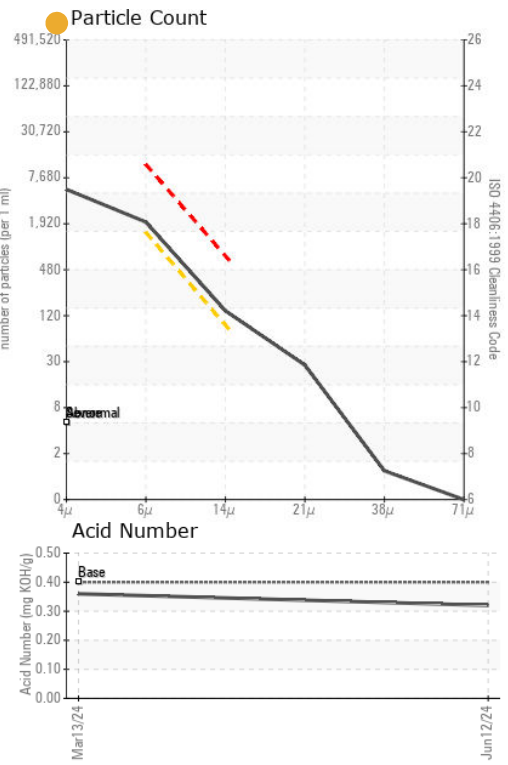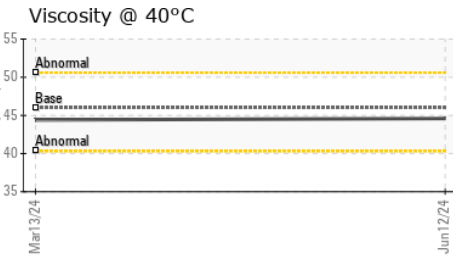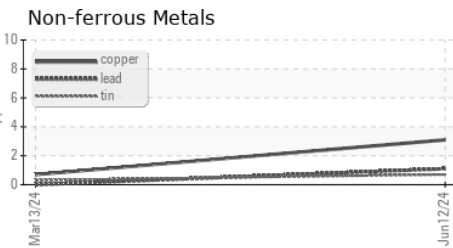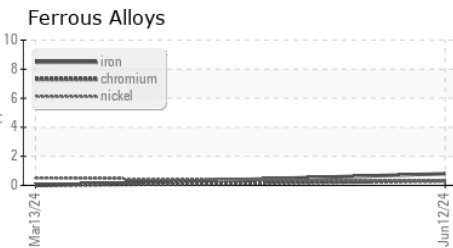

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC131221
Lab Number : 06217304
Unique Number : 11090168
Test Package : IND 2

Received : 21 Jun 2024
Tested : 25 Jun 2024
Diagnosed : 25 Jun 2024 - Don Baldrige

FRONT LINE COMMUNICATIONS
 12770 44TH ST N
 CLEARWATER, FL
 US 33762
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)