


# **OIL ANALYSIS REPORT**

Sample Rating Trend

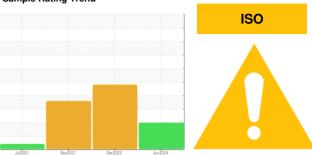

Machine Id

# KAESER 5881031 (S/N 3779)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jul202	Nov2021	Dec2022 Jul	2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA019183	KCP40349D	KCP38861
Sample Date		Client Info		13 Jun 2024	21 Dec 2022	11 Nov 2021
Machine Age	hrs	Client Info		41174	28417	19485
Oil Age	hrs	Client Info		4350	0	3000
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	15	24	29
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	1	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	8	<1	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	4	15	4
Zinc	ppm	ASTM D5185m	0	68	32	39
Sulfur	ppm	ASTM D5185m	23500	20491	18407	16062
CONTAMINANTS	,	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		3	<1	<1
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.05	0.007	<b>△</b> 0.494	<b>△</b> 0.285
ppm Water	ppm	ASTM D6304	>500	80	<b>4940</b>	<u>2850</u>
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		65342	1849	
Particles >6µm		ASTM D7647	>1300	<u>^</u> 22323	1007	
Particles >14μm		ASTM D7647	>80	<b>1714</b>	<u> </u>	
Particles >21µm		ASTM D7647	>20	<u>▲</u> 391	<u></u> 58	
Particles >38μm		ASTM D7647	>4	<u> </u>	<b>9</b>	
Particles >71µm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>23/22/18</u>	<b>▲</b> 18/17/15	
FLUID DEGRADA		method	limit/base		history1	



## **OIL ANALYSIS REPORT**

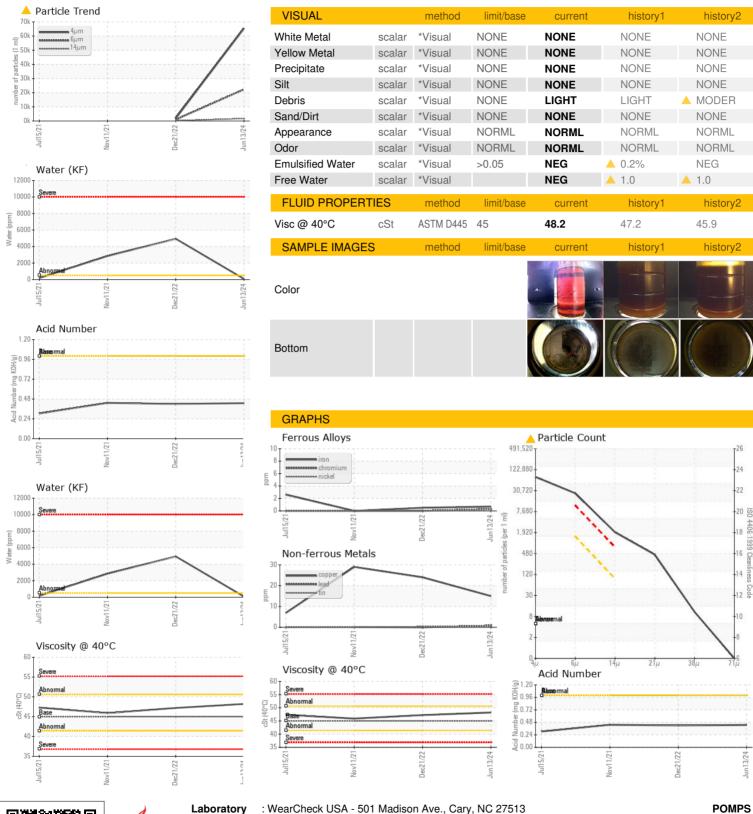



Certificate 12367

Laboratory Sample No. Lab Number

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA019183 Received **Tested** : 06217329

Unique Number : 11090193 Diagnosed : 25 Jun 2024 - Don Baldridge Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.  $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 21 Jun 2024

: 25 Jun 2024

927 GARDNER ST

Contact: Service Manager

JOLIET, IL

US 60433

T:

F: