KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

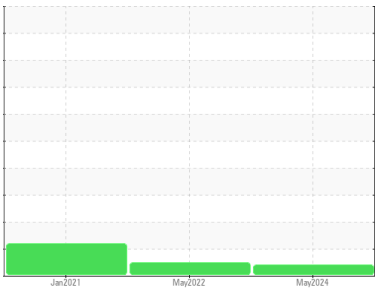

VISCOSITY

Machine Id
KAESER 7087279
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KCPA011330**	KCP51693	KCP30521
Sample Date		Client Info		**29 May 2024**	17 May 2022	18 Jan 2021
Machine Age	hrs	Client Info		**22046**	6989	1407
Oil Age	hrs	Client Info		**0**	6989	1407
Oil Changed		Client Info		**N/A**	Changed	Not Changd
Sample Status				**ABNORMAL**	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	<1	<1
Chromium	ppm	ASTM D5185m	>10	**<1**	0	0
Nickel	ppm	ASTM D5185m	>3	**<1**	0	0
Titanium	ppm	ASTM D5185m	>3	**<1**	0	0
Silver	ppm	ASTM D5185m	>2	**<1**	0	<1
Aluminum	ppm	ASTM D5185m	>10	**3**	0	<1
Lead	ppm	ASTM D5185m	>10	**<1**	0	<1
Copper	ppm	ASTM D5185m	>50	**4**	8	<1
Tin	ppm	ASTM D5185m	>10	**<1**	0	<1
Antimony	ppm	ASTM D5185m		**---**	---	0
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**<1**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	<1
Barium	ppm	ASTM D5185m	90	**1**	1	43
Molybdenum	ppm	ASTM D5185m		**<1**	0	0
Manganese	ppm	ASTM D5185m		**<1**	<1	<1
Magnesium	ppm	ASTM D5185m	90	**<1**	17	83
Calcium	ppm	ASTM D5185m	2	**0**	0	4
Phosphorus	ppm	ASTM D5185m		**<1**	7	8
Zinc	ppm	ASTM D5185m		**<1**	27	0
Sulfur	ppm	ASTM D5185m		**19426**	16929	16690

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**2**	1	<1
Sodium	ppm	ASTM D5185m		**0**	12	17
Potassium	ppm	ASTM D5185m	>20	**2**	13	11
Water	%	ASTM D6304	>0.05	**0.008**	0.013	0.030
ppm Water	ppm	ASTM D6304	>500	**87**	136.7	308.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**724**	860	10076
Particles >6µm		ASTM D7647	>1300	**247**	211	▲ 4249
Particles >14µm		ASTM D7647	>80	**10**	25	▲ 280
Particles >21µm		ASTM D7647	>20	**2**	7	● 37
Particles >38µm		ASTM D7647	>4	**0**	0	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	**17/15/10**	17/15/12	▲ 19/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.54**	0.34	0.352

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

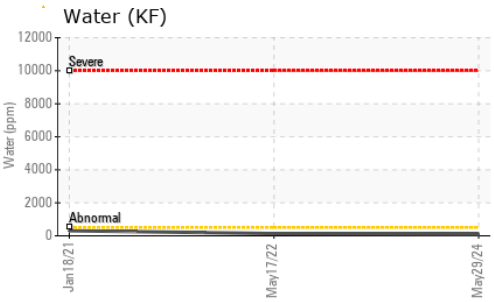

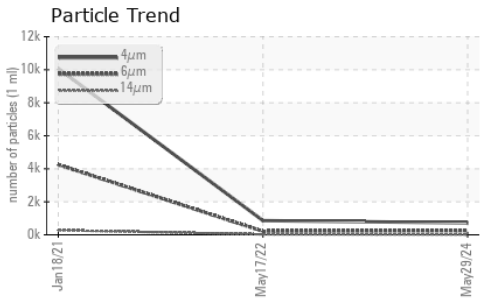

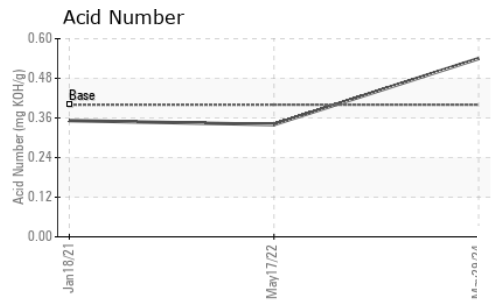

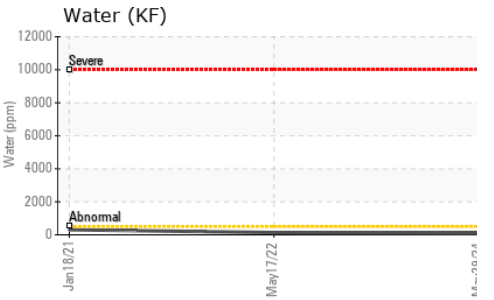

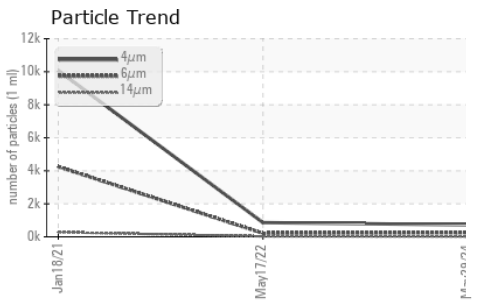

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	▲ **59.83**	44.9	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom			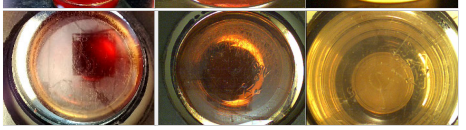		

GRAPHS

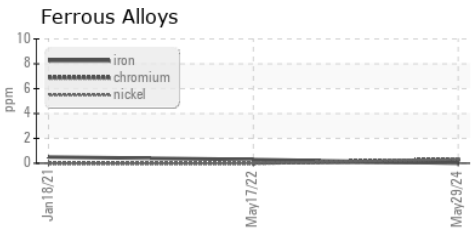

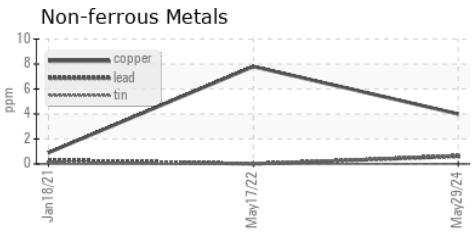

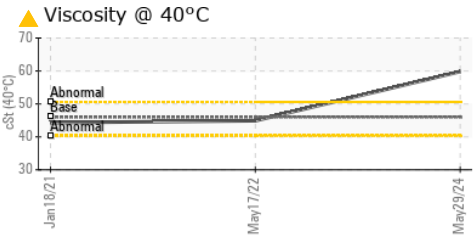

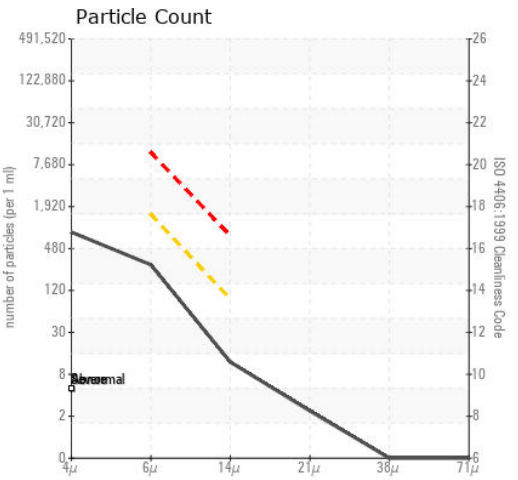

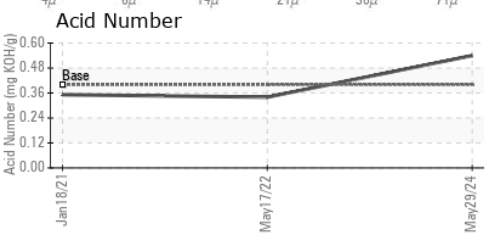

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011330 **Received** : 21 Jun 2024
Lab Number : 06217332 **Tested** : 26 Jun 2024
Unique Number : 11090196 **Diagnosed** : 26 Jun 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AMAZON TUL2
4040 N 125TH E AVE
TULSA, OK
US 74116
Contact: W. HOWEL
whowel@amazon.com
T:
F: