




# OIL ANALYSIS REPORT

Sample Rating Trend

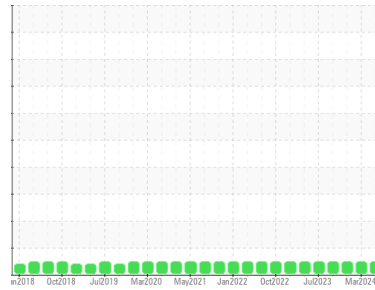

**NORMAL**



Area  
**ENGINE ROOM**  
 Machine Id  
**C-5 (S/N 10242F05813037)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI 1009-68 SC (65 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0013141</b>	USP0008164	USP0005204
Sample Date	Client Info		<b>18 Jun 2024</b>	28 Mar 2024	27 Dec 2023
Machine Age	hrs	Client Info	<b>13211</b>	13210	13195
Oil Age	hrs	Client Info	<b>13211</b>	117	13195
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>3</b>	2	1
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m >4	<b>&lt;1</b>	1	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>1</b>	1	0
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	2	0
Water	%	ASTM D6304 >0.01	<b>0.001</b>	0.002	0.002
ppm Water	ppm	ASTM D6304 >100	<b>9</b>	16	19

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>530</b>	3259	707
Particles >6µm	ASTM D7647	>2500	<b>124</b>	713	139
Particles >14µm	ASTM D7647	>320	<b>6</b>	37	15
Particles >21µm	ASTM D7647	>80	<b>2</b>	5	4
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>16/14/10</b>	19/17/12	17/14/11

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.014	0.014



# OIL ANALYSIS REPORT

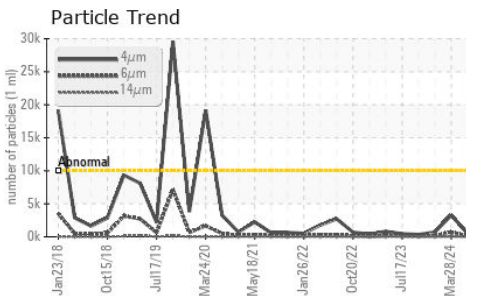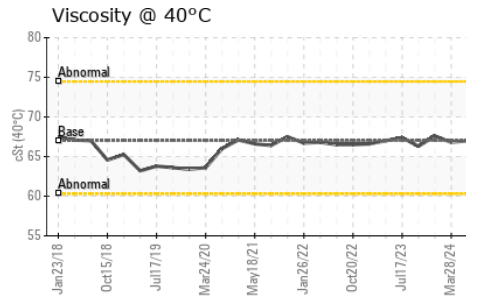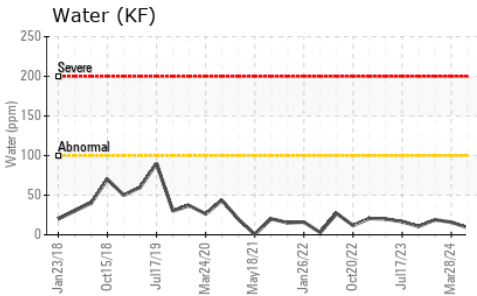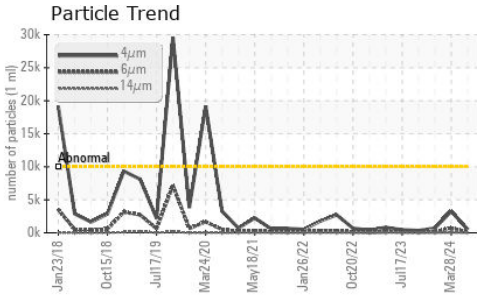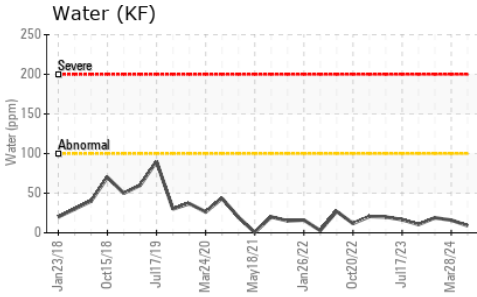


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	67.0	66.8	67.6






SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

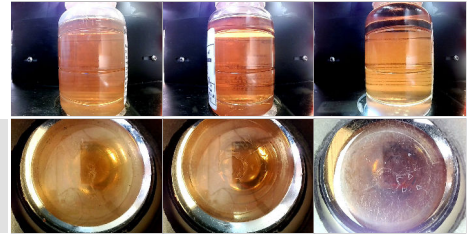

Bottom

## GRAPHS

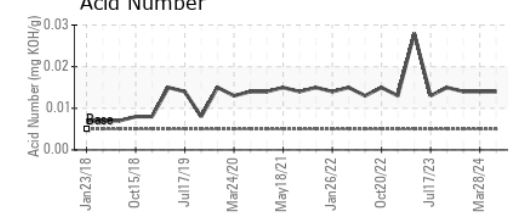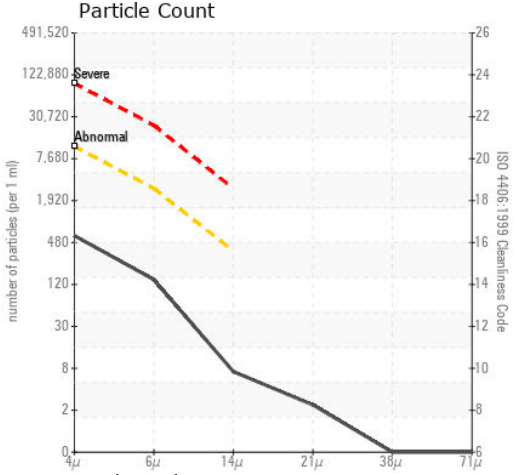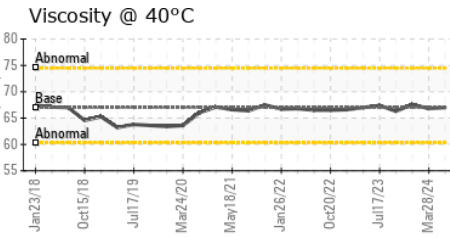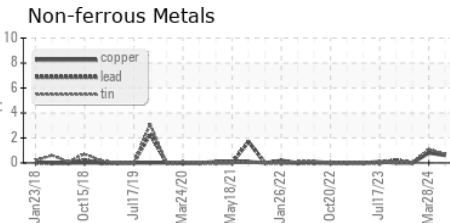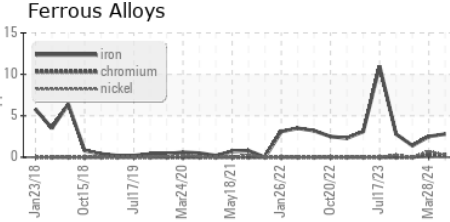

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USP0013141  
 Lab Number : 06217357  
 Unique Number : 11090221  
 Test Package : IND 2

Received : 21 Jun 2024  
 Tested : 25 Jun 2024  
 Diagnosed : 25 Jun 2024 - Doug Bogart

TYSON - ROCHELLE

ROCHELLE, IL  
 US 61068  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: