




# OIL ANALYSIS REPORT

## Sample Rating Trend

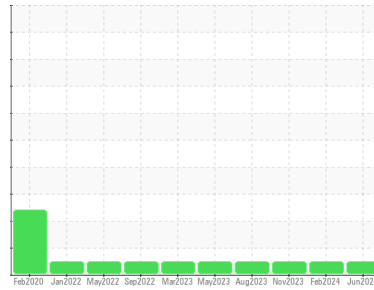

**NORMAL**



Machine Id  
**COHO\_U1 COHO\_U1\_P1**  
 Component  
**Drive End Pump**  
 Fluid  
**SHELL TELLUS 32 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2    |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number      | Client Info |             |            | <b>RP0032750</b>   | RP0032747   | RP0032724   |
| Sample Date        | Client Info |             |            | <b>12 Jun 2024</b> | 15 Feb 2024 | 14 Nov 2023 |
| Machine Age        | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Age            | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | N/A         | N/A         |
| Sample Status      |             |             |            | <b>NORMAL</b>      | NORMAL      | NORMAL      |

| WEAR METALS |     | method      | limit/base | current      | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron        | ppm | ASTM D5185m | >90        | <b>&lt;1</b> | <1       | <1       |
| Chromium    | ppm | ASTM D5185m | >5         | <b>&lt;1</b> | <1       | <1       |
| Nickel      | ppm | ASTM D5185m | >5         | <b>&lt;1</b> | <1       | <1       |
| Titanium    | ppm | ASTM D5185m | >3         | <b>&lt;1</b> | <1       | <1       |
| Silver      | ppm | ASTM D5185m | >3         | <b>&lt;1</b> | <1       | 0        |
| Aluminum    | ppm | ASTM D5185m | >7         | <b>3</b>     | <1       | <1       |
| Lead        | ppm | ASTM D5185m | >12        | <b>1</b>     | <1       | <1       |
| Copper      | ppm | ASTM D5185m | >30        | <b>2</b>     | 3        | 1        |
| Tin         | ppm | ASTM D5185m | >9         | <b>2</b>     | 3        | 1        |
| Vanadium    | ppm | ASTM D5185m |            | <b>&lt;1</b> | 0        | 0        |
| Cadmium     | ppm | ASTM D5185m |            | <b>&lt;1</b> | <1       | <1       |




| ADDITIVES  |     | method      | limit/base | current      | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Barium     | ppm | ASTM D5185m |            | <b>1</b>     | 5        | <1       |
| Molybdenum | ppm | ASTM D5185m |            | <b>&lt;1</b> | <1       | <1       |
| Manganese  | ppm | ASTM D5185m |            | <b>&lt;1</b> | <1       | <1       |
| Magnesium  | ppm | ASTM D5185m | 11         | <b>80</b>    | 63       | 66       |
| Calcium    | ppm | ASTM D5185m | 35         | <b>11</b>    | 13       | 13       |
| Phosphorus | ppm | ASTM D5185m | 259        | <b>348</b>   | 226      | 286      |
| Zinc       | ppm | ASTM D5185m | 277        | <b>417</b>   | 331      | 331      |

| CONTAMINANTS |     | method      | limit/base | current      | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >60        | <b>3</b>     | 3        | 2        |
| Sodium       | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Potassium    | ppm | ASTM D5185m | >20        | <b>1</b>     | <1       | 1        |
| Water        | %   | ASTM D6304  | >.1        | <b>0.001</b> | 0.001    | 0.005    |
| ppm Water    | ppm | ASTM D6304  | >1000      | <b>7</b>     | 9        | 60       |

| FLUID DEGRADATION |          | method     | limit/base | current     | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 | 0.32       | <b>0.34</b> | 0.31     | 0.30     |

| VISUAL           |        | method  | limit/base | current      | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal      | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Precipitate      | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Silt             | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Debris           | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Appearance       | scalar | *Visual | NORML      | <b>NORML</b> | NORML    | NORML    |
| Odor             | scalar | *Visual | NORML      | <b>NORML</b> | NORML    | NORML    |
| Emulsified Water | scalar | *Visual | >.1        | <b>NEG</b>   | NEG      | NEG      |
| Free Water       | scalar | *Visual |            | <b>NEG</b>   | NEG      | NEG      |

# OIL ANALYSIS REPORT

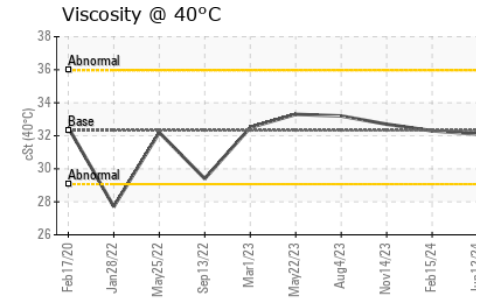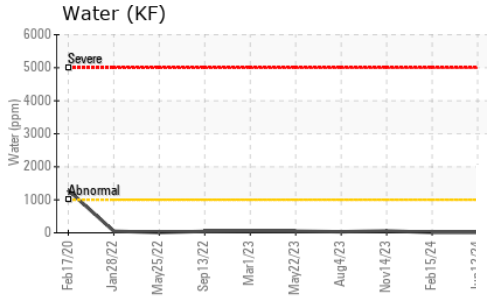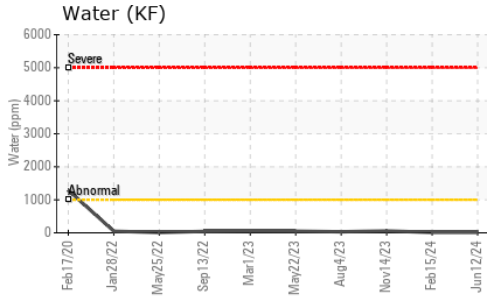

| FLUID PROPERTIES |     | method    | limit/base | current     | history1 | history2 |
|------------------|-----|-----------|------------|-------------|----------|----------|
| Visc @ 40°C      | cSt | ASTM D445 | 32.32      | <b>32.1</b> | 32.3     | 32.7     |





| SAMPLE IMAGES |  | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---------|----------|----------|
|---------------|--|--------|------------|---------|----------|----------|

Color



Bottom

## GRAPHS

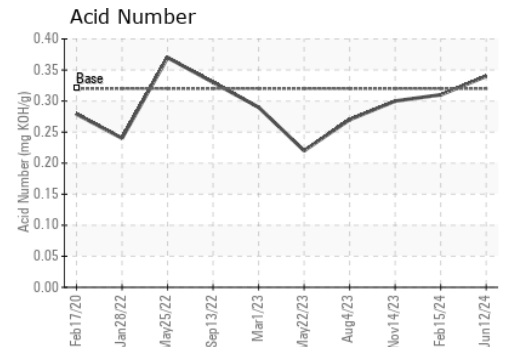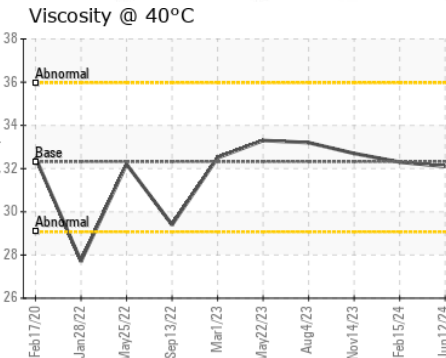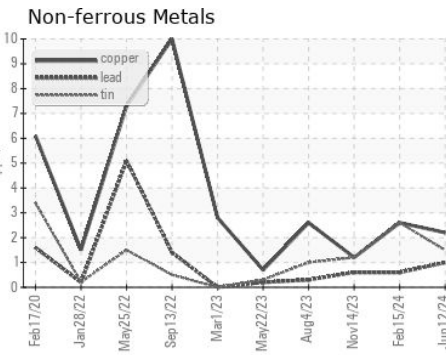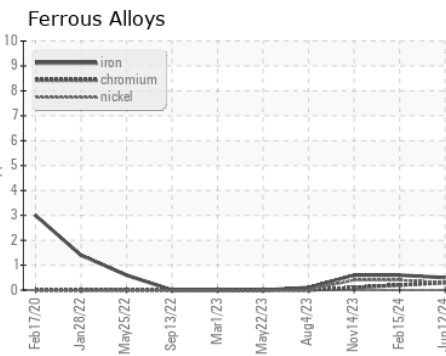

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0032750  
**Lab Number** : 06217376  
**Unique Number** : 11090240  
**Test Package** : IND 2

**Received** : 21 Jun 2024  
**Tested** : 25 Jun 2024  
**Diagnosed** : 25 Jun 2024 - Don Baldrige

**ENERGY TRANSFER - COHOCTON**  
 4191 WENTWORTH ROAD  
 COHOCTON, NY  
 US 14826  
 Contact: JERRY HIGGINS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (610)858-3838

F: