




# OIL ANALYSIS REPORT

Sample Rating Trend

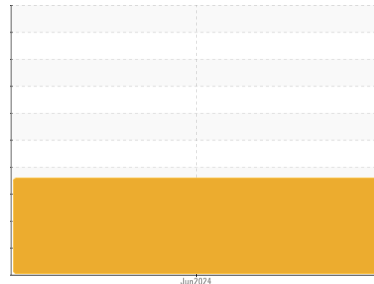

**WATER**



Machine Id  
**ACL 2 METERING UNIT**  
 Component  
**Hydraulic System**  
 Fluid  
**SHELL TELLUS 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

The iron level is abnormal.

### Contamination

Appearance is hazy. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>TLC0001850</b>	---	---
Sample Date	Client Info		<b>20 Jun 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>▲ 22</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >20	<b>3</b>	---	---
Tin	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.0	<b>5</b>	---	---
Barium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>1</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m 11	<b>66</b>	---	---
Calcium	ppm	ASTM D5185m 35	<b>95</b>	---	---
Phosphorus	ppm	ASTM D5185m 266	<b>325</b>	---	---
Zinc	ppm	ASTM D5185m 276	<b>368</b>	---	---
Sulfur	ppm	ASTM D5185m 1847	<b>1047</b>	---	---

## CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>2</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>2</b>	---	---
Water	%	ASTM D6304 >0.05	<b>▲ 0.081</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>▲ 810</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.36	<b>0.38</b>	---	---



# OIL ANALYSIS REPORT

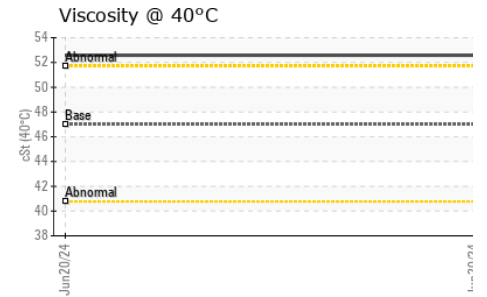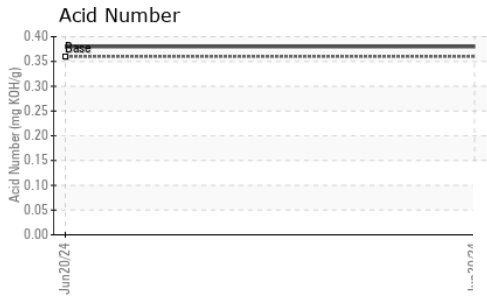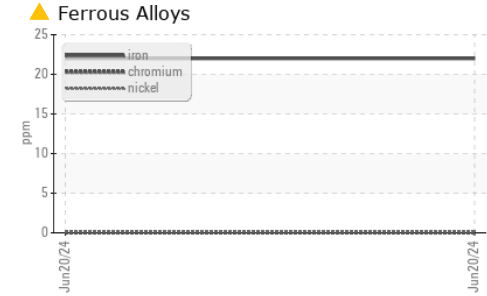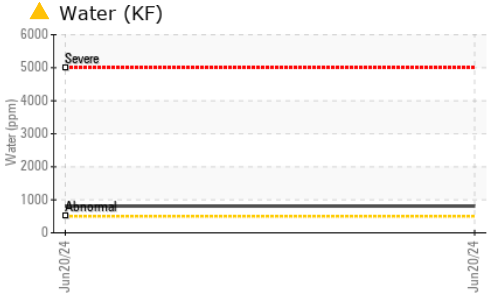





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	● HAZY	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.99	52.58	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

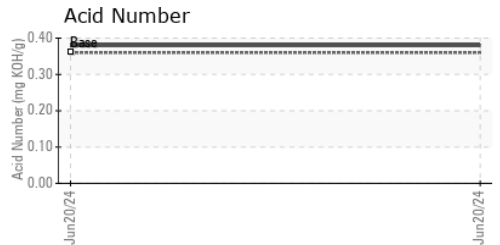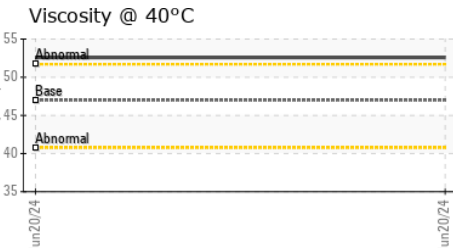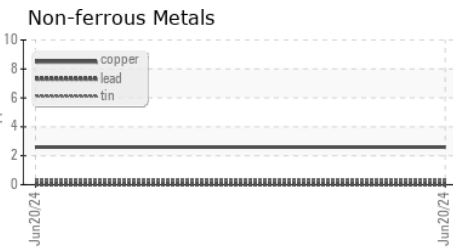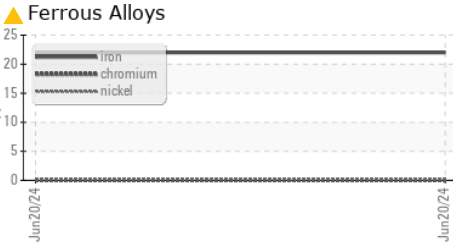

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TLC0001850      **Received** : 24 Jun 2024  
**Lab Number** : 06218162      **Tested** : 27 Jun 2024  
**Unique Number** : 11096359      **Diagnosed** : 27 Jun 2024 - Jonathan Hester  
**Test Package** : PLANT

**AUTONEUM**  
 1103 POWDERHOUSE RD  
 AIKEN, SC 29803  
 Contact: JEFFREY WASHICK  
 jeffrey.washick@autoneum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)