




OIL ANALYSIS REPORT

Sample Rating Trend

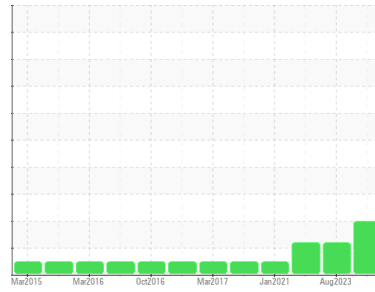

ISO



Area
Compressor
 Machine Id
2140 CO03
 Component
Compressor
 Fluid
ULTIMA 46 (15 GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0806875	WC0806891	WC0668079
Sample Date	Client Info		23 Apr 2024	08 Aug 2023	24 Oct 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Not Changed	Not Changd	Not Changed
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		26	18	---
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >5	0	0	0
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >15	0	0	0
Lead	ppm	ASTM D5185m >65	0	0	0
Copper	ppm	ASTM D5185m >65	2	<1	<1
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	0	2	0
Calcium	ppm	ASTM D5185m	0	0	0
Phosphorus	ppm	ASTM D5185m	18	62	11
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	28	45	41

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	4	6	3
Sodium	ppm	ASTM D5185m	2	<1	0
Potassium	ppm	ASTM D5185m >20	2	0	0
Water	%	ASTM D6304 >0.1	0.046	0.061	---
ppm Water	ppm	ASTM D6304 >1000	462	614.2	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 75221	● 17607	▲ 22841
Particles >6µm	ASTM D7647	>2500	▲ 26914	● 4756	▲ 5259
Particles >14µm	ASTM D7647	>320	▲ 1186	283	225
Particles >21µm	ASTM D7647	>80	▲ 170	80	24
Particles >38µm	ASTM D7647	>20	2	5	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 23/22/17	● 21/19/15	▲ 22/20/15



OIL ANALYSIS REPORT

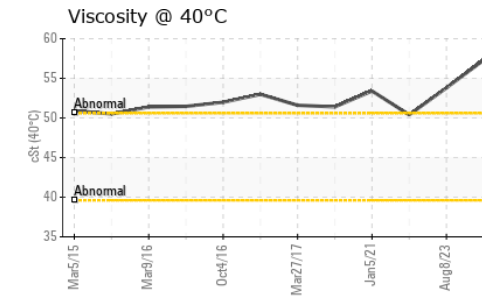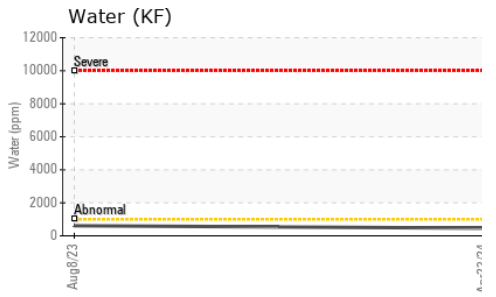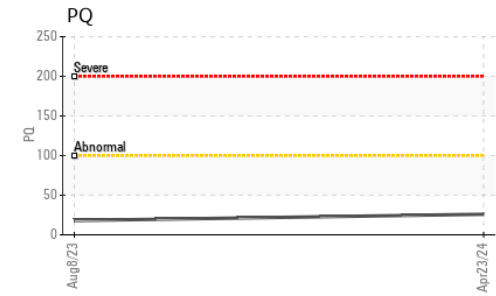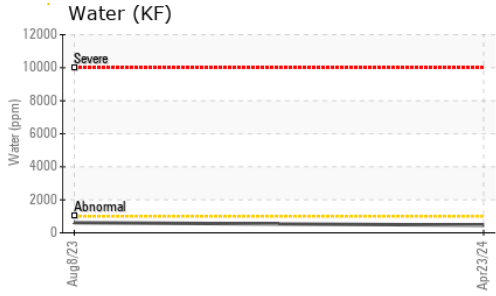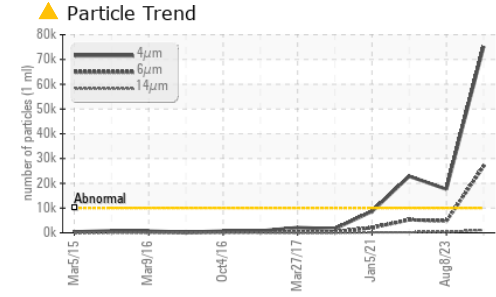


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.53	0.55	0.75






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		57.3	53.8	50.4

SAMPLE IMAGES

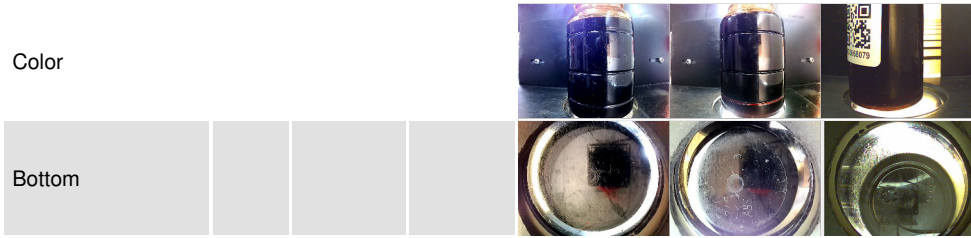

GRAPHS

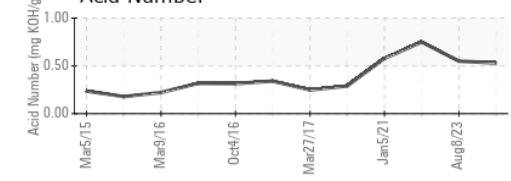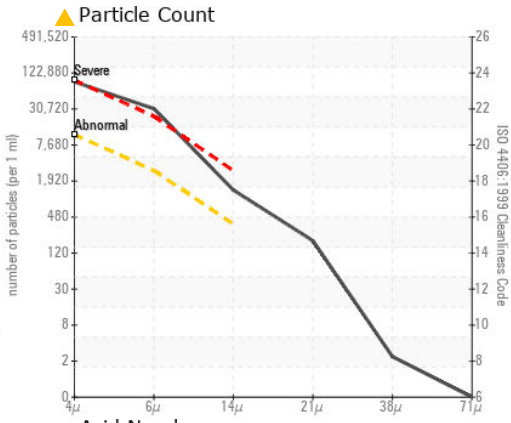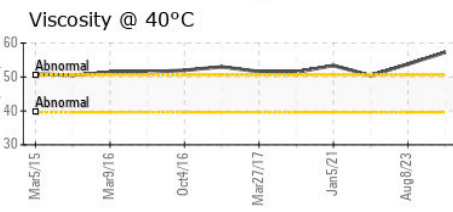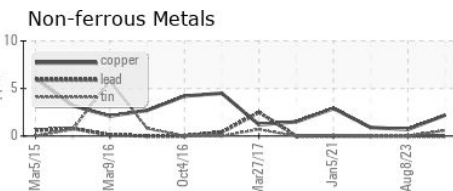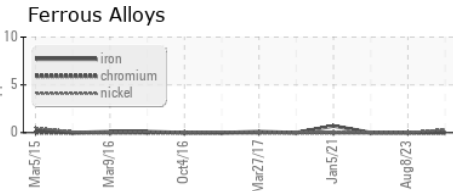

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0806875
Lab Number : 06218235
Unique Number : 11096432
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)
Received : 24 Jun 2024
Tested : 27 Jun 2024
Diagnosed : 27 Jun 2024 - Jonathan Hester

ARAUCO FLAKEBOARD - MDF
 985 CORINTH RD
 MONCURE, NC
 US
 Contact: CHRISTOPHER JACKSON
 christopher.jackson@arauco.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)