

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

GLB LOPOKL/SOUTH FC-10 (S/N 05376011)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		v2006 Mar201	0 Apr2011 Apr2018 Dec2	019 Nov2020 Oct2021 Oct2022	Oct2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013100	USP0005945	USP0005122
Sample Date		Client Info		23 Jun 2024	13 Mar 2024	04 Jan 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	1	<1
Chromium	ppm	ASTM D5185m	>2	0	<1	<1
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>3	0	0	1
Lead	ppm	ASTM D5185m	>2	0	1	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		<1	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	<1
Sodium	ppm	ASTM D5185m		<1	1	0
Potassium	ppm	ASTM D5185m	>20	0	1	1
Water	%	ASTM D6304	>0.01	0.002	0.003	0.001
ppm Water	ppm	ASTM D6304	>100	18	27	9
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	1116	15891	10700
Particles >6µm		ASTM D7647	>2500	312	3379	3030
Particles >14μm		ASTM D7647	>320	15	97	142
Particles >21µm		ASTM D7647	>80	3	12	19
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/15/11	21/19/14	21/19/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.012	0.014





OIL ANALYSIS REPORT














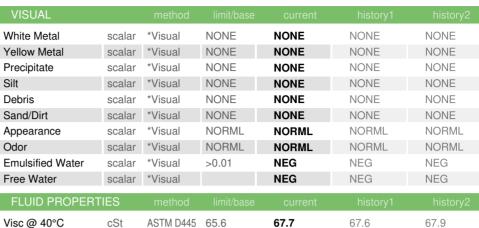

Visc @ 40°C	cSt	ASTM D445	65.6	67.7	67.6	67.9	
044454544465							

Color





GRAPHS		
Ferrous Alloys	Particle Count	T26
8 iron	751,320	T20
6	122,880 Severe	-24
4	30,720	22
2 1000000000000000000000000000000000000	Abnormal	TZZ
	- _€ 7,680	-20
Nov9/06 Mar25/10 Apr29/18 Dec.25/19 Nov19/20 Oct3/21 Oct12/22	n 1,920	-20 -18 -16 -14
Ma Ap Ap Oc Oc Oc Oc	8	10
Non-ferrous Metals	480	-16
0 copper 1	1.920 the of particles (per 1 m) 1.920 the of particles (per 1 m) 120 the of particles (per 1	14
**************************************	m line	
4 ************************************	5 30	-12
2 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1		10
Nov9/06 Mar25/10 Apr21/11 Apr29/18 Dec.25/19 Oct3/21 Oct12/22	2	18
No Apr Apr Oct Oct	0	6
Viscosity @ 40°C	4μ 6 μ 14 μ 21 μ 38 μ Acid Number	$I1\mu$
Abnormal	© 0.02 _T	101115111
Min	90.02	<u> </u>
Special Absence of the Control of th	Act of Mumber (ng KOHg) (100 to 100 t	$\neg \lor$
0 - Abnormal	Base	
	2 0.01	171511
710 + 7	A A A A A A A A A A A A A A A A A A A	/23
Nov9/06 Mar25/10 Apr21/11 Apr29/18 Dec.25/19 Oct3/21 Oct12/22	Mar25/10 Mar25/10 Apr21/11 Apr29/18 Oct3/21 Oct12/22	Oct18/23

: 25 Jun 2024 - Doug Bogart





Laboratory

Sample No. Lab Number : 06218270 Unique Number : 11096467 Test Package : IND 2

: USP0013100

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 24 Jun 2024 **Tested** : 25 Jun 2024

Diagnosed

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (405)789-7500 F: (405)499-0128

Report Id: LOPOKL [WUSCAR] 06218270 (Generated: 06/25/2024 18:11:31) Rev: 1

Contact/Location: John Myers - LOPOKL

LOPEZ FOODS-OKLAHOMA CITY

OKLAHOMA CITY, OK

Contact: John Myers

US 73127