

# **OIL ANALYSIS REPORT**

## Sample Rating Trend



NORMAL



Machine Id

# FES/MYCOM LOPOKL 3 EAST (RB) (S/N 1613720)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


v2006 Jun2010 Sep2011 0ct2018 Rev2020 Jun2021 Jun2022 Mar2022 Jun2024								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		USP0013096	USP0005950	USP0005126		
Sample Date		Client Info		23 Jun 2024	13 Mar 2024	04 Jan 2024		
Machine Age	hrs	Client Info		0	0	0		
Oil Age	hrs	Client Info		0	0	0		
Oil Changed		Client Info		N/A	N/A	N/A		
Sample Status				NORMAL	NORMAL	NORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>8	0	0	0		
Chromium	ppm	ASTM D5185m	>2	0	<1	<1		
Nickel	ppm	ASTM D5185m		0	0	0		
Titanium	ppm	ASTM D5185m		0	<1	0		
Silver	ppm	ASTM D5185m	>2	0	<1	0		
Aluminum	ppm	ASTM D5185m	>3	0	0	1		
Lead	ppm	ASTM D5185m	>2	0	1	<1		
Copper	ppm	ASTM D5185m	>8	0	0	0		
Tin	ppm	ASTM D5185m	>4	0	<1	<1		
Vanadium	ppm	ASTM D5185m		0	<1	0		
Cadmium	ppm	ASTM D5185m		0	<1	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	0	0		
Barium	ppm	ASTM D5185m		0	0	0		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		0	<1	0		
Magnesium	ppm	ASTM D5185m		0	0	0		
Calcium	ppm	ASTM D5185m		0	0	0		
Phosphorus	ppm	ASTM D5185m		0	0	<1		
Zinc	ppm	ASTM D5185m		0	0	0		
Sulfur	ppm	ASTM D5185m	50	0	0	0		
CONTAMINANTS		method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	<1	1	<1		
Sodium	ppm	ASTM D5185m		<1	1	0		
Potassium	ppm	ASTM D5185m	>20	0	1	1		
Water	%	ASTM D6304	>0.01	0.003	0.001	0.001		
ppm Water	ppm	ASTM D6304	>100	30	4	7		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647	>10000	4232	686	1061		
Particles >6µm		ASTM D7647	>2500	970	117	261		
Particles >14µm		ASTM D7647	>320	21	9	12		
Particles >21µm		ASTM D7647	>80	2	2	3		
Particles >38µm		ASTM D7647	>20	0	0	0		
Particles >71µm		ASTM D7647	>4	0	0	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/17/12	17/14/10	17/15/11		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.015	0.014		





## **OIL ANALYSIS REPORT**



300k	Par	ticle	Tren	d						
≘ <sup>250k</sup>		4 4 4 6	μm μm 4μm	1						
150k 150k 100k 50k				A	A					
≣ 50k 0k	9	ormal								
	Nov8/06	Jun21/10	Sep2/11	Oct18/18	Apr22/20	Jan25/21	Jan5/22	Mar23/23	Jan4/24	








VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IFS	method	limit/base	current	history1	history2


I LOID I HOI LIT	TILO					
Visc @ 40°C	cSt	ASTM D445	65.6	64.5	65.2	64.8

Color			

SAMPLE IMAGES





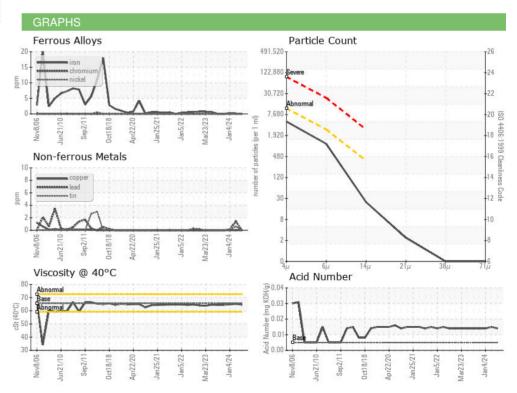





Laboratory Sample No.

Lab Number : 06218274

: USP0013096 Unique Number : 11096471

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 24 Jun 2024 **Tested** : 25 Jun 2024

Diagnosed

Test Package : IND 2

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

OKLAHOMA CITY, OK : 25 Jun 2024 - Doug Bogart

US 73127 Contact: John Myers

T: (405)789-7500 F: (405)499-0128

LOPEZ FOODS-OKLAHOMA CITY