


# **OIL ANALYSIS REPORT**

Sample Rating Trend

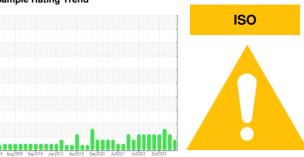

Machine Id

# FES LOPOKL/SOUTH FC-02 (S/N AB10097)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

### **DIAGNOSIS**

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil.


### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


| SAMPLE INFORM   | MATION   | method       | limit/base | current         | history1          | history2          |
|-----------------|----------|--------------|------------|-----------------|-------------------|-------------------|
| Sample Number   |          | Client Info  |            | USP0013088      | USP0005930        | USP0005115        |
| Sample Date     |          | Client Info  |            | 23 Jun 2024     | 13 Mar 2024       | 04 Jan 2024       |
| Machine Age     | hrs      | Client Info  |            | 0               | 0                 | 0                 |
| Oil Age         | hrs      | Client Info  |            | 0               | 0                 | 0                 |
| Oil Changed     |          | Client Info  |            | N/A             | N/A               | N/A               |
| Sample Status   |          |              |            | ABNORMAL        | ABNORMAL          | ABNORMAL          |
| WEAR METALS     |          | method       | limit/base | current         | history1          | history2          |
| Iron            | ppm      | ASTM D5185m  | >8         | 2               | 3                 | <1                |
| Chromium        | ppm      | ASTM D5185m  | >2         | 0               | <1                | <1                |
| Nickel          | ppm      | ASTM D5185m  |            | 0               | 0                 | 0                 |
| Titanium        | ppm      | ASTM D5185m  |            | 0               | <1                | 0                 |
| Silver          | ppm      | ASTM D5185m  | >2         | 0               | <1                | 0                 |
| Aluminum        | ppm      | ASTM D5185m  | >3         | 0               | 0                 | 1                 |
| Lead            | ppm      | ASTM D5185m  | >2         | 0               | 1                 | 0                 |
| Copper          | ppm      | ASTM D5185m  | >8         | 0               | 0                 | 0                 |
| Tin             | ppm      | ASTM D5185m  | >4         | 0               | <1                | 0                 |
| Vanadium        | ppm      | ASTM D5185m  |            | 0               | <1                | 0                 |
| Cadmium         | ppm      | ASTM D5185m  |            | 0               | 0                 | 0                 |
| ADDITIVES       |          | method       | limit/base | current         | history1          | history2          |
| Boron           | ppm      | ASTM D5185m  |            | 0               | 0                 | 0                 |
| Barium          | ppm      | ASTM D5185m  |            | 0               | 0                 | 0                 |
| Molybdenum      | ppm      | ASTM D5185m  |            | 0               | <1                | <1                |
| Manganese       | ppm      | ASTM D5185m  |            | 0               | <1                | 0                 |
| Magnesium       | ppm      | ASTM D5185m  |            | 0               | 0                 | <1                |
| Calcium         | ppm      | ASTM D5185m  |            | 0               | 0                 | <1                |
| Phosphorus      | ppm      | ASTM D5185m  |            | 0               | 0                 | <1                |
| Zinc            | ppm      | ASTM D5185m  |            | <1              | 0                 | 0                 |
| Sulfur          | ppm      | ASTM D5185m  | 50         | 0               | 0                 | 0                 |
| CONTAMINANTS    | 5        | method       | limit/base | current         | history1          | history2          |
| Silicon         | ppm      | ASTM D5185m  | >15        | <1              | <1                | 0                 |
| Sodium          | ppm      | ASTM D5185m  |            | <1              | 2                 | 0                 |
| Potassium       | ppm      | ASTM D5185m  |            | 0               | 1                 | 1                 |
| Water           | %        | ASTM D6304   | >0.01      | 0.002           | 0.001             | 0.002             |
| ppm Water       | ppm      | ASTM D6304   | >100       | 19              | 4                 | 19                |
| FLUID CLEANLIN  | IESS     | method       | limit/base | current         | history1          | history2          |
| Particles >4µm  |          | ASTM D7647   | >10000     | <u>▲</u> 30249  | <u>▲</u> 127368   | <b>▲</b> 80492    |
| Particles >6µm  |          | ASTM D7647   | >2500      | 2178            | <u>4</u> 24089    | <u>^</u> 20264    |
| Particles >14µm |          | ASTM D7647   | >320       | 14              | 118               | <b>△</b> 370      |
| Particles >21μm |          | ASTM D7647   | >80        | 1               | 10                | 28                |
| Particles >38µm |          | ASTM D7647   | >20        | 0               | 0                 | 1                 |
| Particles >71µm |          | ASTM D7647   | >4         | 0               | 0                 | 0                 |
| Oil Cleanliness |          | ISO 4406 (c) | >20/18/15  | <u>22/18/11</u> | <u>4</u> 24/22/14 | <u>4</u> 24/22/16 |
| FLUID DEGRADA   | TION     | method       | limit/base | current         | history1          | history2          |
|                 | mg KOH/g | ASTM D974    | 0.005      | 0.014           | 0.014             | 0.014             |





## **OIL ANALYSIS REPORT**












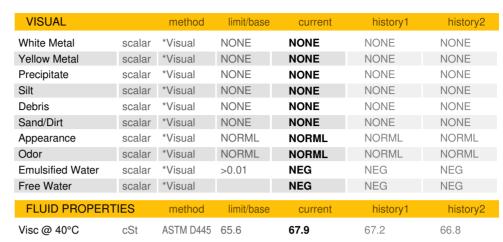

| SAMPLE IMAGES |
|---------------|
|---------------|

method

limit/base

current

historv1

historv2

**GRAPHS** 

Color

**Bottom** 

Ferrous Alloys Particle Count 491.52 122,88 30.72 1,920 Non-ferrous Metals 480 120 Viscosity @ 40°C Acid Number (B/0.05 XOH/0.04 €0.03 흘 0.02 Abnorma 0.0 0.00 PG





Laboratory Sample No. Lab Number

: USP0013088 : 06218282 Unique Number : 11096479 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 24 Jun 2024

**Tested** : 25 Jun 2024

Diagnosed : 25 Jun 2024 - Doug Bogart

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (405)789-7500 F: (405)499-0128

Report Id: LOPOKL [WUSCAR] 06218282 (Generated: 06/25/2024 18:13:54) Rev: 1

Contact/Location: John Myers - LOPOKL

LOPEZ FOODS-OKLAHOMA CITY

OKLAHOMA CITY, OK

Contact: John Myers

US 73127