

# **OIL ANALYSIS REPORT**

# VISCOSITY

#### Machine Id

# 2280-C-14 S FES 700 (S/N 2511143)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

## DIAGNOSIS

### A Recommendation

The oil is near the end of it's useful service life, recommend schedule an oil change. Resample at the next service interval to monitor.

## Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition


The viscosity is at the top-end of the recommended limit. Confirmed. The AN level is acceptable for this fluid.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013113	USP0006141	USP0005003
Sample Date		Client Info		01 Jun 2024	08 Mar 2024	01 Dec 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				MARGINAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	<1
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		1	0	0
Sulfur	ppm	ASTM D5185m	50	4	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	<1
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.01	0.007	0.005	0.008
opm Water	ppm	ASTM D6304	>100	74	51	81
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	1871	11423	4190
Particles >6µm		ASTM D7647	>2500	408	2131	805
Particles >14µm		ASTM D7647	>320	6	45	13
Particles >21µm		ASTM D7647	>80	1	7	2
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/16/10	21/18/13	19/17/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.014


Contact/Location: SERVICE MANAGER - FARDEN Page 1 of 2





# **OIL ANALYSIS REPORT**












VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	<b>A</b> 79.41	77.8	78.4
SAMPLE IMAGES	S	method	limit/base	current	history1	history2
Color				•	Nr.	-
Bottom				68	(6)	(6)

Abnorma

50

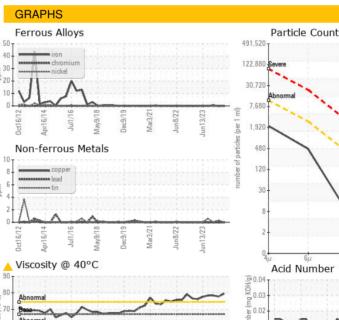

lar3/21

Pr0/10

20 8 4406 1999 Clea 6 14 12 Code Acid Number 0.01 Bas Pi 0.00 un8/22 lar3/21 pr16/12 er/9/19 Oct16/1

#### Apr16/14 un8/22 Jun13/23 Oct16/12 Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **SMITHFIELD - DENISON - SMIDENIOW** Sample No. : USP0013113 Received : 24 Jun 2024 800 INDUSTRIAL ROAD Lab Number : 06218295 Tested : 26 Jun 2024 DENISON, IA Unique Number : 11096492 Diagnosed : 26 Jun 2024 - Doug Bogart US 51442 Test Package : IND 2 Contact: SERVICE MANAGER To discuss this sample report, contact Customer Service at 1-800-237-1369. T: (712)263-7414 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Nun

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ST/P/m

F: (712)263-7314

Report Id: FARDEN [WUSCAR] 06218295 (Generated: 06/30/2024 15:17:37) Rev: 1

Certificate 12367

Contact/Location: SERVICE MANAGER - FARDEN