


# OIL ANALYSIS REPORT

Sample Rating Trend

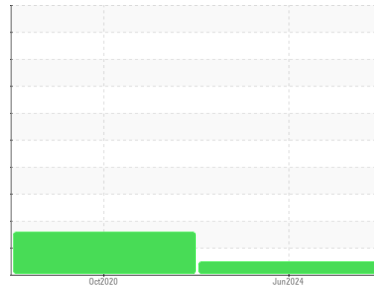

Machine Id  
**C-141**  
Component  
**Refrigeration Compressor**  
Fluid  
**TULCO LUBSOIL SYN RL WI 100 (--- GAL)**

**DIAGNOSIS**

**Recommendation**  
Resample at the next service interval to monitor.

**Wear**  
All component wear rates are normal.

**Contamination**  
The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>TO20000336</b>	TO2000977	---
Sample Date	Client Info			<b>12 Jun 2024</b>	12 Oct 2020	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	MARGINAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>10</b>	<1	---
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>2	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>8	<b>0</b>	0	---
Tin	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	---
Antimony	ppm	ASTM D5185m		<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	2	---
Barium	ppm	ASTM D5185m		<b>0</b>	2	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m		<b>0</b>	1	---
Phosphorus	ppm	ASTM D5185m	1500	<b>826</b>	217	---
Zinc	ppm	ASTM D5185m		<b>31</b>	0	---
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>6</b>	2	---
Sodium	ppm	ASTM D5185m		<b>5</b>	8	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	---
Water	%	ASTM D6304	>2.26	<b>0.056</b>	▲ 0.047	---
ppm Water	ppm	ASTM D6304	>22600	<b>568</b>	▲ 477.2	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>6291</b>	5796	---
Particles >6µm		ASTM D7647	>2500	<b>1631</b>	1199	---
Particles >14µm		ASTM D7647	>320	<b>40</b>	20	---
Particles >21µm		ASTM D7647	>80	<b>6</b>	4	---
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>20/18/12</b>	20/17/11	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.04	<b>0.069</b>	0.015	---


# OIL ANALYSIS REPORT

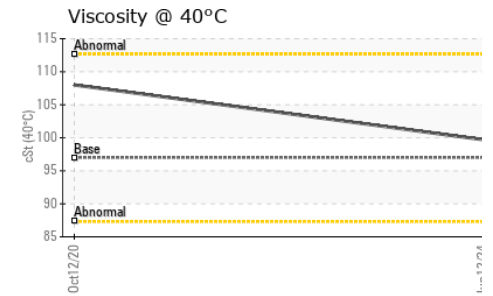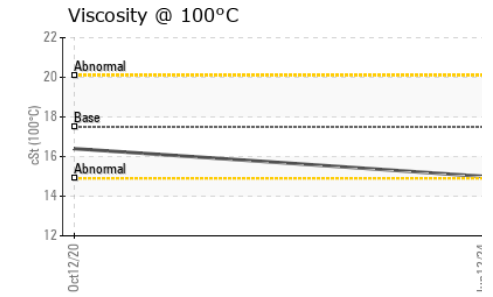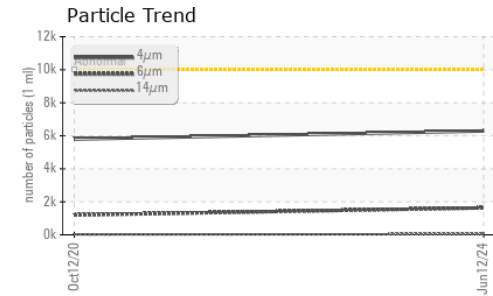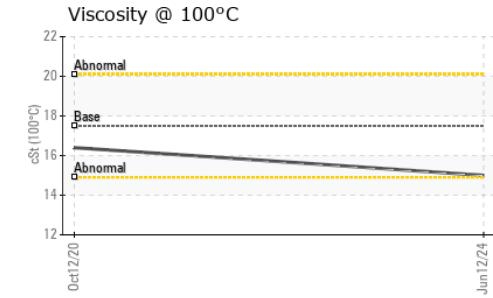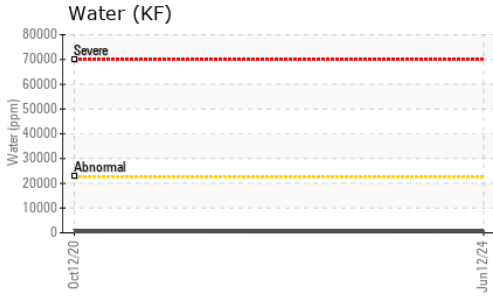






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>2.26	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	97	<b>99.7</b>	108
Visc @ 100°C	cSt	ASTM D445	17.5	<b>15.0</b>	16.4
Viscosity Index (VI)	Scale	ASTM D2270	198	<b>157</b>	164

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

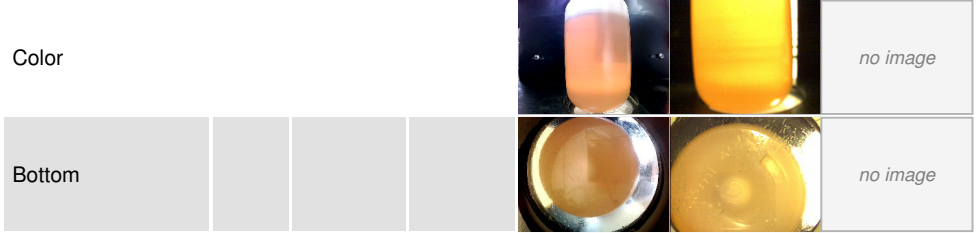

## GRAPHS

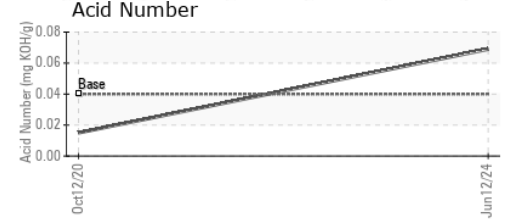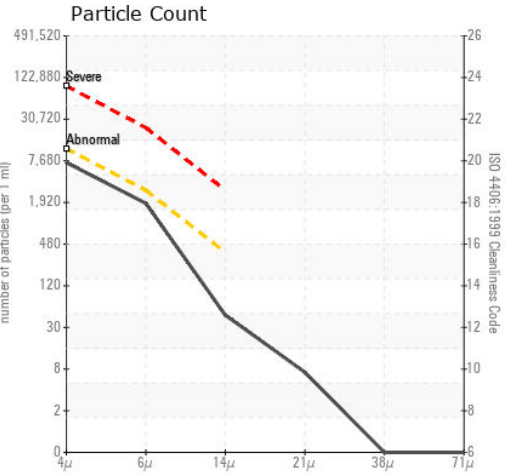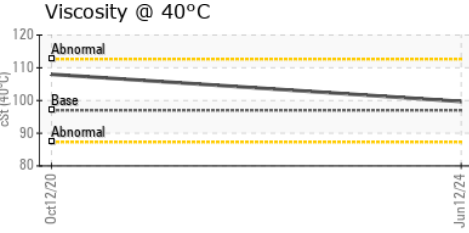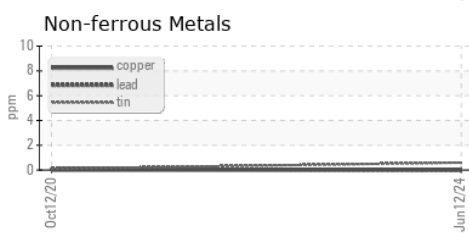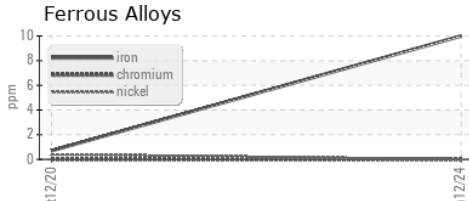

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO20000336 **Received** : 24 Jun 2024  
**Lab Number** : **06218315** **Tested** : 25 Jun 2024  
**Unique Number** : 11096512 **Diagnosed** : 26 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KV100, PrtCount, VI )

**ENLINK MIDSTREAM - CHISHOLM PLANT**  
 3000 W TEXACO RD  
 CUSHING, OK  
 US 74023  
 Contact: TYLER FINCH  
 tyler.finch@enlink.com  
 T: (918)399-0359  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)