


OIL ANALYSIS REPORT

Sample Rating Trend

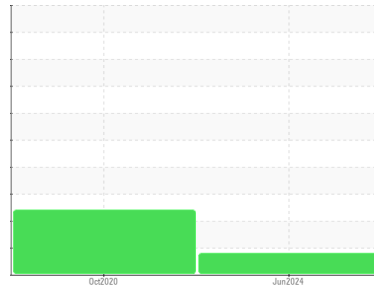

Machine Id
C-3142
Component
Refrigeration Compressor
Fluid
TULCO LUBSOIL SYN RL WI 100 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TO20000334	TO2000982	---
Sample Date	Client Info		12 Jun 2024	12 Oct 2020	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	▲ 7	2	---
Chromium	ppm	ASTM D5185m >2	0	0	---
Nickel	ppm	ASTM D5185m	0	<1	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m >2	0	<1	---
Aluminum	ppm	ASTM D5185m >3	0	0	---
Lead	ppm	ASTM D5185m >2	0	0	---
Copper	ppm	ASTM D5185m >8	0	0	---
Tin	ppm	ASTM D5185m >4	<1	<1	---
Antimony	ppm	ASTM D5185m	---	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	2	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m	0	0	---
Calcium	ppm	ASTM D5185m	<1	0	---
Phosphorus	ppm	ASTM D5185m 1500	723	224	---
Zinc	ppm	ASTM D5185m	28	0	---
Sulfur	ppm	ASTM D5185m	0	0	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	2	---
Sodium	ppm	ASTM D5185m	4	6	---
Potassium	ppm	ASTM D5185m >20	0	0	---
Water	%	ASTM D6304 >2.26	0.223	▲ 0.037	---
ppm Water	ppm	ASTM D6304 >22600	2232	▲ 378.8	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	734	▲ 92439	---
Particles >6µm	ASTM D7647	>2500	182	▲ 17738	---
Particles >14µm	ASTM D7647	>320	7	209	---
Particles >21µm	ASTM D7647	>80	2	23	---
Particles >38µm	ASTM D7647	>20	0	0	---
Particles >71µm	ASTM D7647	>4	0	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	17/15/10	▲ 24/21/15	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.04	0.042	0.015	---


OIL ANALYSIS REPORT

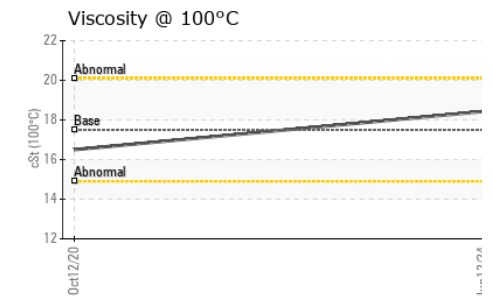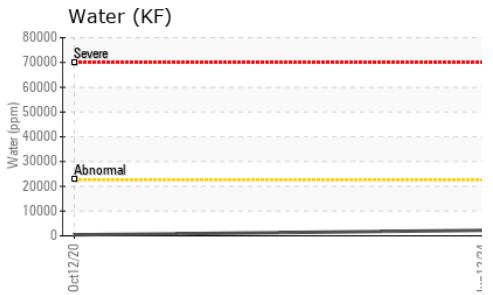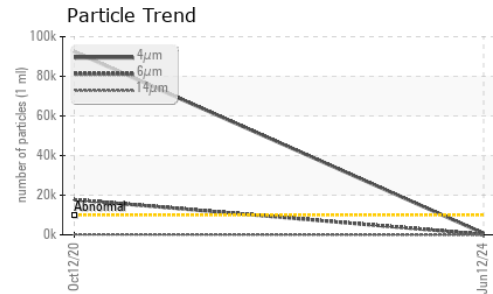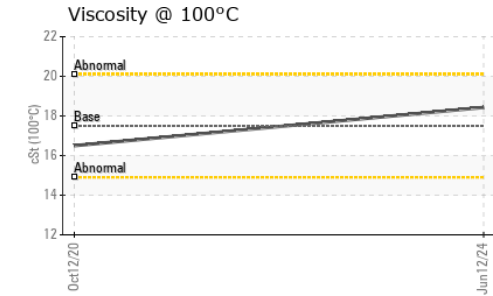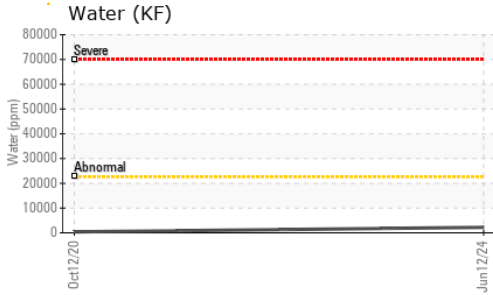






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2.26	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	97	107	106
Visc @ 100°C	cSt	ASTM D445	17.5	18.43	16.5
Viscosity Index (VI)	Scale	ASTM D2270	198	192	168

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

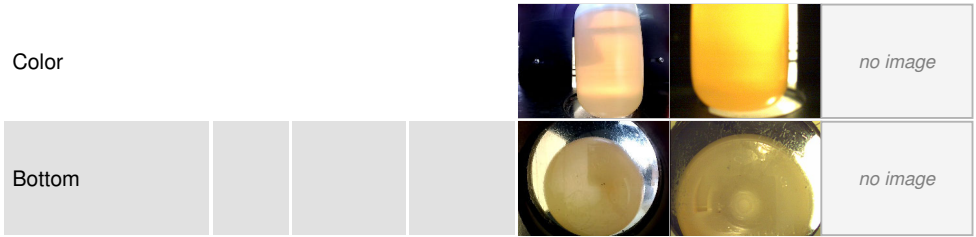

GRAPHS

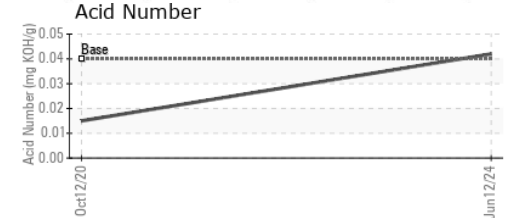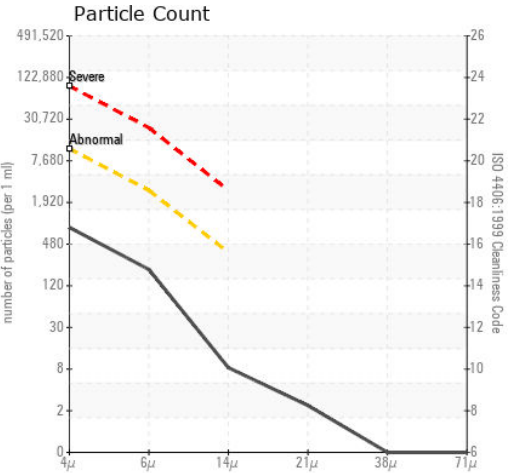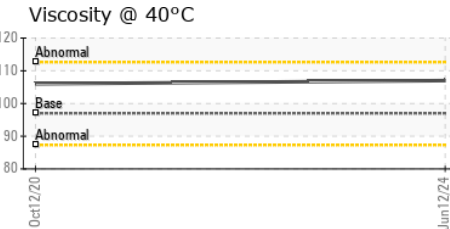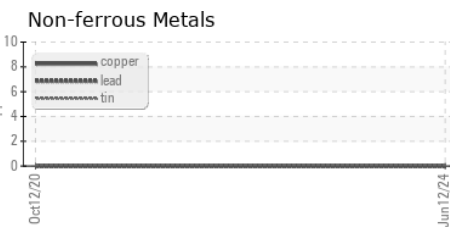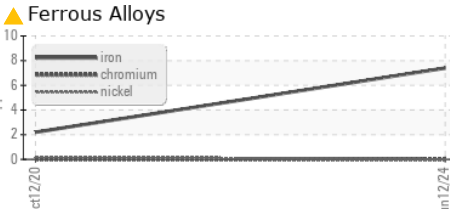

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : TO20000334

Lab Number : 06218321

Unique Number : 11096518

Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 24 Jun 2024

Tested : 27 Jun 2024

Diagnosed : 27 Jun 2024 - Jonathan Hester

ENLINK MIDSTREAM - CHISHOLM PLANT

3000 W TEXACO RD

CUSHING, OK

US 74023

Contact: TYLER FINCH

tyler.finch@enlink.com

T: (918)399-0359

F: