


OIL ANALYSIS REPORT

Sample Rating Trend



WEAR

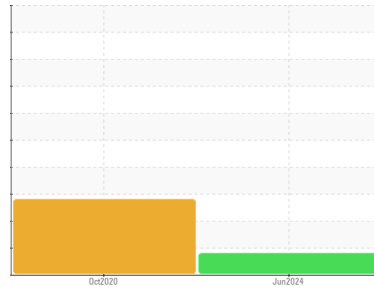

Machine Id
C-143
 Component
Refrigeration Compressor
 Fluid
TULCO LUBSOIL SYN RL WI 100 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The iron level is abnormal. All other component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TO20000339	TO2000983	---
Sample Date	Client Info			12 Jun 2024	12 Oct 2020	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	▲ 17	3	---
Chromium	ppm	ASTM D5185m	>2	0	0	---
Nickel	ppm	ASTM D5185m		0	<1	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m	>2	0	<1	---
Aluminum	ppm	ASTM D5185m	>3	0	0	---
Lead	ppm	ASTM D5185m	>2	0	0	---
Copper	ppm	ASTM D5185m	>8	0	0	---
Tin	ppm	ASTM D5185m	>4	<1	<1	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	2	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	<1	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		<1	<1	---
Calcium	ppm	ASTM D5185m		<1	<1	---
Phosphorus	ppm	ASTM D5185m	1500	910	225	---
Zinc	ppm	ASTM D5185m		53	3	---
Sulfur	ppm	ASTM D5185m		0	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1	2	---
Sodium	ppm	ASTM D5185m		7	5	---
Potassium	ppm	ASTM D5185m	>20	<1	0	---
Water	%	ASTM D6304	>2.26	0.201	▲ 0.024	---
ppm Water	ppm	ASTM D6304	>22600	2016	▲ 245.2	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	5737	▲ 28201	---
Particles >6µm		ASTM D7647	>2500	1342	▲ 8816	---
Particles >14µm		ASTM D7647	>320	25	● 406	---
Particles >21µm		ASTM D7647	>80	2	53	---
Particles >38µm		ASTM D7647	>20	0	1	---
Particles >71µm		ASTM D7647	>4	0	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/12	▲ 22/20/16	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.04	0.113	0.027	---


OIL ANALYSIS REPORT

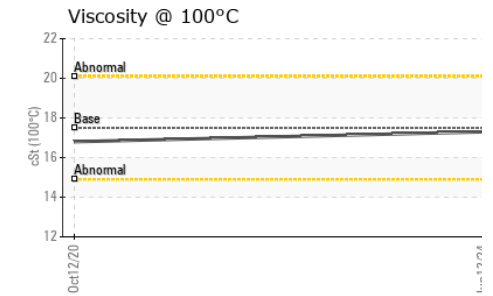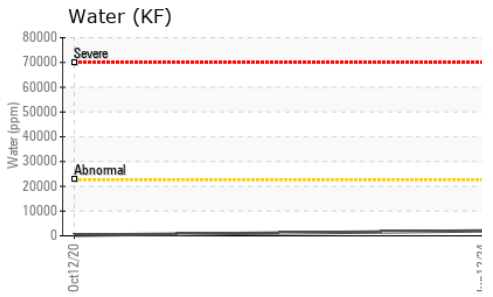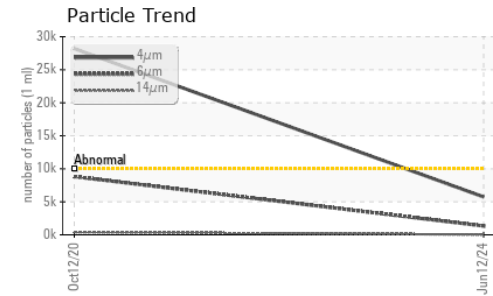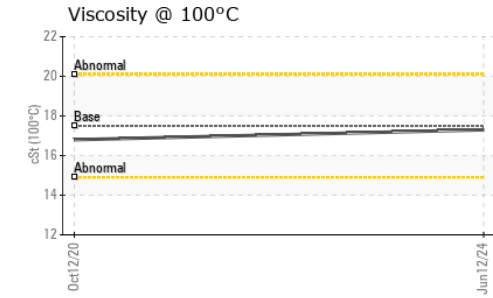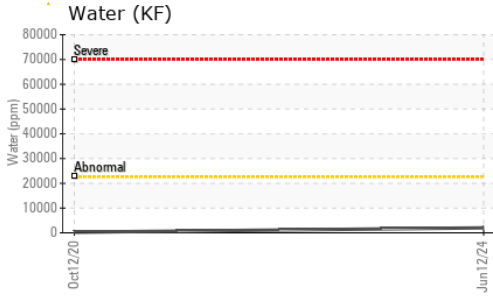





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2.26	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	97	107	---
Visc @ 100°C	cSt	ASTM D445	17.5	17.3	16.8
Viscosity Index (VI)	Scale	ASTM D2270	198	177	171

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

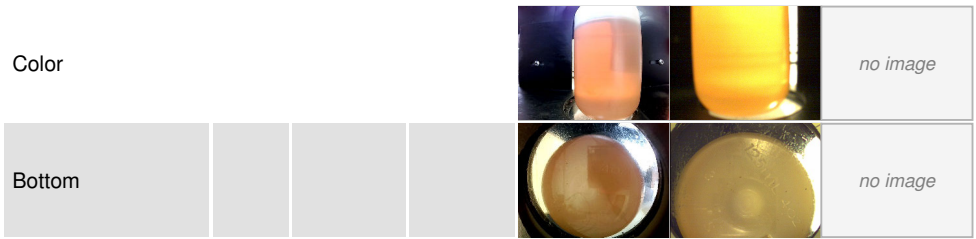

GRAPHS

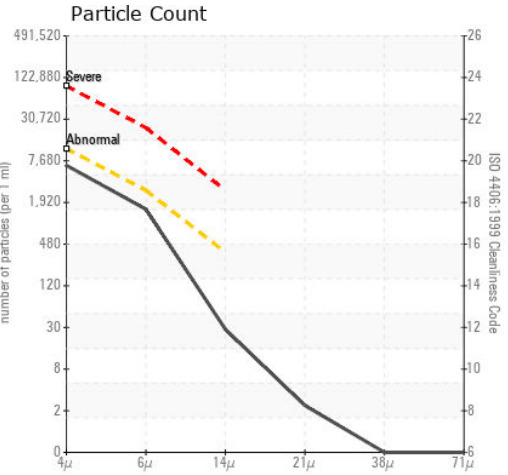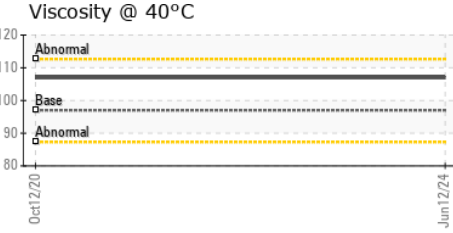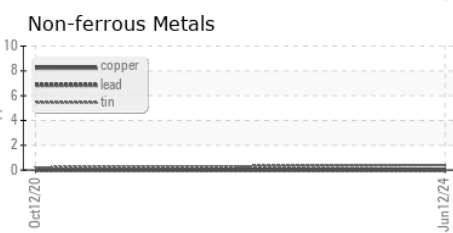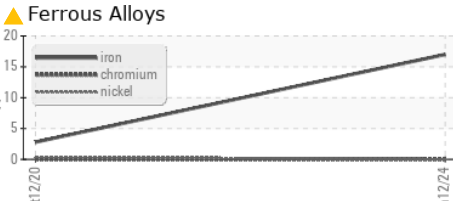

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO20000339 **Received** : 24 Jun 2024
Lab Number : 06218322 **Tested** : 25 Jun 2024
Unique Number : 11096519 **Diagnosed** : 26 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

ENLINK MIDSTREAM - CHISHOLM PLANT
 3000 W TEXACO RD
 CUSHING, OK
 US 74023
 Contact: TYLER FINCH
 tyler.finch@enlink.com
 T: (918)399-0359
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)