


OIL ANALYSIS REPORT

Sample Rating Trend

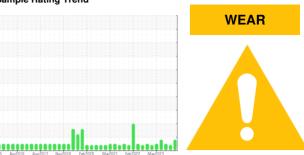

Machine Id

HS-15 (S/N W0896UFMPTHAA03)

Refrigeration Compressor

CAMCO 717 SC (150 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

The iron level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0901867	WC0901869	WC0864156
Sample Date		Client Info		18 Jun 2024	04 Feb 2024	12 Nov 2023
Machine Age	hrs	Client Info		169989	159767	158802
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<u> </u>	6	10
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	1	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		<1	0	0
Phosphorus	ppm	ASTM D5185m		1	0	1
Zinc	ppm	ASTM D5185m		5	0	0
Sulfur	ppm	ASTM D5185m		57	44	68
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	0
Sodium	ppm	ASTM D5185m		1	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.01	0.006	0.003	0.004
ppm Water	ppm	ASTM D6304	>100	66	34	47.6
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A si al Niversala a v. (ANI)	ma I/OII/a	ACTM DOZA		0.014	0.070	0.010




OIL ANALYSIS REPORT









VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	LIGHT
Debris	scalar	*Visual	NONE	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/hase	current	history1	history2

T LOID T HOT LITTIES		memod	IIIIII basc	Carrent	Thotory I	Thotol y	
Visc @ 40°C	cSt	ASTM D445		73.3	73.0	74.4	


SAMPLE IMAGES method limit/base current history1 historv2


Color







GRAPHS













Certificate 12367

Laboratory Sample No.

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0901867 Lab Number : 06218327

Unique Number : 11096524

Received : 24 Jun 2024 **Tested**

: 25 Jun 2024 Diagnosed

: 26 Jun 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

michael.gruis@lambweston.com T: (218)732-2188 F: (218)732-2175

Report Id: LAMPAR [WUSCAR] 06218327 (Generated: 06/29/2024 23:24:41) Rev: 1

Contact/Location: MICHAEL GRUIS - LAMPAR

PO BOX 552

US 56470

LAMB WESTON/RDO

Contact: MICHAEL GRUIS

PARK RAPIDS, MN