




# OIL ANALYSIS REPORT

Sample Rating Trend

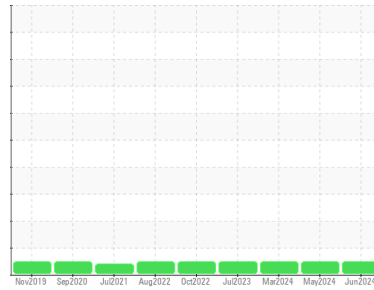

**NORMAL**



Machine Id  
**VANP\_U2320 VANP\_U2320\_M2320**  
 Component  
**Drive End Bearing**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (4 QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>RP0017580</b>	RP0032662	RP0017614	
Sample Date	Client Info	<b>19 Jun 2024</b>	23 May 2024	05 Mar 2024	
Machine Age	hrs	Client Info	<b>50000</b>	49872	49872
Oil Age	hrs	Client Info	<b>50000</b>	49872	49872
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m		<b>0</b>	1	0
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	1	3
Lead	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>20	<b>0</b>	3	2
Tin	ppm	ASTM D5185m	>20	<b>0</b>	6	7
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>92</b>	77	88
Calcium	ppm	ASTM D5185m		<b>1</b>	0	4
Phosphorus	ppm	ASTM D5185m		<b>0</b>	19	2
Zinc	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	<b>2</b>	3	1
Sodium	ppm	ASTM D5185m		<b>1</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Water	%	ASTM D6304	>0.05	<b>0.024</b>	0.019	0.016
ppm Water	ppm	ASTM D6304	>500	<b>248</b>	197	166




## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.35</b>	0.39	0.36

## VISUAL


method	limit/base	current	history1	history2		
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT


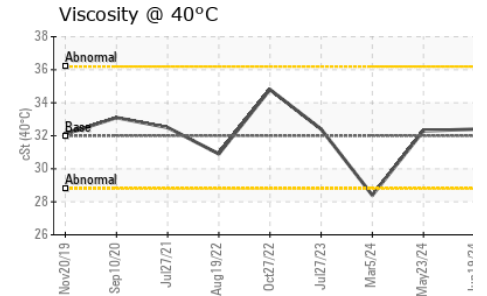
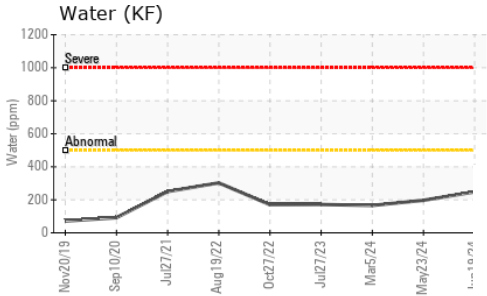
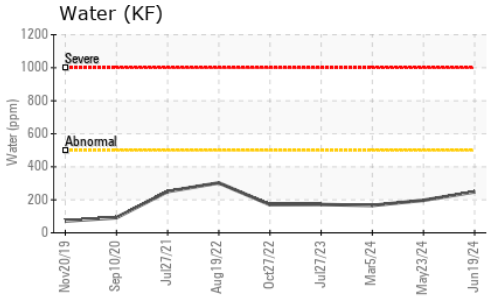


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	<b>32.4</b>	32.3	28.4

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

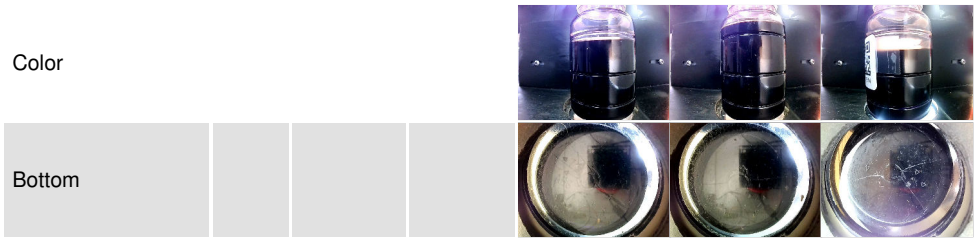

## GRAPHS

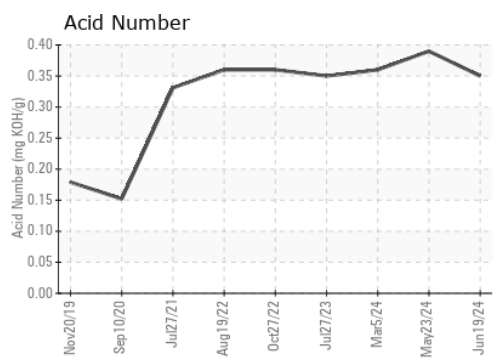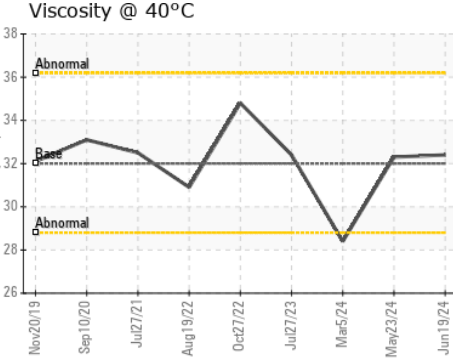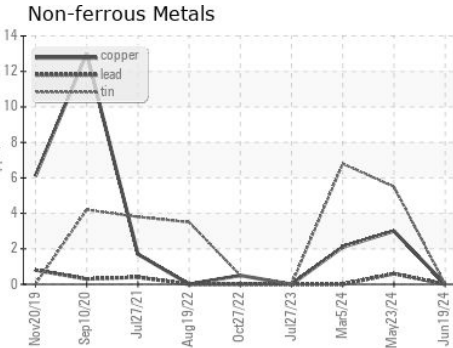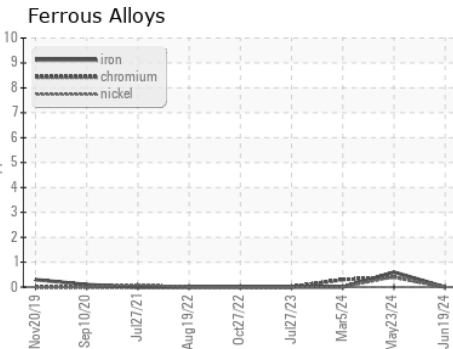

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0017580  
**Lab Number** : **06218338**  
**Unique Number** : 11096535  
**Test Package** : IND 2  
**Received** : 24 Jun 2024  
**Tested** : 25 Jun 2024  
**Diagnosed** : 26 Jun 2024 - Don Baldrige

**ENERGY TRANSFER - VANPORT**  
 660 DIVISION LN  
 BEAVER, PA  
 US 15009  
 Contact: LUKE SUMMERS  
 luke.summers@energytransfer.com  
 T: (216)308-2654  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)