




# OIL ANALYSIS REPORT

Sample Rating Trend

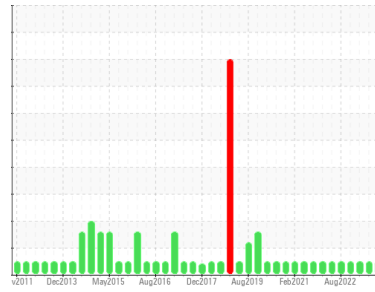

**NORMAL**



Machine Id  
**AIR BLOWER 1 (S/N 3796)**  
 Component  
**Blower**  
 Fluid  
 {not provided} (60 GAL)

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0901866</b>	WC0822379	WC0831591
Sample Date	Client Info		<b>23 Jun 2024</b>	12 Nov 2023	11 Aug 2023
Machine Age	hrs	Client Info	<b>0</b>	40314	39380
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >20	<b>4</b>	2	3
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>21</b>	21	21
Phosphorus	ppm	ASTM D5185m	<b>321</b>	317	321
Zinc	ppm	ASTM D5185m	<b>404</b>	399	404
Sulfur	ppm	ASTM D5185m	<b>3572</b>	3003	3735

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	1	1
Sodium	ppm	ASTM D5185m	<b>2</b>	0	2
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	2

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.42</b>	0.34	0.38




# OIL ANALYSIS REPORT

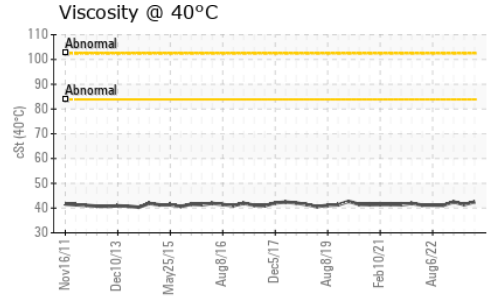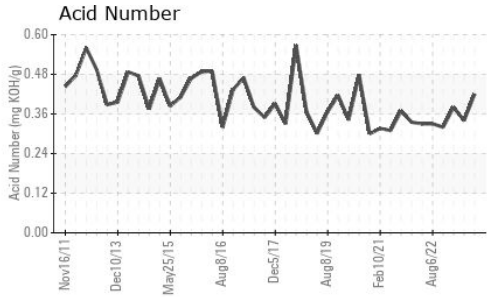





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	42.5	41.4	42.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

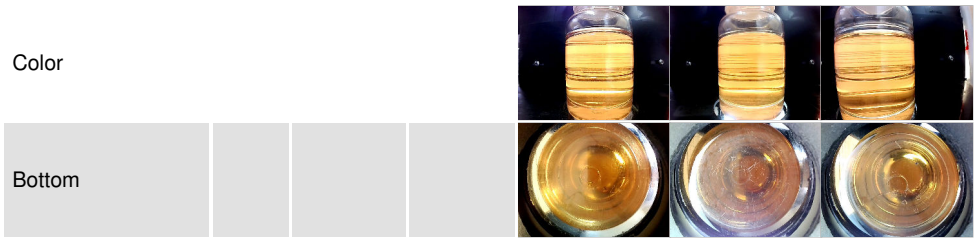

## GRAPHS

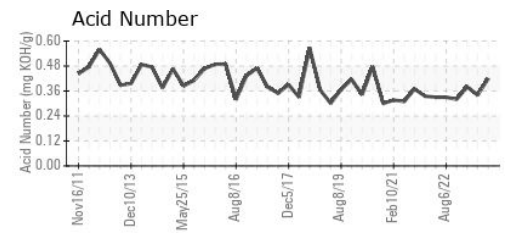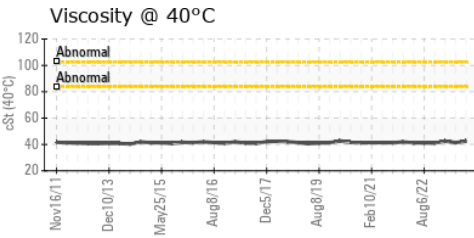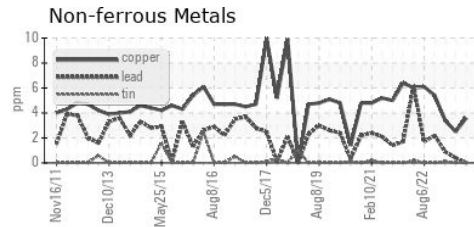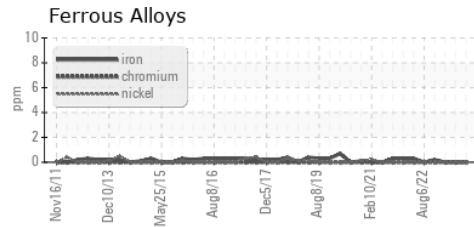

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0901866      **Received** : 24 Jun 2024  
**Lab Number** : 06218345      **Tested** : 25 Jun 2024  
**Unique Number** : 11096542      **Diagnosed** : 26 Jun 2024 - Don Baldrige  
**Test Package** : IND 2

**LAMB WESTON/RDO**  
 PO BOX 552  
 PARK RAPIDS, MN  
 US 56470  
 Contact: MICHAEL GRUIS  
 michael.gruis@lambweston.com  
 T: (218)732-2188  
 F: (218)732-2175

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)