




OIL ANALYSIS REPORT

Sample Rating Trend

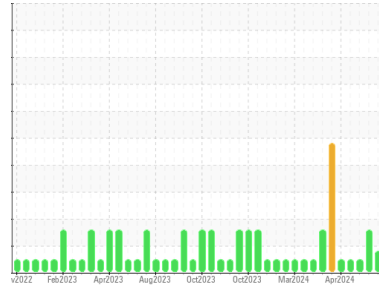

WEAR



Machine Id
4EK05286

Component
Biogas Engine

Fluid
D-A Lubricant Blue Flame HB-8 40W (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

An increase in the iron level is noted. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0880247	WC0880260	WC0880258
Sample Date	Client Info			21 Jun 2024	06 May 2024	29 Apr 2024
Machine Age	hrs	Client Info		83167	83159	82993
Oil Age	hrs	Client Info		8	420	354
Oil Changed	Client Info			N/A	Not Changd	N/A
Sample Status				ATTENTION	ABNORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>45	30	4	6
Chromium	ppm	ASTM D5185m	>2	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	1	0	1
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m	>5	<1	0	<1
Aluminum	ppm	ASTM D5185m	>10	4	2	3
Lead	ppm	ASTM D5185m	>5	2	<1	2
Copper	ppm	ASTM D5185m	>14	2	2	3
Tin	ppm	ASTM D5185m	>13	2	4	4
Vanadium	ppm	ASTM D5185m		<1	0	<1
Cadmium	ppm	ASTM D5185m		<1	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		7	0	0
Barium	ppm	ASTM D5185m		0	<1	<1
Molybdenum	ppm	ASTM D5185m		4	0	1
Manganese	ppm	ASTM D5185m		<1	<1	1
Magnesium	ppm	ASTM D5185m		28	4	6
Calcium	ppm	ASTM D5185m		2492	2339	2243
Phosphorus	ppm	ASTM D5185m		347	393	391
Zinc	ppm	ASTM D5185m		434	455	439
Sulfur	ppm	ASTM D5185m		3894	5150	4683

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	57	▲ 237	192
Sodium	ppm	ASTM D5185m		2	0	0
Potassium	ppm	ASTM D5185m	>20	3	0	2


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	4.0	4.8	4.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.1	22.6	21.2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	7.9	9.7	9.8
Acid Number (AN)	mg KOH/g	ASTM D8045		0.64	1.72	1.69
Base Number (BN)	mg KOH/g	ASTM D2896	8	7.87	4.94	4.66




OIL ANALYSIS REPORT


Ferrous Alloys

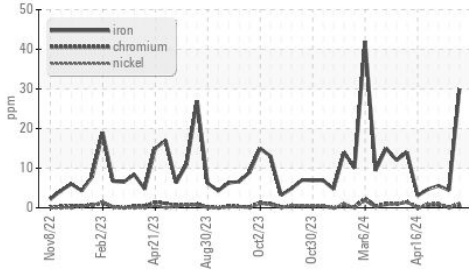


FT-IR (Direct Trend)

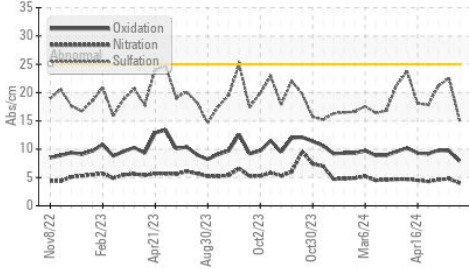


Acid Number

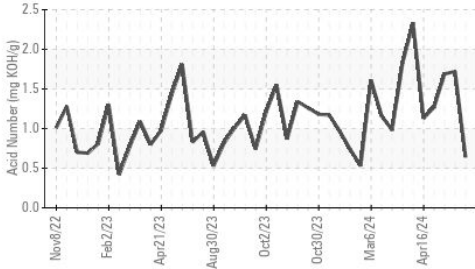

Base Number

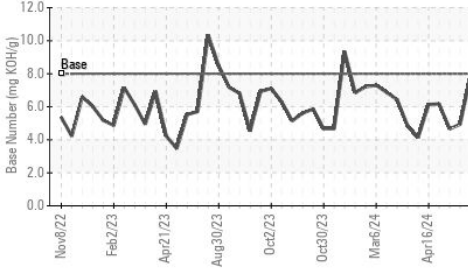

Viscosity @ 100°C

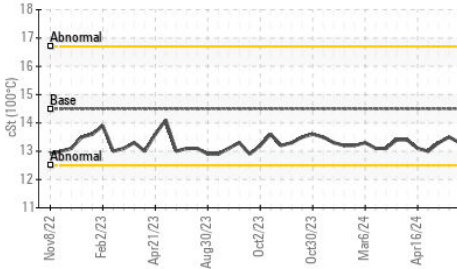


PARAMETER	VISUAL	method	limit/base	current	history1	history2
White Metal		scalar	*Visual	NONE	NONE	NONE
Yellow Metal		scalar	*Visual	NONE	NONE	NONE
Precipitate		scalar	*Visual	NONE	NONE	NONE
Silt		scalar	*Visual	NONE	NONE	NONE
Debris		scalar	*Visual	NONE	NONE	NONE
Sand/Dirt		scalar	*Visual	NONE	NONE	NONE
Appearance		scalar	*Visual	NORML	NORML	NORML
Odor		scalar	*Visual	NORML	NORML	NORML
Emulsified Water		scalar	*Visual	>0.1	NEG	NEG
Free Water		scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.5	13.3	13.5

GRAPHS


Iron (ppm)

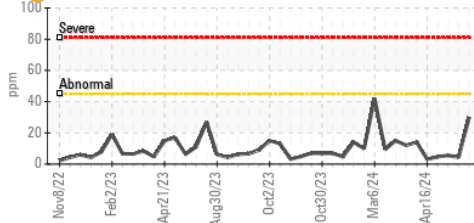


Aluminum (ppm)

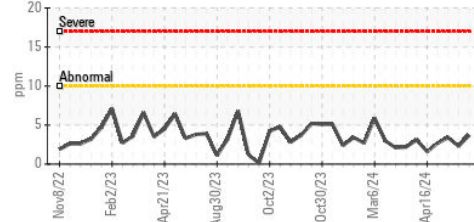


Copper (ppm)

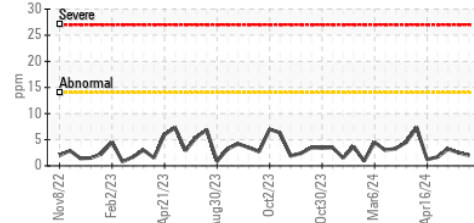


Viscosity @ 100°C

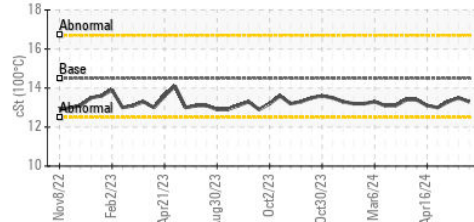


Lead (ppm)

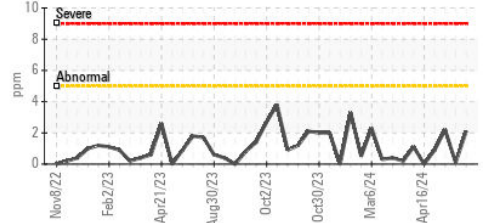


Chromium (ppm)

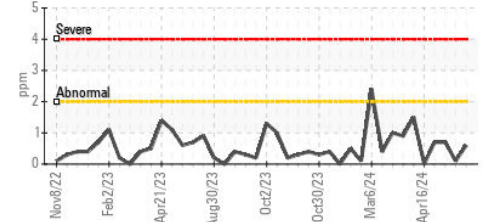

Silicon (ppm)

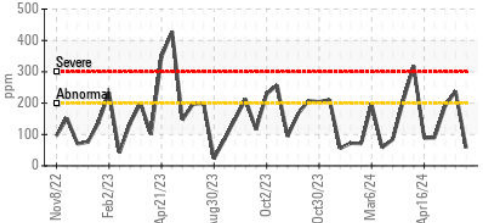

Base Number

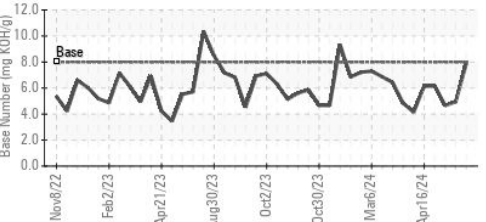

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0880247

Lab Number : 06218411

Unique Number : 11096608

Test Package : MOB 2

Received : 24 Jun 2024

Tested : 25 Jun 2024

Diagnosed : 25 Jun 2024 - Sean Felton

BI-COUNTY

3214 DOVER RD

WOODLAWN, TN

US 37191

Contact: KEVIN WEAVER

kevin.weaver@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)