

## FUEL REPORT

I

### Area HIGHLANDS CASHIERS HOSPITAL [17714] [HIGHLANDS CASHIERS HOSPITAL] WOODRUFF CLINIC

**Diesel Fuel** 

Fluid No.2 DIESEL FUEL (ULTRALOW SULPHUR) (1100 GAL)

#### DIAGNOSIS

#### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

#### Corrosion


All metal levels are normal indicating no corrosion in the system.

#### Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

#### **Fuel Condition**

Sulfur value derived by ASTM D5453 method for ULSD validation.



Sample Rating Trend




NORMAL


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0957796		
Sample Date		Client Info		23 Jun 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Yllow	Red		
ASTM Color	scalar	*ASTM D1500		L4.5		
Visc @ 40°C	cSt	ASTM D445	3.0	2.4		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	60.8		
SULFUR CONTER	١T	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	304		
Sulfur (UVF)	ppm	ASTM D5453		238		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	171		
5% Distillation Point	°C	ASTM D86		194		
10% Distill Point	°C	ASTM D86	201	203		
15% Distillation Point	°C	ASTM D86		211		
20% Distill Point	°C	ASTM D86	216	218		
30% Distill Point	°C	ASTM D86	230	232		
40% Distill Point	°C	ASTM D86	243	245		
50% Distill Point	°C	ASTM D86	255	258		
60% Distill Point	°C	ASTM D86	267	272		
70% Distill Point	°C	ASTM D86	280	286		
80% Distill Point	°C	ASTM D86	295	301		
85% Distillation Point	°C	ASTM D86		312		
90% Distill Point	°C	ASTM D86	310	323		
95% Distillation Point	°C	ASTM D86		340		
Final Boiling Point	°C	ASTM D86	341	354		
IGNITION QUALIT	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36		
Cetane Index		ASTM D4737	<40.0	47		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	2		
Potassium	ppm	ASTM D5185m	<0.1	<1		
Water	%	ASTM D6304	<0.05	0.006		
ppm Water	ppm	ASTM D6304	<500	65		
% Gasoline	%	*In-House	<0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		




# **FUEL REPORT**

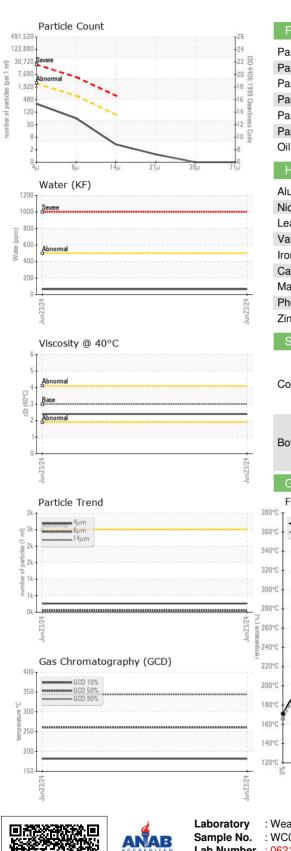

FLUID CLEANLI		method	limit/base	current	history1	history2
	NLOO					
Particles >4µm		ASTM D7647 ASTM D7647	>2500 >640	264 53		
Particles >6µm		ASTM D7647 ASTM D7647	>640 >80	3		
Particles >14µm Particles >21µm		ASTM D7647 ASTM D7647		3 1		
Particles >38µm		ASTM D7647 ASTM D7647	>20	0		
Particles >71µm		ASTM D7647 ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>18/16/13	0 15/13/9		
HEAVY METALS	3	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0		
Nickel	ppm	ASTM D5185m	<0.1	0		
Lead	ppm	ASTM D5185m	<0.1	0		
Vanadium	ppm	ASTM D5185m	<0.1	0		
Iron	ppm	ASTM D5185m	<0.1	0		
Calcium	ppm	ASTM D5185m	<0.1	0		
Magnesium	ppm	ASTM D5185m	<0.1	0		
Phosphorus	ppm	ASTM D5185m	<0.1	0		
Zinc	ppm	ASTM D5185m	<0.1	0		
SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image
GRAPHS						
Fuel Distillation C	urve		ے 80	Pensky-Marte	ns Flash Point (	°C)
Sample Sample			00 erature	•		
c -			/ Buber 60	Base		
			// <sup>#</sup> 50			2
C		1		Jun23/24		100 CC
		1.00		⊰ GCD Spectrun	2	-
C		1	550	)_	ana ana anaka marang 18.1 parta sanaha ana ana mitan.	
	1	70 °	500		905	
	and the second s		450			
100			400 (ar 350			
			(b)			
1			8, 300			





: WearCheck USA - 501 Madison Ave., Cary, NC 27513 PETROLEUM RECOVERY SERVICES : WC0957796 Received : 24 Jun 2024 210 POWELL DR Lab Number : 06218718 Tested : 27 Jun 2024 SUMMERVILLE, SC : 27 Jun 2024 - Elizabeth Valachovic Unique Number : 11096915 Diagnosed US 29483 Test Package : DF-2 (Additional Tests: Fuel, Screen) Contact: AJAY EL Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. Ajay@prsfuel.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (843)225-1777 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

10%

20%

30%

Report Id: PETSUM [WUSCAR] 06218718 (Generated: 06/29/2024 19:20:39) Rev: 1

Contact/Location: AJAY EL - PETSUM

F: