



FUEL REPORT

Sample Rating Trend



NORMAL



Area
ASCENT LLC FIS LITTLE ROCK AR [17918]
 Machine Id
[ASCENT LLC FIS LITTLE ROCK AR] LRDC 1
 Component
Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (1000 GAL)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0957800	---	---
Sample Date	Client Info		23 Jun 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Sample Status			NORMAL	---	---

PHYSICAL PROPERTIES

	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Yellow	Red	---
ASTM Color	scalar	*ASTM D1500		L4.0	---
Visc @ 40°C	cSt	ASTM D445	3.0	2.3	---
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	63.9	---

SULFUR CONTENT

	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0	---
Sulfur (UVF)	ppm	ASTM D5453		10	---

DISTILLATION

	method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	176	---
5% Distillation Point	°C	ASTM D86		192	---
10% Distill Point	°C	ASTM D86	201	200	---
15% Distillation Point	°C	ASTM D86		207	---
20% Distill Point	°C	ASTM D86	216	214	---
30% Distill Point	°C	ASTM D86	230	228	---
40% Distill Point	°C	ASTM D86	243	242	---
50% Distill Point	°C	ASTM D86	255	255	---
60% Distill Point	°C	ASTM D86	267	270	---
70% Distill Point	°C	ASTM D86	280	285	---
80% Distill Point	°C	ASTM D86	295	303	---
85% Distillation Point	°C	ASTM D86		314	---
90% Distill Point	°C	ASTM D86	310	326	---
95% Distillation Point	°C	ASTM D86		346	---
Final Boiling Point	°C	ASTM D86	341	361	---

IGNITION QUALITY






	method	limit/base	current	history1	history2
API Gravity	ASTM D7777	37.7	38	---	---
Cetane Index	ASTM D4737	<40.0	51	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	---
Sodium	ppm	ASTM D5185m	<0.1	1	---
Potassium	ppm	ASTM D5185m	<0.1	<1	---
Water	%	ASTM D6304	<0.05	0.006	---
ppm Water	ppm	ASTM D6304	<500	63	---
% Gasoline	%	*In-House	<0.50	0.0	---
% Biodiesel	%	*In-House	<20.0	0.0	---



FUEL REPORT

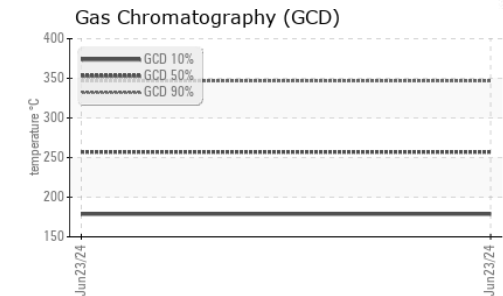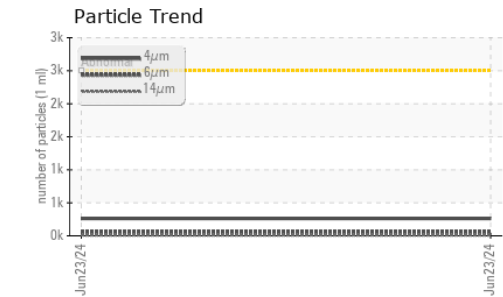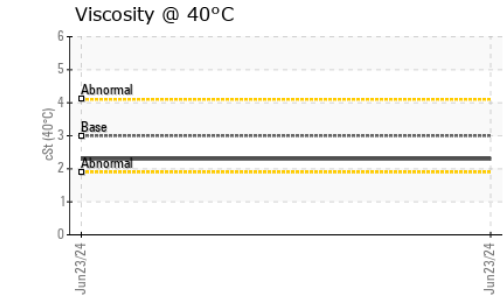
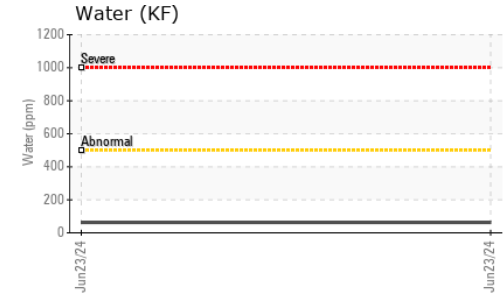
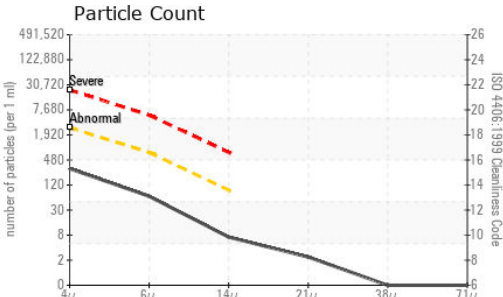


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	262	---	---
Particles >6µm	ASTM D7647	>640	57	---	---
Particles >14µm	ASTM D7647	>80	6	---	---
Particles >21µm	ASTM D7647	>20	2	---	---
Particles >38µm	ASTM D7647	>4	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	15/13/10	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	---	---
Nickel	ppm	ASTM D5185m <0.1	0	---	---
Lead	ppm	ASTM D5185m <0.1	0	---	---
Vanadium	ppm	ASTM D5185m <0.1	0	---	---
Iron	ppm	ASTM D5185m <0.1	0	---	---
Calcium	ppm	ASTM D5185m <0.1	0	---	---
Magnesium	ppm	ASTM D5185m <0.1	0	---	---
Phosphorus	ppm	ASTM D5185m <0.1	0	---	---
Zinc	ppm	ASTM D5185m <0.1	0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

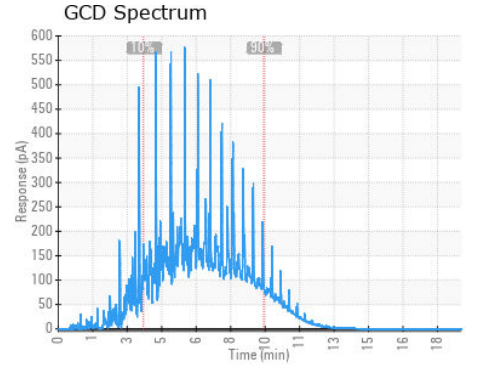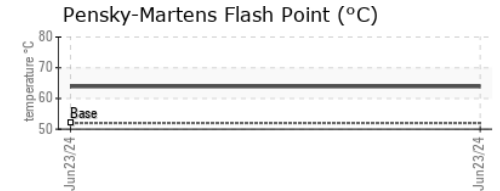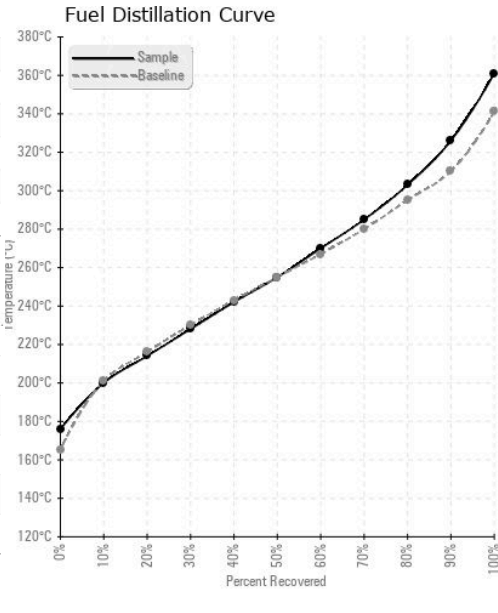

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0957800 **Received** : 24 Jun 2024
Lab Number : **06218723** **Tested** : 26 Jun 2024
Unique Number : 11096920 **Diagnosed** : 26 Jun 2024 - Elizabeth Valachovic
Test Package : DF-2 (Additional Tests: Fuel, Screen)

PETROLEUM RECOVERY SERVICES
 210 POWELL DR
 SUMMERVILLE, SC
 US 29483
 Contact: AJAY EL
 Ajay@prsfuel.com
 T: (843)225-1777
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)