


FUEL REPORT

Carilion Giles Community Hospital [17642] [Carilion Giles Community Hospital] DAY TANK 2

Diesel Fuel

No.2 DIESEL FUEL (ULTRALOW SULPHUR)





DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

) (200 GAL)			Mar2024	Jun2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0957805	WC06139438	
Sample Date		Client Info		23 Jun 2024	22 Mar 2024	
Machine Age	hrs	Client Info		0	0	
Sample Status				NORMAL	ATTENTION	
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
uel Color	text	*Visual Screen	Yllow	Red	Red	
ASTM Color	scalar	*ASTM D1500		L5.0	L4.5	
/isc @ 40°C	cSt	ASTM D445	3.0	2.46	2.45	
ensky-Martens Flash Point	°C	*PMCC Calculated	52	61.4	61.9	
SULFUR CONTER	VT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	4	0	
Sulfur (UVF)	ppm	ASTM D5453		14	15	
DISTILLATION		method	limit/base	current	history1	history2
nitial Boiling Point	°C	ASTM D86	165	172	173	
% Distillation Point	°C	ASTM D86		195	195	
0% Distill Point	°C	ASTM D86	201	205	205	
5% Distillation Point	°C	ASTM D86		213	213	
20% Distill Point	°C	ASTM D86	216	221	221	
0% Distill Point	°C	ASTM D86	230	235	236	
10% Distill Point	°C	ASTM D86	243	249	249	
60% Distill Point	°C	ASTM D86	255	262	262	
60% Distill Point	°C	ASTM D86	267	276	276	
70% Distill Point	°C	ASTM D86	280	291	290	
80% Distill Point	°C	ASTM D86	295	307	306	
5% Distillation Point	°C	ASTM D86		317	317	
00% Distill Point	°C	ASTM D86	310	328	327	
15% Distillation Point	°C	ASTM D86	310	344	343	
Final Boiling Point	°C	ASTM D86	341	357	357	
IGNITION QUALIT	ΓΥ	method	limit/base	current	history1	history2
PI Gravity		ASTM D7777	37.7	36	36	
Cetane Index		ASTM D4737	<40.0	48	48	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	0	
Sodium	ppm	ASTM D5185m	<0.1	2	<1	
otassium	ppm	ASTM D5185m	<0.1	1	0	
Vater	%	ASTM D6304	< 0.05	0.003	0.002	
pm Water	ppm	ASTM D6304	<500	38	16	
6 Gasoline	%	*In-House	< 0.50	0.0	0.0	
/ Pindingal	0/	*In I louge	-20.0	1.0	1.0	

*In-House <20.0


1.3

% Biodiesel

1.2



FUEL REPORT

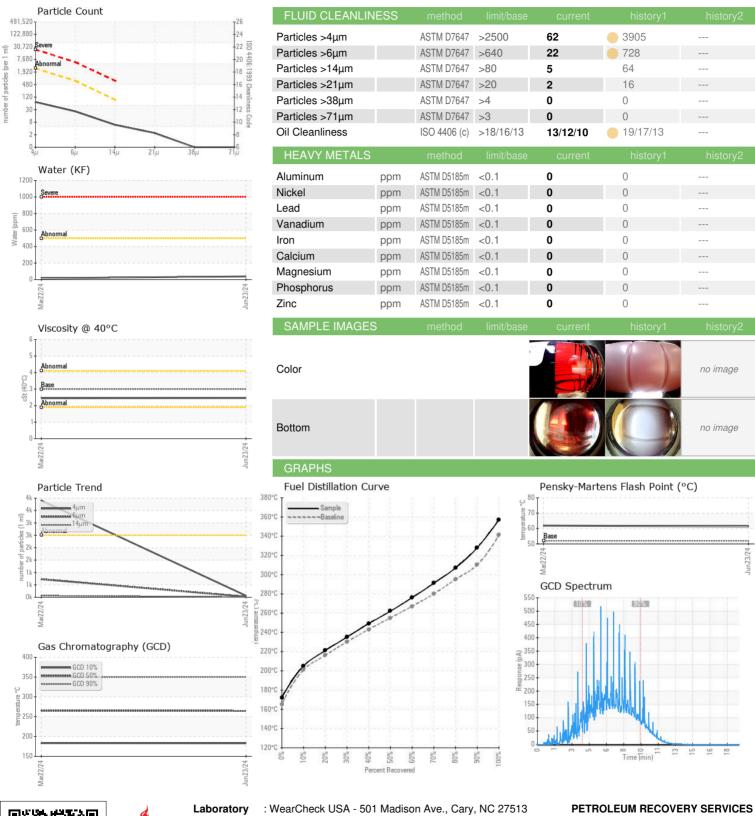





Certificate 12367

Sample No.

Lab Number

: WC0957805 : 06218729

Received **Tested** Unique Number : 11096926 Diagnosed

: 27 Jun 2024 : 27 Jun 2024 - Elizabeth Valachovic

: 24 Jun 2024

Test Package : DF-2 (Additional Tests: Fuel, Screen) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

210 POWELL DR

SUMMERVILLE, SC US 29483 Contact: AJAY EL

Ajay@prsfuel.com T: (843)225-1777

Contact/Location: AJAY EL - PETSUM