




OIL ANALYSIS REPORT

Sample Rating Trend

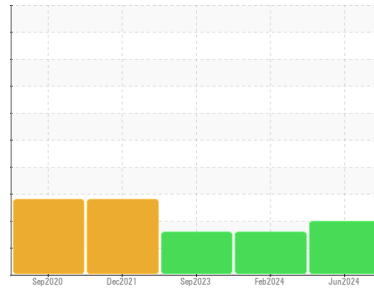

WATER



Machine Id
KAESER 7376028

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA018832	KCP53895	KCPA006424
Sample Date	Client Info			19 Jun 2024	07 Feb 2024	20 Sep 2023
Machine Age	hrs	Client Info		33054	29933	28482
Oil Age	hrs	Client Info		3121	4685	0
Oil Changed	Client Info			Not Chngd	Changed	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	<1	0
Titanium	ppm	ASTM D5185m	>3	<1	<1	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	2	0
Lead	ppm	ASTM D5185m	>10	<1	<1	0
Copper	ppm	ASTM D5185m	>50	4	1	13
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	<1	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	23	83	0
Molybdenum	ppm	ASTM D5185m		<1	<1	<1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	90	47	84	12
Calcium	ppm	ASTM D5185m	2	0	3	1
Phosphorus	ppm	ASTM D5185m		3	21	3
Zinc	ppm	ASTM D5185m		13	0	13
Sulfur	ppm	ASTM D5185m		22053	20579	21293

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	0	<1
Sodium	ppm	ASTM D5185m		6	0	5
Potassium	ppm	ASTM D5185m	>20	2	1	1
Water	%	ASTM D6304	>0.05	▲ 0.144	0.018	▲ 0.198
ppm Water	ppm	ASTM D6304	>500	▲ 1440	187	▲ 1980

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	8988	---
Particles >6µm		ASTM D7647	>1300	---	▲ 2312	---
Particles >14µm		ASTM D7647	>80	---	▲ 230	---
Particles >21µm		ASTM D7647	>20	---	▲ 59	---
Particles >38µm		ASTM D7647	>4	---	3	---
Particles >71µm		ASTM D7647	>3	---	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	▲ 20/18/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.37	0.25


OIL ANALYSIS REPORT

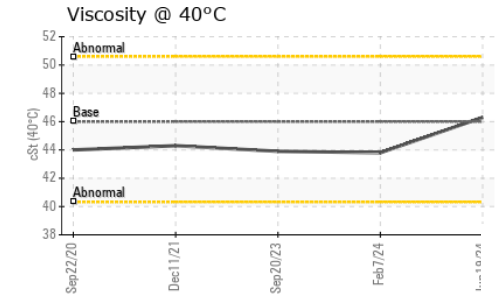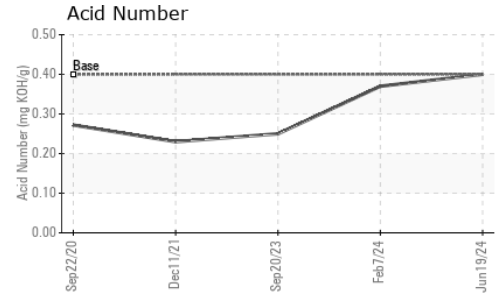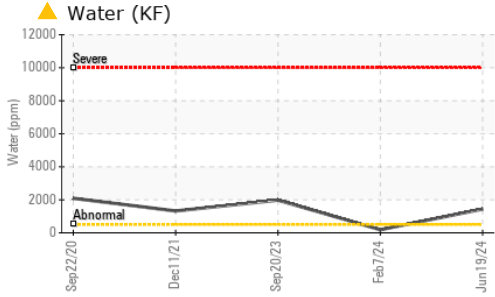





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.3	43.8	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

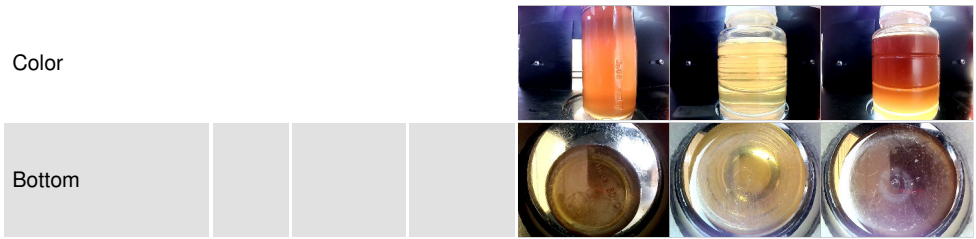

GRAPHS

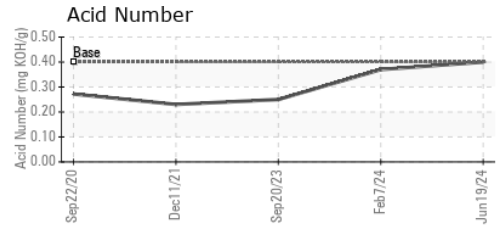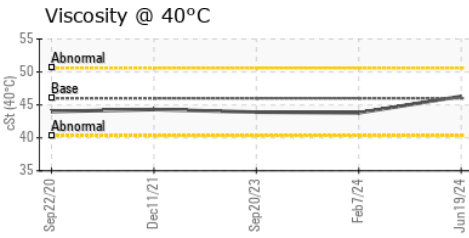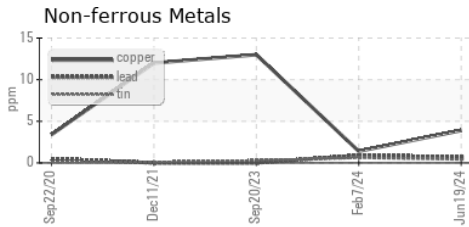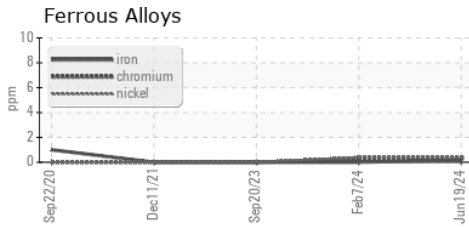

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA018832 **Received** : 24 Jun 2024
Lab Number : 06218776 **Tested** : 27 Jun 2024
Unique Number : 11096973 **Diagnosed** : 27 Jun 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MENASHA PACKAGING
 2255 BROOKS AVE
 NEENAH, WI
 US 54956
 Contact: Service Manager
 SERVICE@NORTHERNCOMPRESSOR.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)