

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

8561341 (S/N 1479) Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		L		Jun 2024		
SAMPLE INFORM	/ATION	method	limit/base	current	history1	history2
	ni/ (TTOTA		IIIIIIIIIII			
Sample Number		Client Info		KCPA019197		
Sample Date	la con	Client Info		18 Jun 2024		
Machine Age	hrs	Client Info		1025		
Oil Age	hrs	Client Info		1025		
Oil Changed		Client inio		Changed NORMAL		
Sample Status				NORWAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	4		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	37		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		3		
Zinc	ppm	ASTM D5185m		8		
Sulfur	ppm	ASTM D5185m		19200		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	10		
Water	%	ASTM D6304	>0.05	0.021		
ppm Water	ppm	ASTM D6304	>500	213		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1400		
Particles >6µm		ASTM D7647	>1300	437		
Particles >14µm		ASTM D7647	>80	31		
Particles >21µm		ASTM D7647	>20	6		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Asid Number (ANI)	I/OLI/-	ACTM DODAE	0.4	0.00		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.29



OIL ANALYSIS REPORT

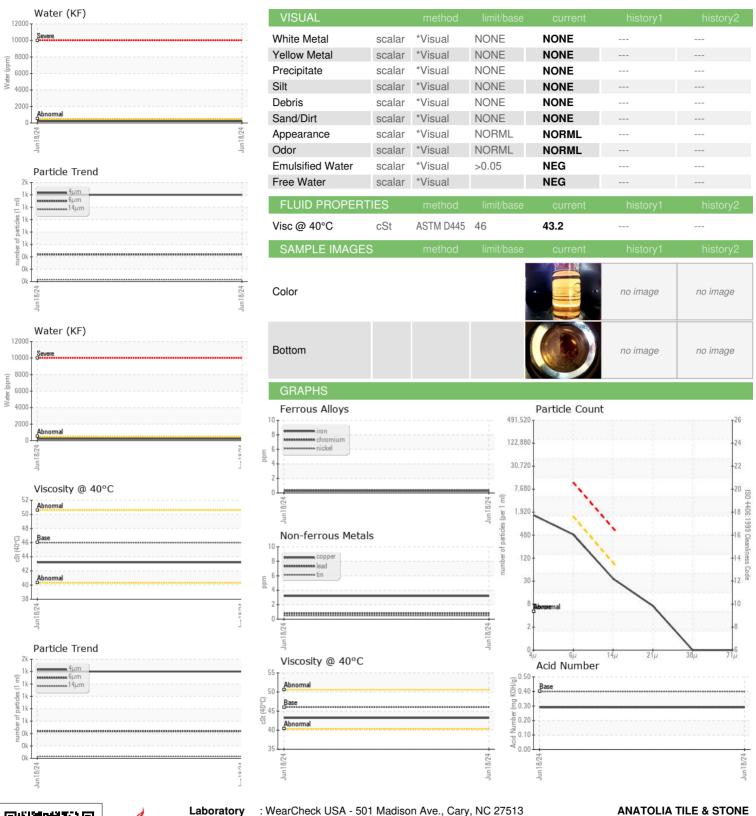



Certificate 12367

Laboratory Sample No.

: KCPA019197 Lab Number : 06218778

Unique Number : 11096975 Test Package : IND 2 (Additional Tests: KF, PrtCount)

Received **Tested**

: 24 Jun 2024 : 25 Jun 2024 Diagnosed

: 26 Jun 2024 - Jonathan Hester

US 31407 Contact: STEVEN MILLER steven.miller@anatoliatile.com T:

250 INTERNATIONAL TRADE PKWY

PORT WENTWORTH, GA

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: