



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
8438985 (S/N 2265)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KC129766	KCPA010040	KC111614
Sample Date	Client Info		14 Jun 2024	28 Nov 2023	03 May 2023
Machine Age	hrs	Client Info	13880	9184	4168
Oil Age	hrs	Client Info	4696	0	4168
Oil Changed	Client Info		Not Chngd	N/A	Not Chngd
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	3	0	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	5	12	5
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	22	0	35
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 90	51	8	61
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	4	1	1
Zinc	ppm	ASTM D5185m	6	2	0

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	10	2	10
Potassium	ppm	ASTM D5185m >20	5	2	5
Water	%	ASTM D6304 >0.05	0.022	0.006	0.025
ppm Water	ppm	ASTM D6304 >500	220	69	259.6

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5425	36382	5884
Particles >6µm	ASTM D7647 >1300		▲ 2076	▲ 17490	▲ 2530
Particles >14µm	ASTM D7647 >80		▲ 261	▲ 853	▲ 147
Particles >21µm	ASTM D7647 >20		▲ 58	▲ 152	▲ 23
Particles >38µm	ASTM D7647 >4		3	2	3
Particles >71µm	ASTM D7647 >3		2	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 20/18/15	▲ 22/21/17	▲ 20/19/14

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.30	0.35


OIL ANALYSIS REPORT

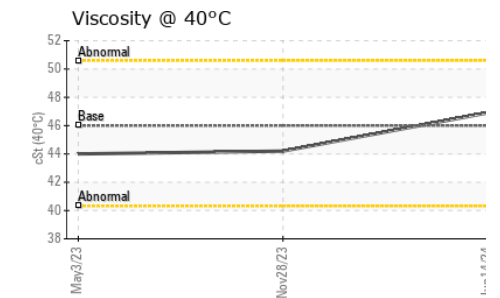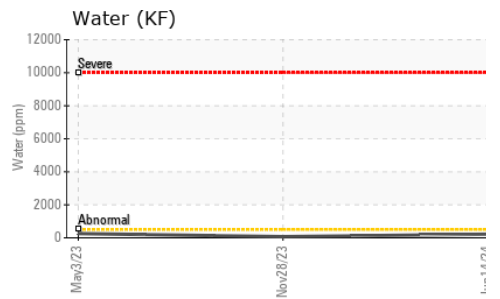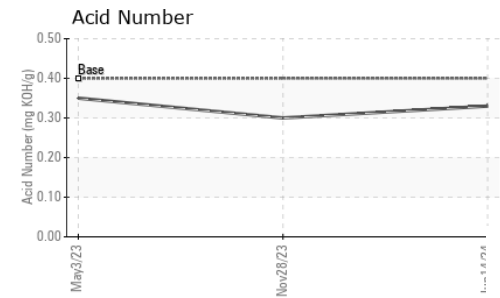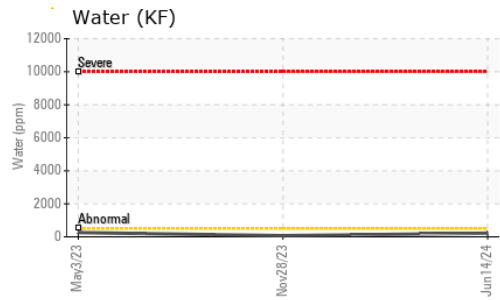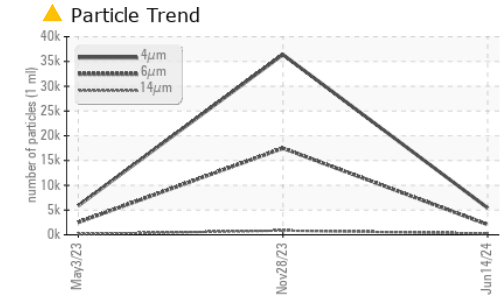





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.9	44.2	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

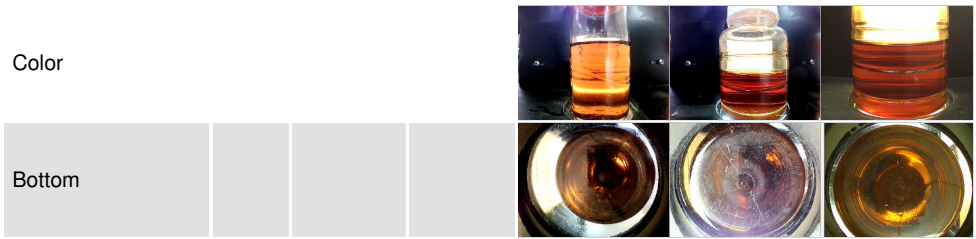

GRAPHS

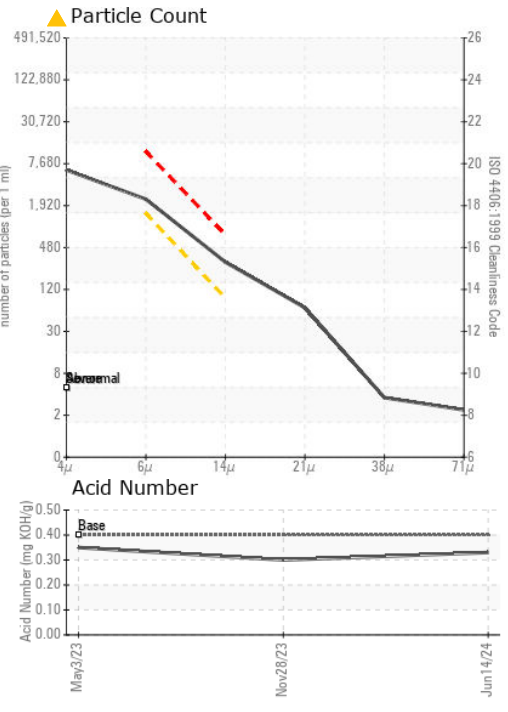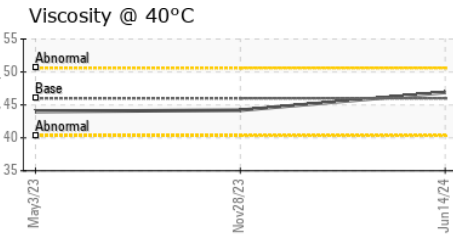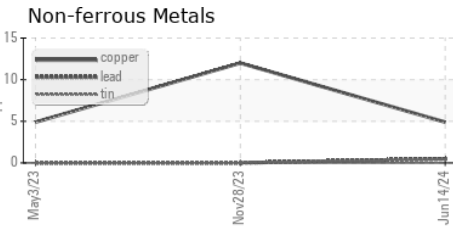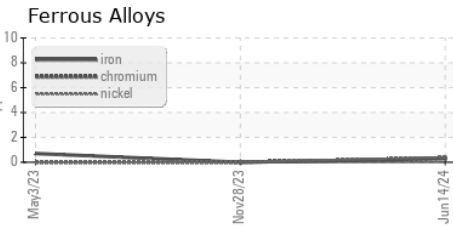

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC129766
Lab Number : 06218785
Unique Number : 11096982
Test Package : IND 2
Received : 24 Jun 2024
Tested : 26 Jun 2024
Diagnosed : 26 Jun 2024 - Jonathan Hester

BHE GT&S LLC
 2100 COVE POINT RD
 LUSBY, MD
 US 20657
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)