


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER 8412321

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Ν		

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Oct	2023	Feb 2024 Jun 20.	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017701	KCPA015159	KCPA007166
Sample Date		Client Info		13 Jun 2024	28 Feb 2024	25 Oct 2023
Machine Age	hrs	Client Info		2365	1895	1001
Oil Age	hrs	Client Info		470	900	0
Oil Changed		Client Info		Changed	Changed	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	2	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	74	68	53
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	77	81	59
Calcium	ppm	ASTM D5185m	2	0	7	0
Phosphorus	ppm	ASTM D5185m		2	0	1
Zinc	ppm	ASTM D5185m		3	2	4
Sulfur	ppm	ASTM D5185m		20908	20423	17738
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	<1
Sodium	ppm	ASTM D5185m		12	14	10
Potassium	ppm	ASTM D5185m	>20	5	6	5
Water	%	ASTM D6304	>0.05	0.024	0.025	△ 0.072
ppm Water	ppm	ASTM D6304	>500	244	253	△ 720.5
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1680	1717	47789
Particles >6µm		ASTM D7647	>1300	500	251	<u>^</u> 23084
Particles >14µm		ASTM D7647	>80	35	18	△ 3155
Particles >21µm		ASTM D7647	>20	8	4	<u>482</u>
Particles >38µm		ASTM D7647	>4	0	0	1
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	18/15/11	<u>\$\text{23}/22/19}</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.34	0.32



OIL ANALYSIS REPORT

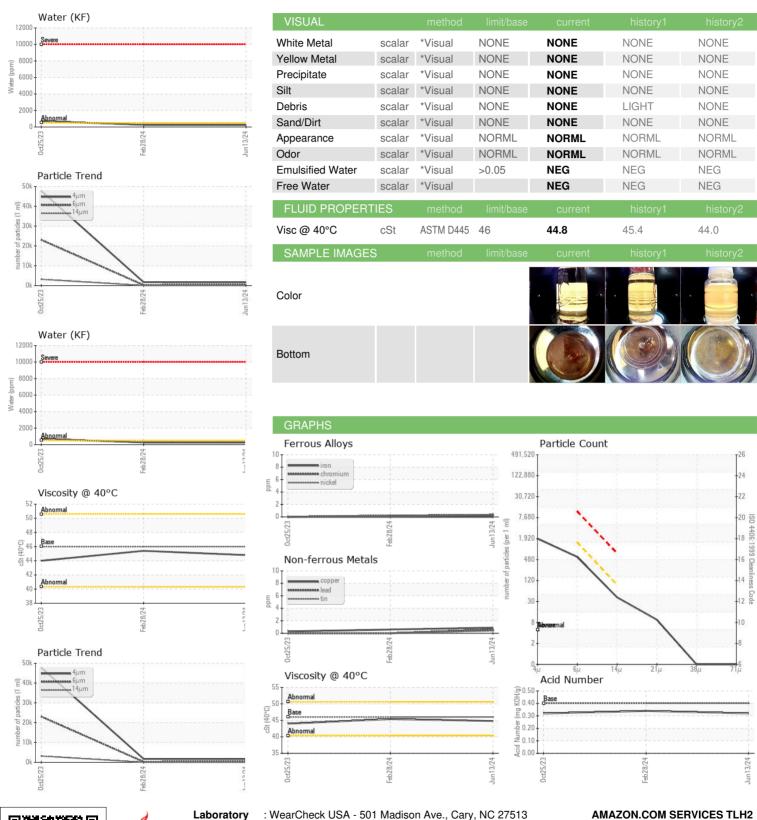





Certificate 12367

Laboratory Sample No. Lab Number

: 06218787 Unique Number : 11096984

: KCPA017701

Received : 24 Jun 2024 **Tested** Diagnosed

: 26 Jun 2024

: 26 Jun 2024 - Jonathan Hester Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

TALLAHASSEE, FL US 32308

Contact: KAY CEHAR KAYCEHAR@AMAZON.COM

2635 VINELAND DR

T: F: