




# OIL ANALYSIS REPORT

## Sample Rating Trend

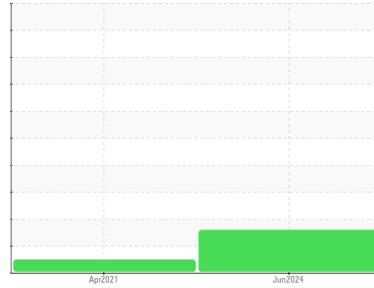

ISO



Machine Id  
**6785196 (S/N 1161)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA017641</b>	KCP35958	---
Sample Date	Client Info			<b>17 Jun 2024</b>	13 Apr 2021	---
Machine Age	hrs	Client Info		<b>956</b>	228	---
Oil Age	hrs	Client Info		<b>956</b>	228	---
Oil Changed	Client Info			<b>Changed</b>	Changed	---
Sample Status				<b>ABNORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>1</b>	1	---
Copper	ppm	ASTM D5185m	>50	<b>3</b>	1	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Antimony	ppm	ASTM D5185m		<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	10	---
Barium	ppm	ASTM D5185m	90	<b>3</b>	10	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>60</b>	71	---
Calcium	ppm	ASTM D5185m	2	<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m		<b>4</b>	10	---
Zinc	ppm	ASTM D5185m		<b>10</b>	2	---
Sulfur	ppm	ASTM D5185m		<b>21354</b>	17616	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m		<b>11</b>	9	---
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	1	---
Water	%	ASTM D6304	>0.05	<b>0.020</b>	0.034	---
ppm Water	ppm	ASTM D6304	>500	<b>205</b>	341.9	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>19812</b>	5221	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 6604</b>	1109	---
Particles >14µm		ASTM D7647	>80	<b>▲ 223</b>	41	---
Particles >21µm		ASTM D7647	>20	<b>▲ 27</b>	10	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 21/20/15</b>	17/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.37</b>	0.333	---


# OIL ANALYSIS REPORT

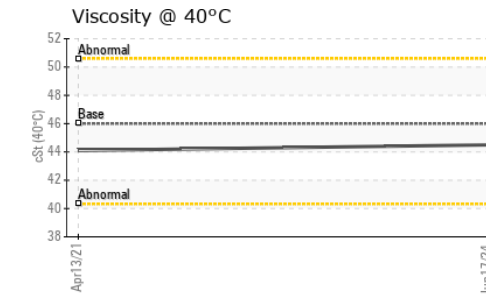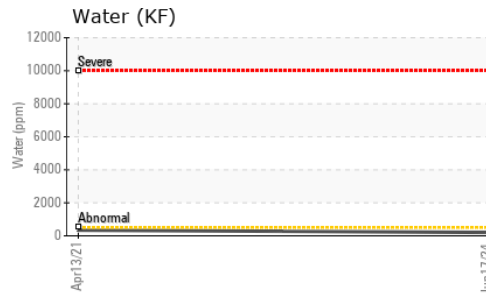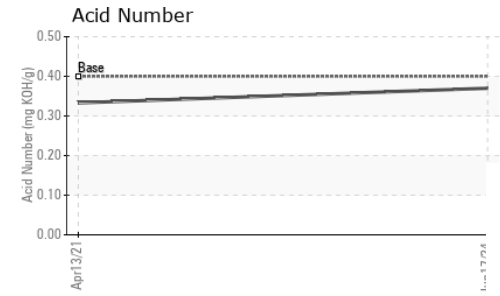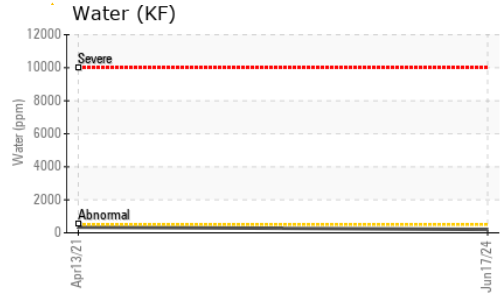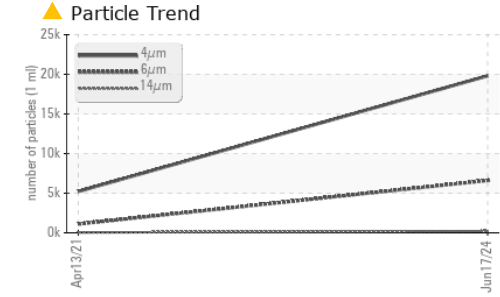





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.5	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

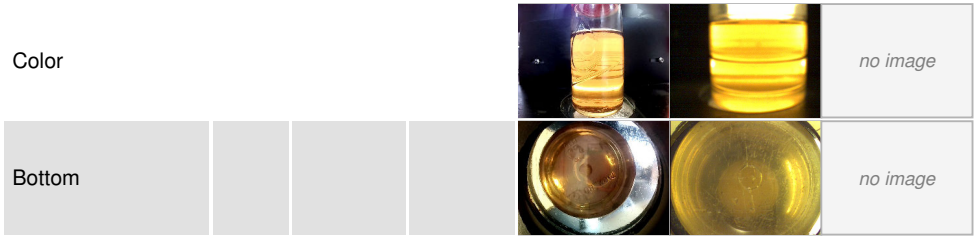

## GRAPHS

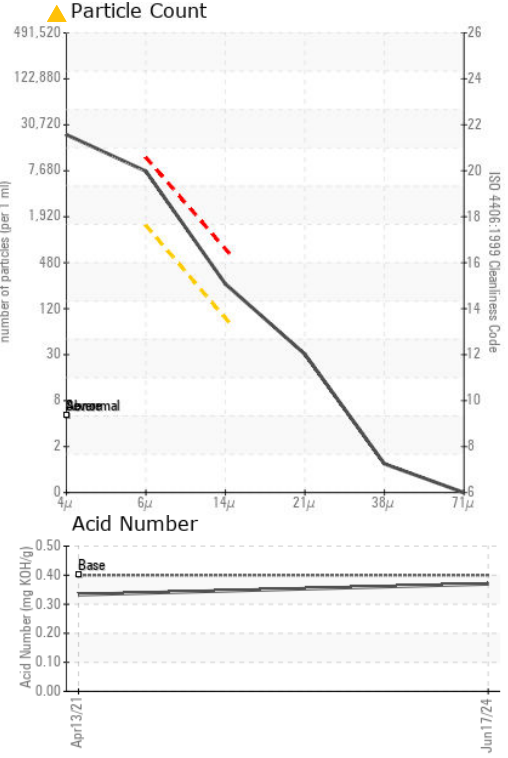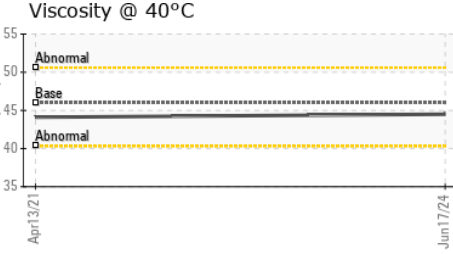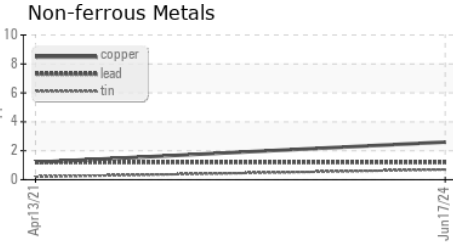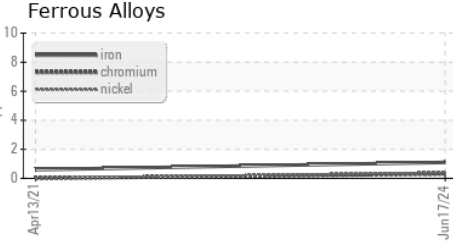

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA017641  
**Lab Number** : 06218790  
**Unique Number** : 11096987  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 24 Jun 2024  
**Tested** : 26 Jun 2024  
**Diagnosed** : 26 Jun 2024 - Jonathan Hester

**BAMA MILL SERVICES**  
 9100 ENERGY LN  
 NORTHPORT, AL  
 US 35476  
 Contact: ADAM  
 adam@bamamillservices.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)