


# **OIL ANALYSIS REPORT**

Sample Rating Trend







Machine Id

# **KAESER 8434959**

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Oct	2023	Feb2024 Jun202	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
	MATION		IIIIIIIIIIII			
Sample Number		Client Info		KCPA017702	KCPA15162	KCP007174
Sample Date	la una	Client Info		13 Jun 2024	28 Feb 2024	25 Oct 2023
Machine Age	hrs	Client Info		1396	1053	1003
Oil Age	hrs	Client Info		350	950 Observed	
Oil Changed		Client Info		Changed NORMAL	Changed	N/A
Sample Status					NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	2	0
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	79	75	17
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	76	83	74
Calcium	ppm	ASTM D5185m	2	0	8	2
Phosphorus	ppm	ASTM D5185m		15	<1	1
Zinc	ppm	ASTM D5185m		5	2	0
Sulfur	ppm	ASTM D5185m		20230	19979	17723
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	1
Sodium	ppm	ASTM D5185m		8	7	13
Potassium	ppm	ASTM D5185m	>20	4	4	7
Water	%	ASTM D6304	>0.05	0.023	0.020	0.025
ppm Water	ppm	ASTM D6304	>500	239	207	257.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		393	546	1873
Particles >6µm		ASTM D7647	>1300	127	148	501
Particles >14µm		ASTM D7647	>80	13	13	35
Particles >21µm		ASTM D7647	>20	4	2	8
Particles >38µm		ASTM D7647	>4	0	0	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/14/11	16/14/11	18/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A -! -! Ni (ANI)		AOTA DOO45	0.4	0.27	0.04	0.05

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.34

0.37

0.35



### **OIL ANALYSIS REPORT**

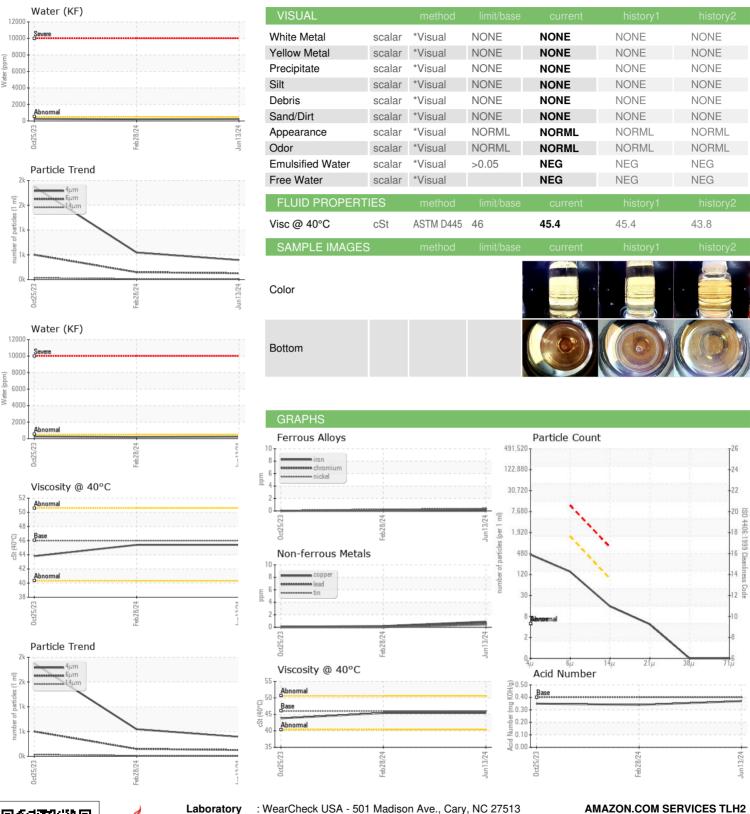





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA017702 : 06218802 Unique Number: 11096999

Received **Tested** Diagnosed

: 26 Jun 2024 - Doug Bogart Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 24 Jun 2024

: 26 Jun 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**AMAZON.COM SERVICES TLH2** 

2635 VINELAND DR TALLAHASSEE, FL US 32308

Contact: KAY CEHAR KAYCEHAR@AMAZON.COM

T:

F: