


# **OIL ANALYSIS REPORT**

Sample Rating Trend

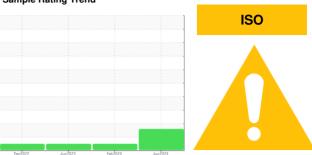

Machine Id

# 8291218 (S/N 1031)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec202	2 Jun2023	Feb2024 Ju	n2024	`
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018428	KCPA010238	KCPA003302
Sample Date		Client Info		11 Jun 2024	01 Feb 2024	12 Jun 2023
Machine Age	hrs	Client Info		11598	8853	5744
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	<1	0
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	2	1	2
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	18	0	10
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m	0	<1	0	0
Magnesium	ppm	ASTM D5185m	100	62	38	54
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	0	1
Zinc	ppm	ASTM D5185m	0	8	11	10
Sulfur	ppm	ASTM D5185m	23500	21365	18205	22222
CONTAMINANTS		method	limit/base		history1	
				current	,	history2
Silicon	ppm	ASTM D5185m	>25	3	0	0
Sodium	ppm	ASTM D5185m		13	12	10
Potassium	ppm	ASTM D5185m	>20	4	<1	2
Water	%	ASTM D6304	>0.05	0.019	0.025	0.025
ppm Water	ppm	ASTM D6304	>500	197	254	251.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6545	1143	1162
Particles >6µm		ASTM D7647	>1300	<u>2231</u>	264	294
Particles >14μm		ASTM D7647	>80	<u> </u>	27	29
Particles >21µm		ASTM D7647	>20	<b>9</b> 38	8	9
Particles >38μm		ASTM D7647	>4	2	0	1
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/15	17/15/12	17/15/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.46	0.37	0.43



## **OIL ANALYSIS REPORT**







Certificate 12367

Laboratory Sample No.

: KCPA018428 Lab Number : 06218803 Unique Number : 11097000

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 24 Jun 2024 **Tested** : 26 Jun 2024 Diagnosed : 26 Jun 2024 - Doug Bogart

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**GROUP MFG SERVICE INC** 

1928 HARTOG DR SAN JOSE, CA US 95131

Contact: Service Manager dpmcoach33@yahoo.com

F:

T: