




# OIL ANALYSIS REPORT

Sample Rating Trend

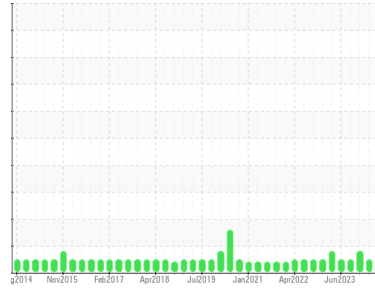

**NORMAL**



Machine Id  
**FRICK FRICK RWB II-76H COMPRESSOR 1 (S/N S0566RFMPLHAA03)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI ALT-68 SC (55 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USP0013071</b>	USP0006090	USP0004543
Sample Date	Client Info			<b>19 Jun 2024</b>	17 Mar 2024	28 Dec 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>8	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>4	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	1
Calcium	ppm	ASTM D5185m		<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	1
Zinc	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Sulfur	ppm	ASTM D5185m	50	<b>0</b>	0	4






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	1
Water	%	ASTM D6304	>0.01	<b>0.003</b>	0.002	0.003
ppm Water	ppm	ASTM D6304	>100	<b>30</b>	25	31

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1246</b>	5399	10539
Particles >6µm		ASTM D7647	>2500	<b>249</b>	1416	2862
Particles >14µm		ASTM D7647	>320	<b>7</b>	50	115
Particles >21µm		ASTM D7647	>80	<b>2</b>	10	18
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/18/15	<b>17/15/10</b>	20/18/13	21/19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	<b>0.014</b>	0.013	0.014



# OIL ANALYSIS REPORT

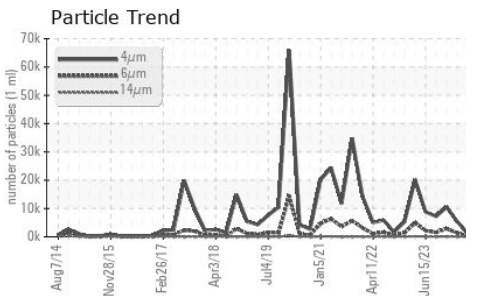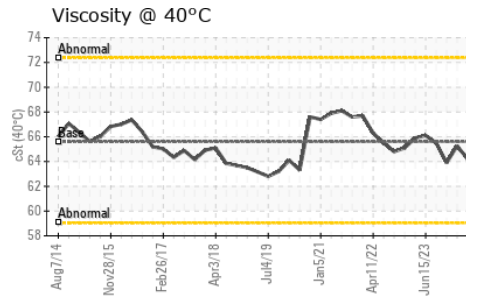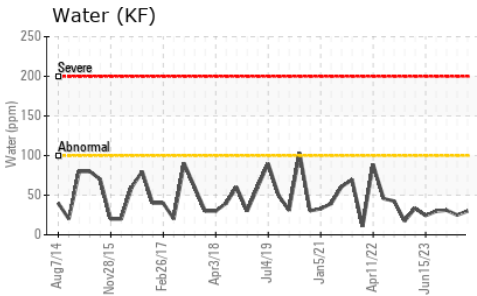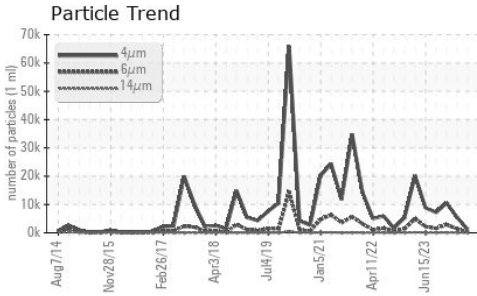
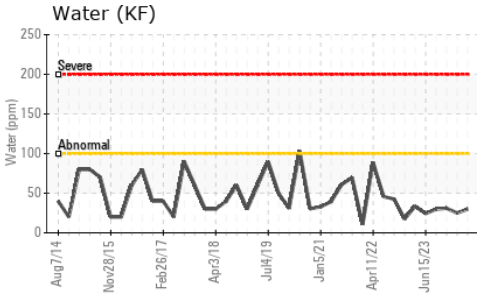


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG






FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	64.2	65.26

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

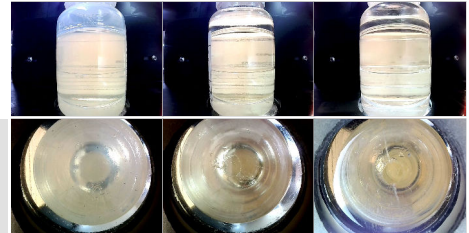

## GRAPHS

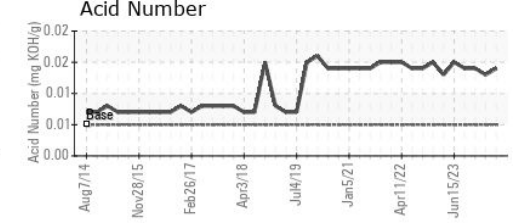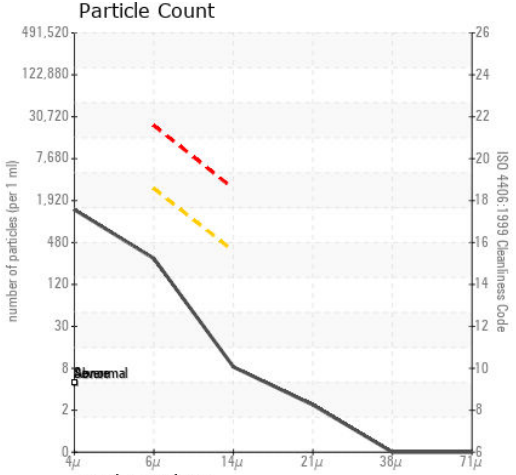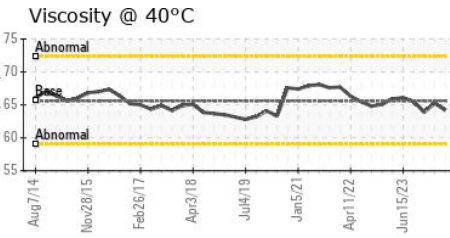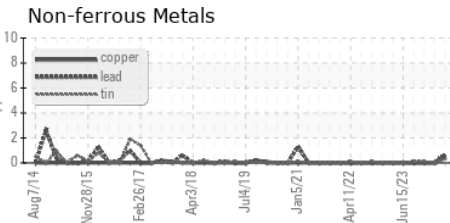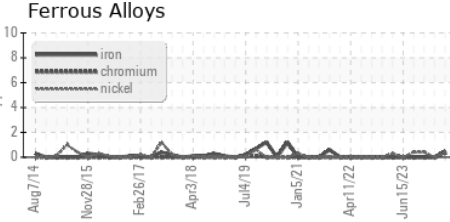

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USP0013071  
 Lab Number : 06218815  
 Unique Number : 11097012  
 Test Package : IND 2

Received : 24 Jun 2024  
 Tested : 26 Jun 2024  
 Diagnosed : 26 Jun 2024 - Doug Bogart

**TYSON PF-HUTCHINSON-USP**  
 521 SOUTH MAIN  
 HUTCHINSON, KS  
 US 67501  
 Contact: ERIC JOHNSON

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (620)669-8761

F: (620)669-8762