




# OIL ANALYSIS REPORT

## Sample Rating Trend

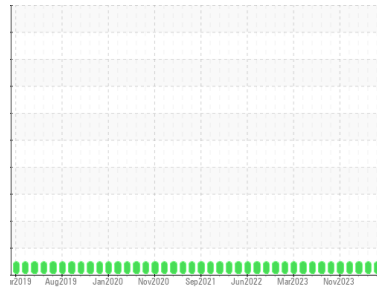

**NORMAL**



Area  
**Turbines and Generators**  
 Machine Id  
**GT 0701 GT 0701**  
 Component  
**Turbine**  
 Fluid  
**MOBIL JET OIL II (--- GAL)**

### DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>HLC0002890</b>	HLC0002927	HLC0002940
Sample Date	Client Info	<b>04 Jun 2024</b>	02 Apr 2024	02 Mar 2024
Machine Age	mths Client Info	<b>0</b>	0	0
Oil Age	mths Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >.1	<b>NEG</b>	NEG	NEG

### WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >15	<b>0</b>	<1	0
Chromium	ppm ASTM D5185m >4	<b>&lt;1</b>	<1	0
Nickel	ppm ASTM D5185m >2	<b>&lt;1</b>	<1	0
Titanium	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Silver	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Aluminum	ppm ASTM D5185m >10	<b>3</b>	1	0
Lead	ppm ASTM D5185m	<b>&lt;1</b>	1	0
Copper	ppm ASTM D5185m >5	<b>&lt;1</b>	<1	0
Tin	ppm ASTM D5185m >5	<b>&lt;1</b>	1	0
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm ASTM D5185m	<b>&lt;1</b>	1	0

### ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm ASTM D5185m	<b>0</b>	<1	0
Calcium	ppm ASTM D5185m	<b>0</b>	5	0
Phosphorus	ppm ASTM D5185m	<b>3151</b>	2815	2219
Zinc	ppm ASTM D5185m	<b>8</b>	5	0
Sulfur	ppm ASTM D5185m	<b>0</b>	0	0

### CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<b>4</b>	3	<1
Sodium	ppm ASTM D5185m	<b>0</b>	0	0
Potassium	ppm ASTM D5185m >20	<b>1</b>	<1	0

### FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>353</b>	329	229
Particles >6µm	ASTM D7647 >1300	<b>59</b>	87	55
Particles >14µm	ASTM D7647 >160	<b>5</b>	6	5
Particles >21µm	ASTM D7647 >40	<b>1</b>	1	1
Particles >38µm	ASTM D7647 >10	<b>0</b>	0	0
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/14	<b>16/13/10</b>	16/14/10	15/13/10

### FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.03	<b>0.073</b>	0.07	0.051

# OIL ANALYSIS REPORT


### Particle Trend

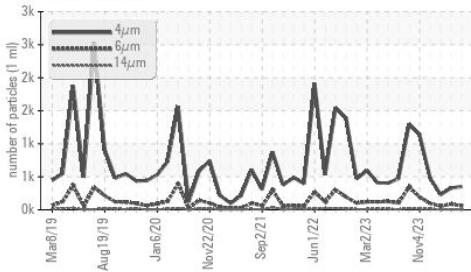


### Acid Number

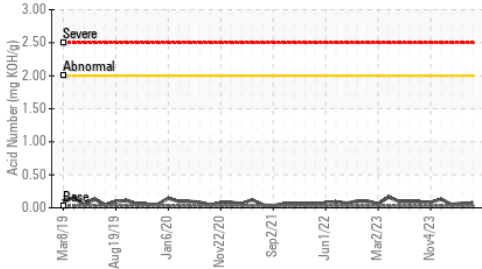

### Viscosity @ 40°C

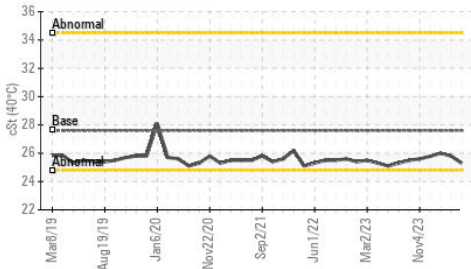


### Particle Trend

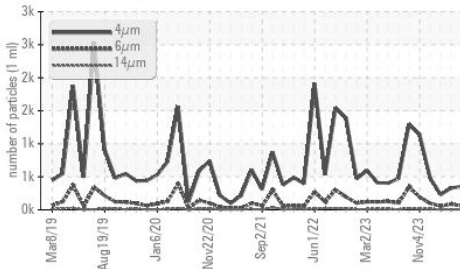





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	27.6	25.3	25.8	26.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

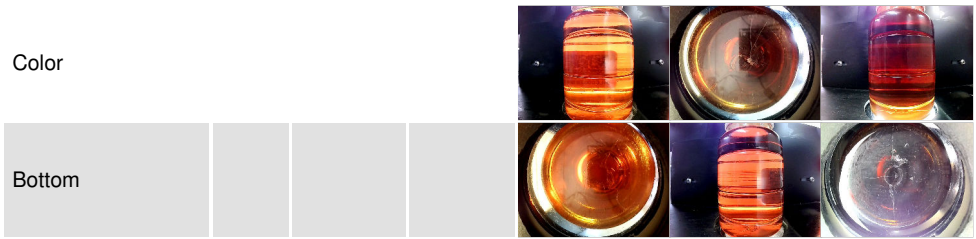

### GRAPHS

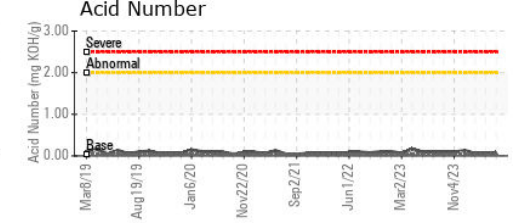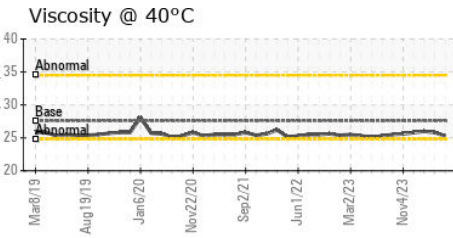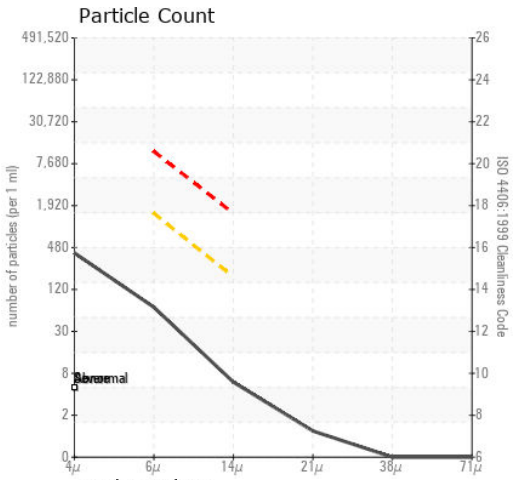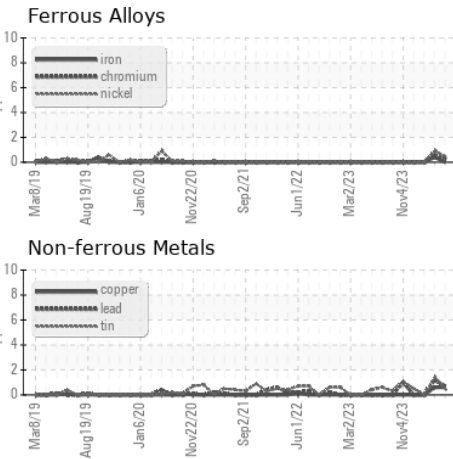

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0002890      **Received** : 24 Jun 2024  
**Lab Number** : 06218834      **Tested** : 27 Jun 2024  
**Unique Number** : 11097031      **Diagnosed** : 27 Jun 2024 - Jonathan Hester  
**Test Package** : IND 2

**HILCORP EXPLORATION ALASKA - MILNE POINT**  
 1000 MILNE POINT RD  
 PRUDOE BAY, AK  
 US 99734  
 Contact: Evan Reilly  
 evan.reilly@hilcorp.com  
 T: (907)670-3231  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)