




OIL ANALYSIS REPORT

Sample Rating Trend

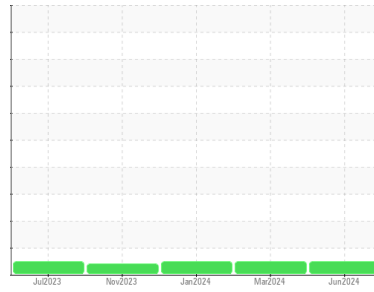

NORMAL



Machine Id

G29

Component

Diesel Engine

Fluid

DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0858199	WC0858126	WC0858185
Sample Date	Client Info		20 Jun 2024	04 Mar 2024	09 Jan 2024
Machine Age	hrs	Client Info	11391	10911	10708
Oil Age	hrs	Client Info	520	520	520
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	0.3	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	10	5	6
Chromium	ppm	ASTM D5185m >20	<1	<1	<1
Nickel	ppm	ASTM D5185m >4	0	0	0
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m >3	0	<1	0
Aluminum	ppm	ASTM D5185m >20	1	1	1
Lead	ppm	ASTM D5185m >40	<1	2	<1
Copper	ppm	ASTM D5185m >330	5	3	2
Tin	ppm	ASTM D5185m >15	0	1	<1
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	5	6	10
Barium	ppm	ASTM D5185m 10	0	0	0
Molybdenum	ppm	ASTM D5185m 100	62	57	59
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 450	926	943	905
Calcium	ppm	ASTM D5185m 3000	1162	1135	1044
Phosphorus	ppm	ASTM D5185m 1150	1020	1032	1079
Zinc	ppm	ASTM D5185m 1350	1261	1273	1235
Sulfur	ppm	ASTM D5185m 4250	3642	3962	3212

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	4	3	4
Sodium	ppm	ASTM D5185m >158	2	4	<1
Potassium	ppm	ASTM D5185m >20	3	9	<1

INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.4	0.2	0.2
Nitration	Abs/cm	*ASTM D7624 >20	8.3	6.4	6.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	19.8	18.0	18.7

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	15.6	13.9	14.6
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	8.7	8.9	8.5







OIL ANALYSIS REPORT

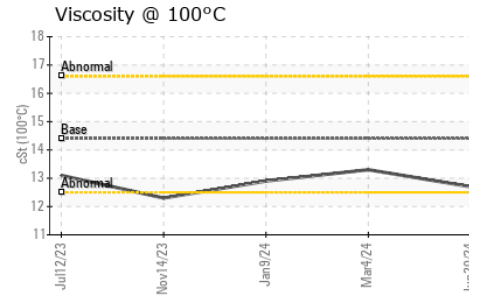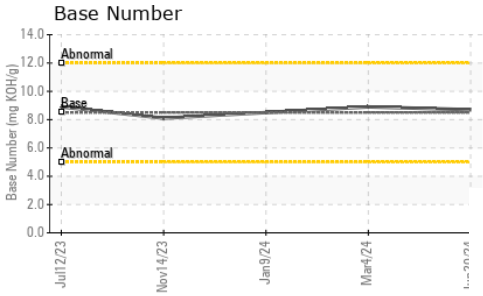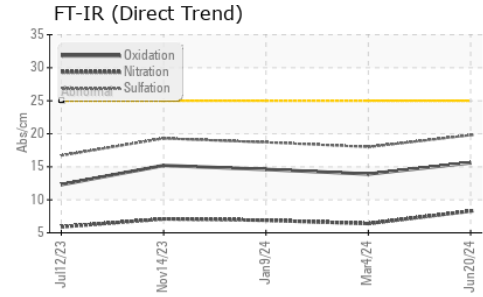

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	12.7	13.3

GRAPHS

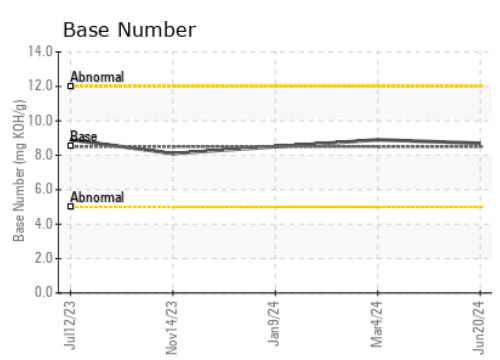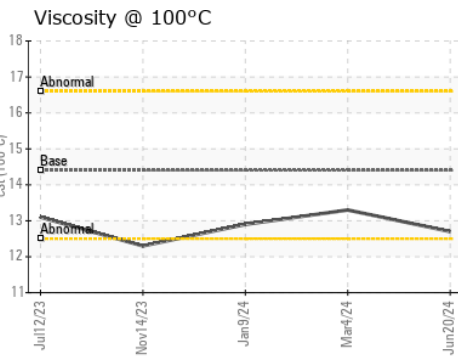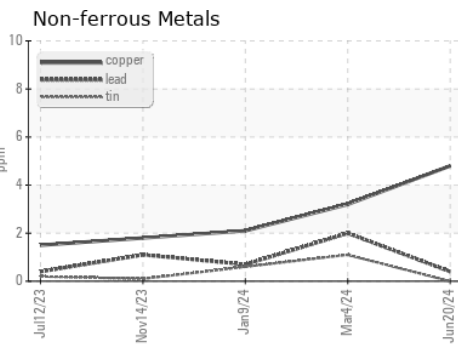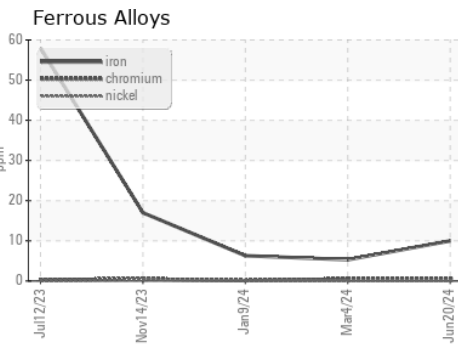

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0858199 **Received** : 24 Jun 2024
Lab Number : 06219079 **Tested** : 25 Jun 2024
Unique Number : 11097276 **Diagnosed** : 25 Jun 2024 - Wes Davis
Test Package : CONST (Additional Tests: TBN)

Apple Valley Waste - Hometown Location
 155 Airport Road
 Selinsgrove, PA
 US 17870
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: