


OIL ANALYSIS REPORT

Sample Rating Trend

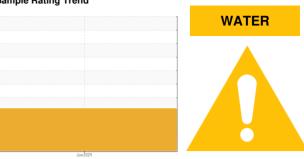

Machine Id

7713774 (S/N 1405)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. There is too much water present in this sample to perform a particle count. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. Free water present.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018237		
Sample Date		Client Info		11 Jun 2024		
Machine Age	hrs	Client Info		3517		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	9		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	2		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	19931		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	△ 0.238		
ppm Water	nnm	ASTM D6304	>500	2380		
ppin water	ppm	A3 1 W D0304	2000			
FLUID DEGRADA		method	limit/base	current	history1	history2


0.33

Acid Number (AN)

mg KOH/g ASTM D8045 1.0



OIL ANALYSIS REPORT

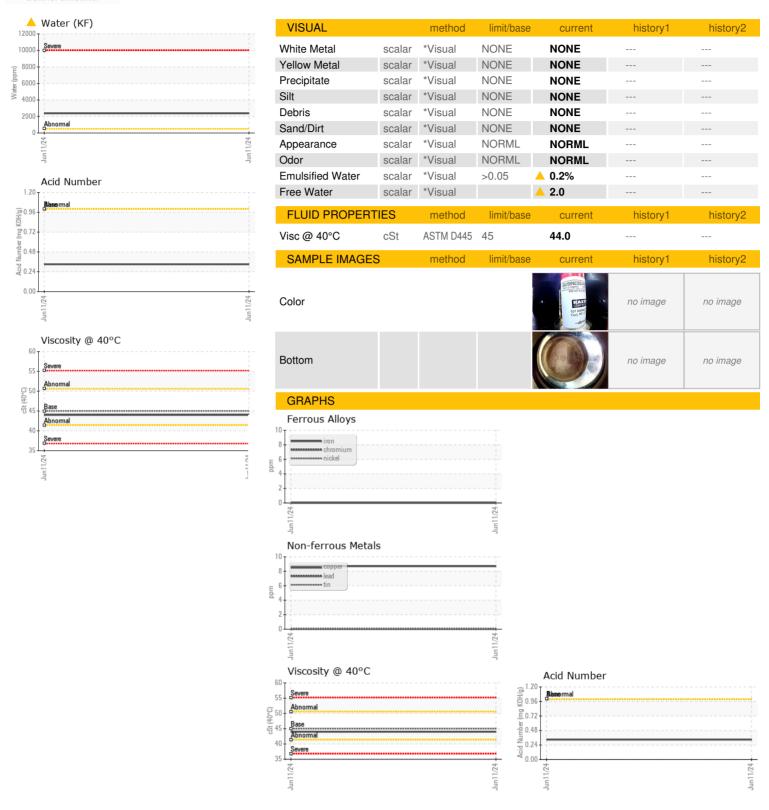





Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA018237 Lab Number : 06219686 Unique Number : 11097883

Received

: 25 Jun 2024 **Tested** : 26 Jun 2024 : 26 Jun 2024 - Don Baldridge Diagnosed

5382 RESEARCH DR, SUITE 107 HUNTINGTON BEACH, CA US 92649

Contact: Service Manager

NEWPORT PRINTING CO

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - NEWHUN

T:

F: