

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id

6752274 (S/N 1105)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018387		
Sample Date		Client Info		13 Jun 2024		
Machine Age	hrs	Client Info		33950		
Oil Age	hrs	Client Info		3000		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm		>50	6		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	7.0	0		
Cadmium	ppm	ASTM D5185m		0		
	ррпп			•		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	19		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	11		
Sulfur	ppm	ASTM D5185m	23500	22417		
CONTAMINANTS	j	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.012		
ppm Water	ppm	ASTM D6304	>500	124		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		18720		
Particles >6µm		ASTM D7647	>1300	4 9054		
Particles >14µm		ASTM D7647	>80	<u> 1191</u>		
Particles >21µm		ASTM D7647	>20	^ 208		
Particles >38µm		ASTM D7647	>4	<u>^</u> 6		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/20/17		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.45		
ACIO INGLIDEI (AIN)	mg NOTING	7.0 TWI D0040	1.0	0.70		



OIL ANALYSIS REPORT

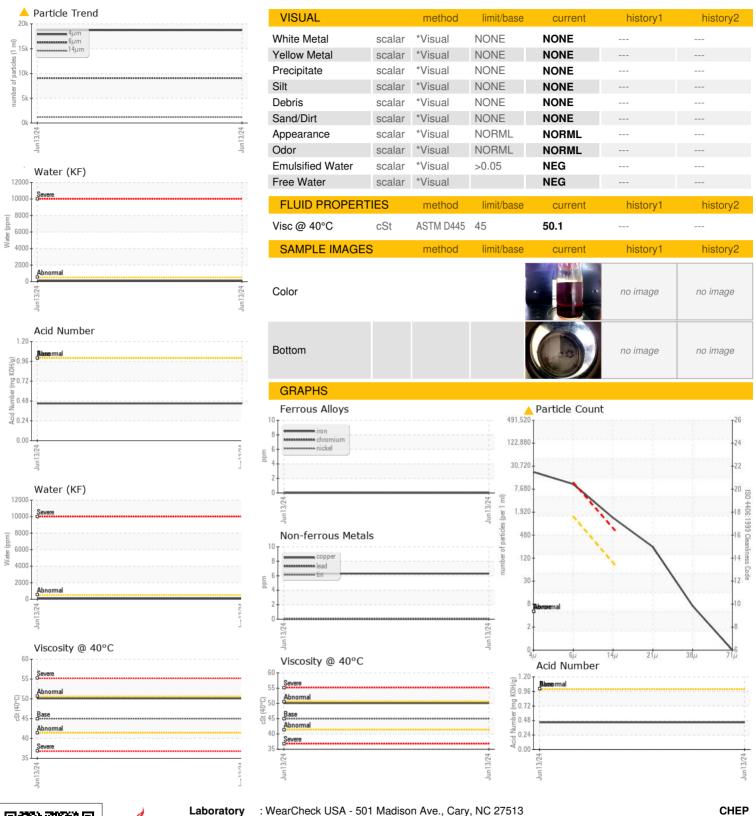



Certificate 12367

Sample No.

Lab Number : 06219687

: KCPA018387 Unique Number : 11097884

Received **Tested** Diagnosed

: 25 Jun 2024 : 26 Jun 2024

: 26 Jun 2024 - Don Baldridge

2053 MIGUEL BUSTAMANTE PKWY COLTON, CA US 92324

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369. Contact: JASON PINEDA jason.pineda@chep.com T:

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: