




OIL ANALYSIS REPORT

Sample Rating Trend

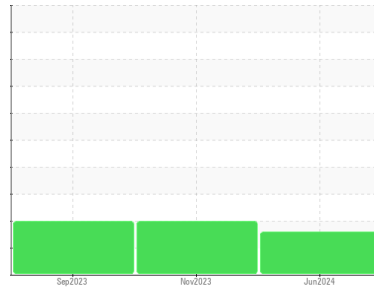

ISO



Machine Id

8670737 (S/N 1364)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA018375	KCPA003242	KCPA005714
Sample Date	Client Info		13 Jun 2024	15 Nov 2023	13 Sep 2023
Machine Age	hrs	Client Info	3859	2301	1769
Oil Age	hrs	Client Info	3000	0	0
Oil Changed	Client Info		Changed	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	<1	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	<1	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	2	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	1	2	4
Tin	ppm	ASTM D5185m >10	0	0	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	13	34	1
Molybdenum	ppm	ASTM D5185m 0	0	<1	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 100	55	51	46
Calcium	ppm	ASTM D5185m 0	<1	2	0
Phosphorus	ppm	ASTM D5185m 0	<1	10	4
Zinc	ppm	ASTM D5185m 0	2	5	10
Sulfur	ppm	ASTM D5185m 23500	21153	14442	20861

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	2	<1
Sodium	ppm	ASTM D5185m	16	5	9
Potassium	ppm	ASTM D5185m >20	3	<1	6
Water	%	ASTM D6304 >0.05	0.019	0.022	0.014
ppm Water	ppm	ASTM D6304 >500	197	229	149.0






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		7435	18026	20491
Particles >6µm	ASTM D7647 >1300		▲ 2669	▲ 5418	▲ 7578
Particles >14µm	ASTM D7647 >80		▲ 225	▲ 442	▲ 1209
Particles >21µm	ASTM D7647 >20		▲ 45	▲ 127	▲ 379
Particles >38µm	ASTM D7647 >4		1	▲ 5	▲ 7
Particles >71µm	ASTM D7647 >3		0	0	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	▲ 21/20/16	▲ 22/20/17

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.40	0.35	0.40


OIL ANALYSIS REPORT

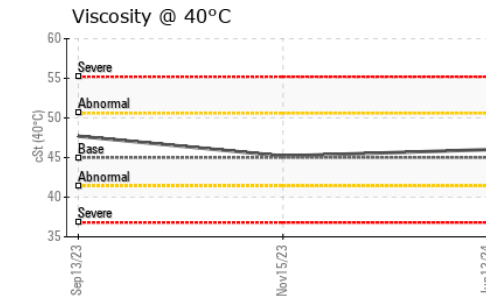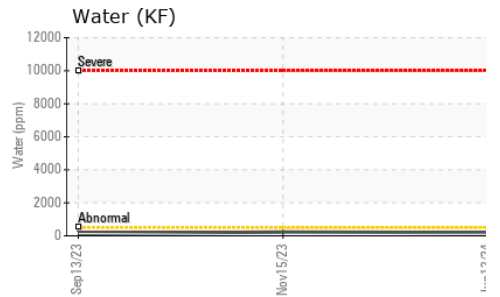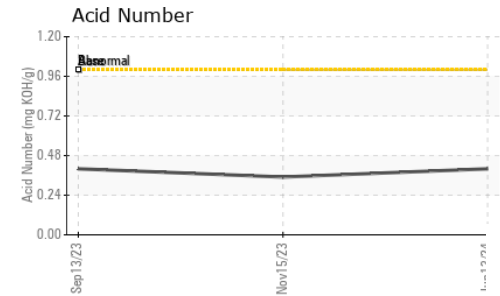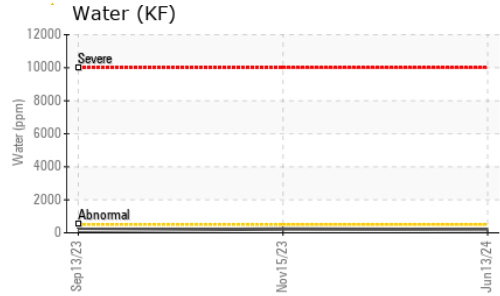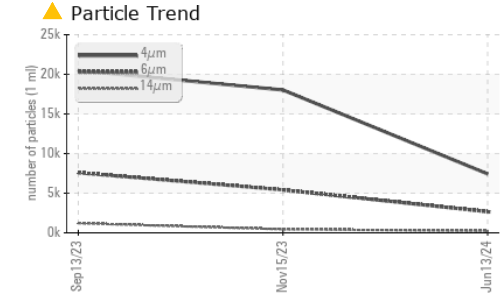






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.0	45.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

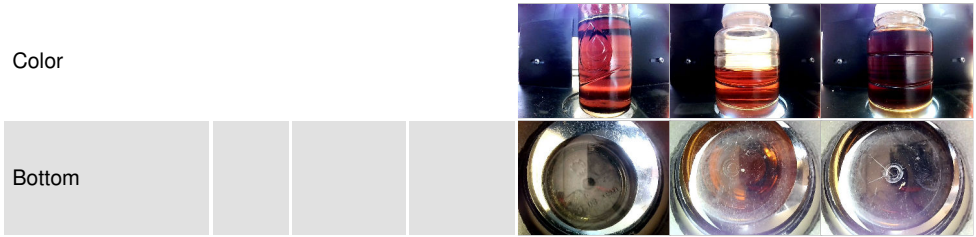

GRAPHS

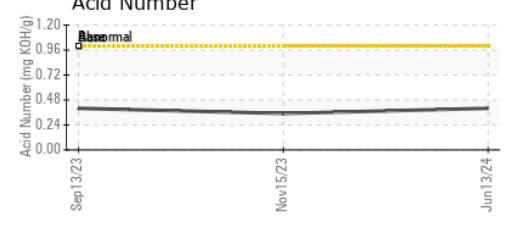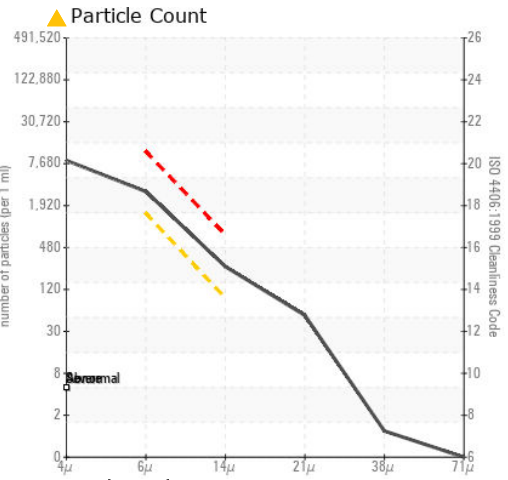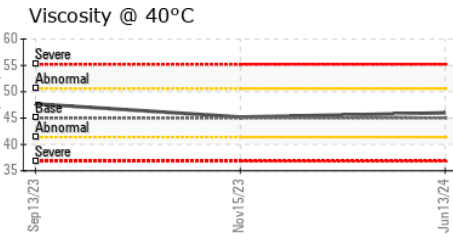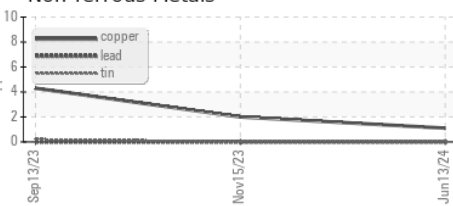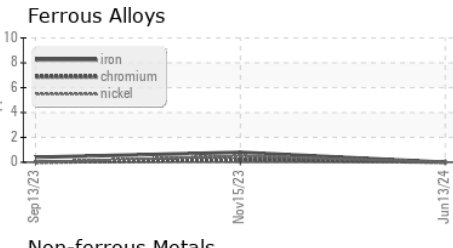

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA018375
Lab Number : 06219688
Unique Number : 11097885
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 25 Jun 2024
Tested : 26 Jun 2024
Diagnosed : 26 Jun 2024 - Don Baldrige

CHEP
 2053 MIGUEL BUSTAMANTE PKWY
 COLTON, CA
 US 92324
 Contact: JASON PINEDA
 jason.pineda@chep.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)