


OIL ANALYSIS REPORT

Sample Rating Trend

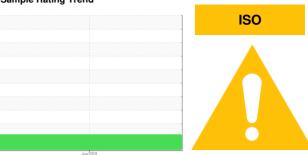

Machine Id

7865977 (S/N 1162)

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

		1		Jun2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018378		
Sample Date		Client Info		24 Jun 2024		
Machine Age	hrs	Client Info		3819		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
		ASTM D5185m	>10	0		
Lead	ppm			2		
Copper	ppm	ASTM D5185m	>50			
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m	500	4		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		4667		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.001		
ppm Water	ppm	ASTM D6304	>500	13		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		7451		
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2577		
Particles >14µm		ASTM D7647	>80	123		
Particles >21µm		ASTM D7647	>20	16		
Particles >38µm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.26		



OIL ANALYSIS REPORT

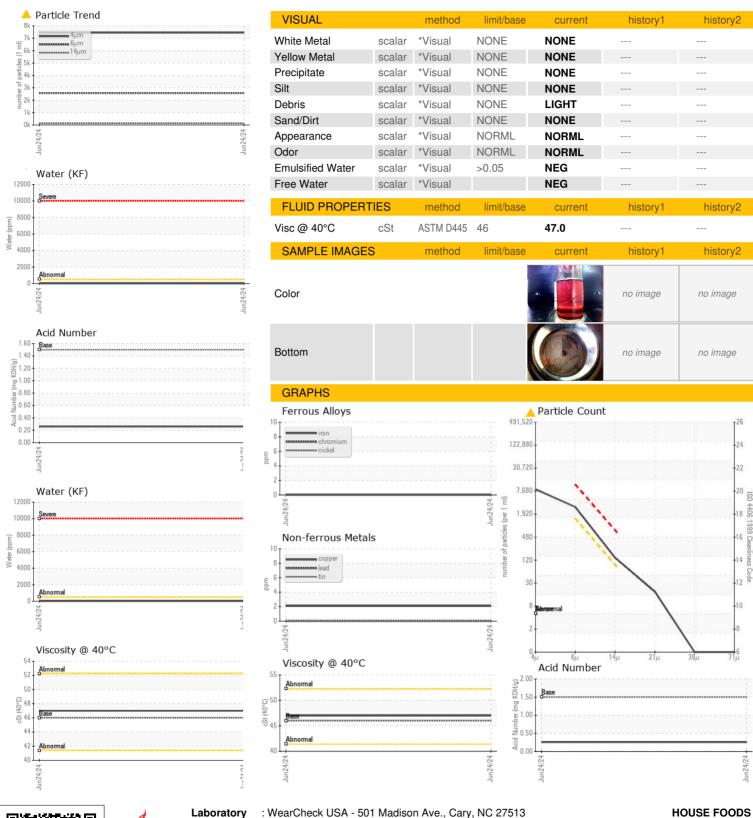



Laboratory Sample No. Lab Number

: KCPA018378 : 06219694 Unique Number : 11097891

Received : 25 Jun 2024 Tested : 26 Jun 2024 Diagnosed

: 26 Jun 2024 - Don Baldridge

7351 ORANGEWOOD AVE GARDEN GROVE, CA US 92841 Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: HOUGAR [WUSCAR] 06219694 (Generated: 06/27/2024 14:17:06) Rev: 1

Contact/Location: Service Manager - HOUGAR

T:

F: