




OIL ANALYSIS REPORT

Sample Rating Trend

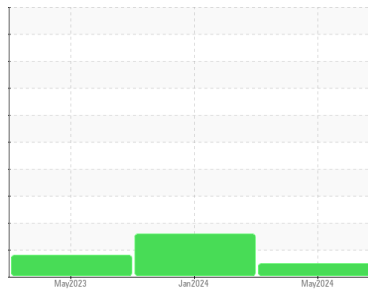

NORMAL



Machine Id
8431096 (S/N 1524)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC124584	KC121972	KC106108
Sample Date	Client Info			28 May 2024	05 Jan 2024	22 May 2023
Machine Age	hrs	Client Info		8834	6994	4152
Oil Age	hrs	Client Info		0	0	4152
Oil Changed	Client Info			N/A	N/A	Changed
Sample Status				NORMAL	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	3
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	2	0
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	2	4	2
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	5	10	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	29	44	44
Calcium	ppm	ASTM D5185m	2	0	4	2
Phosphorus	ppm	ASTM D5185m		0	26	3
Zinc	ppm	ASTM D5185m		0	0	3

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	1
Sodium	ppm	ASTM D5185m		10	7	11
Potassium	ppm	ASTM D5185m	>20	1	2	2
Water	%	ASTM D6304	>0.05	0.014	▲ 0.298	0.013
ppm Water	ppm	ASTM D6304	>500	147	▲ 2980	130.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1718	---	4600
Particles >6µm		ASTM D7647	>1300	863	---	● 1668
Particles >14µm		ASTM D7647	>80	32	---	61
Particles >21µm		ASTM D7647	>20	4	---	11
Particles >38µm		ASTM D7647	>4	0	---	0
Particles >71µm		ASTM D7647	>3	0	---	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	18/17/12	---	● 19/18/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31	0.32	0.29


OIL ANALYSIS REPORT

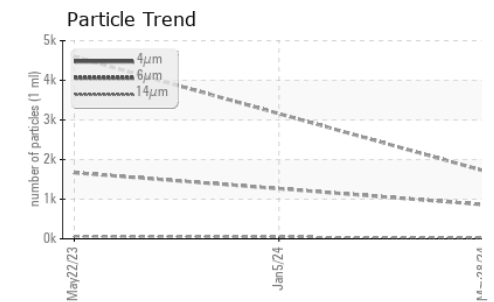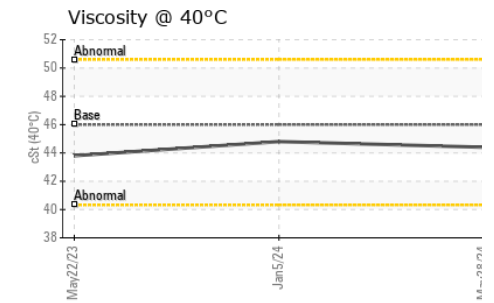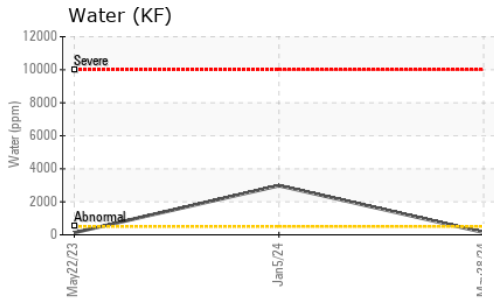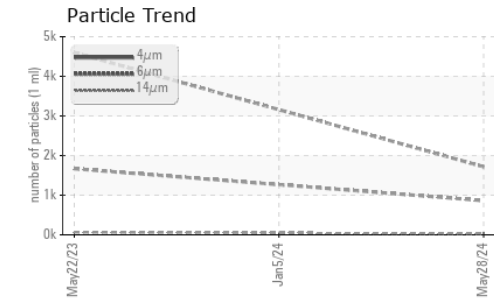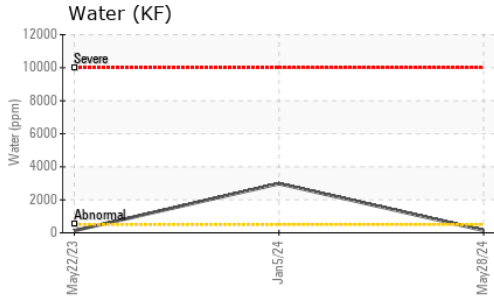






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	HEAVY	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	44.4	44.8	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

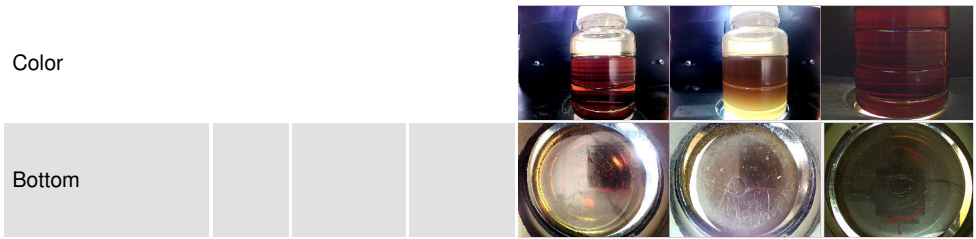

GRAPHS

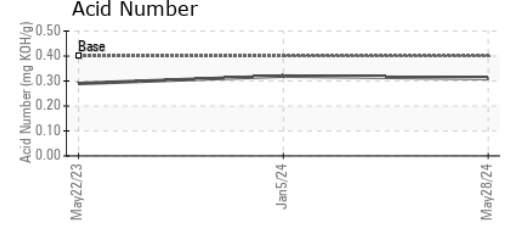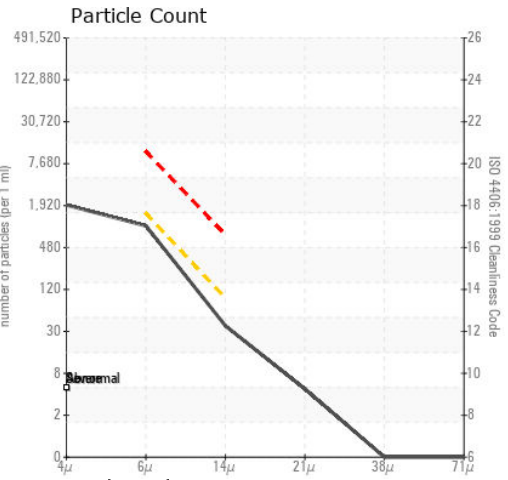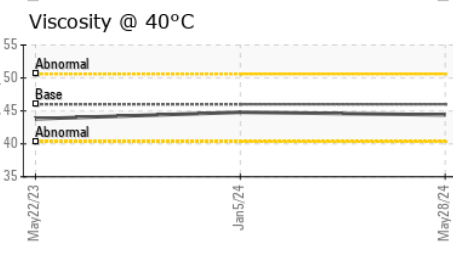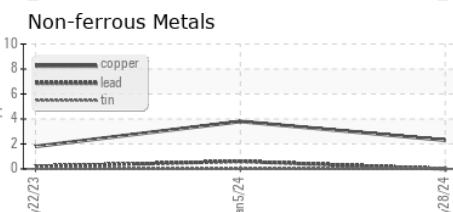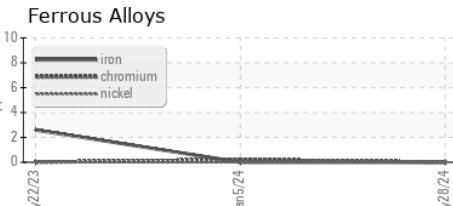

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC124584
Lab Number : 06219698
Unique Number : 11097895
Test Package : IND 2
Received : 25 Jun 2024
Tested : 26 Jun 2024
Diagnosed : 26 Jun 2024 - Don Baldrige

INTEGER HOLDINGS
 101 E MILL ST
 QUAKERTOWN, PA
 US 18951
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)